NHP

MOD6+™
CIRCUIT BREAKERS

MD6AFDDR
Operation
and
Installation
Manual

Installation

12 mm

2.8 Nm

≤ 25 mm²

10 mm²

Insulation test

≤ 1000 V AC/DC

> 1000 V AC/DC
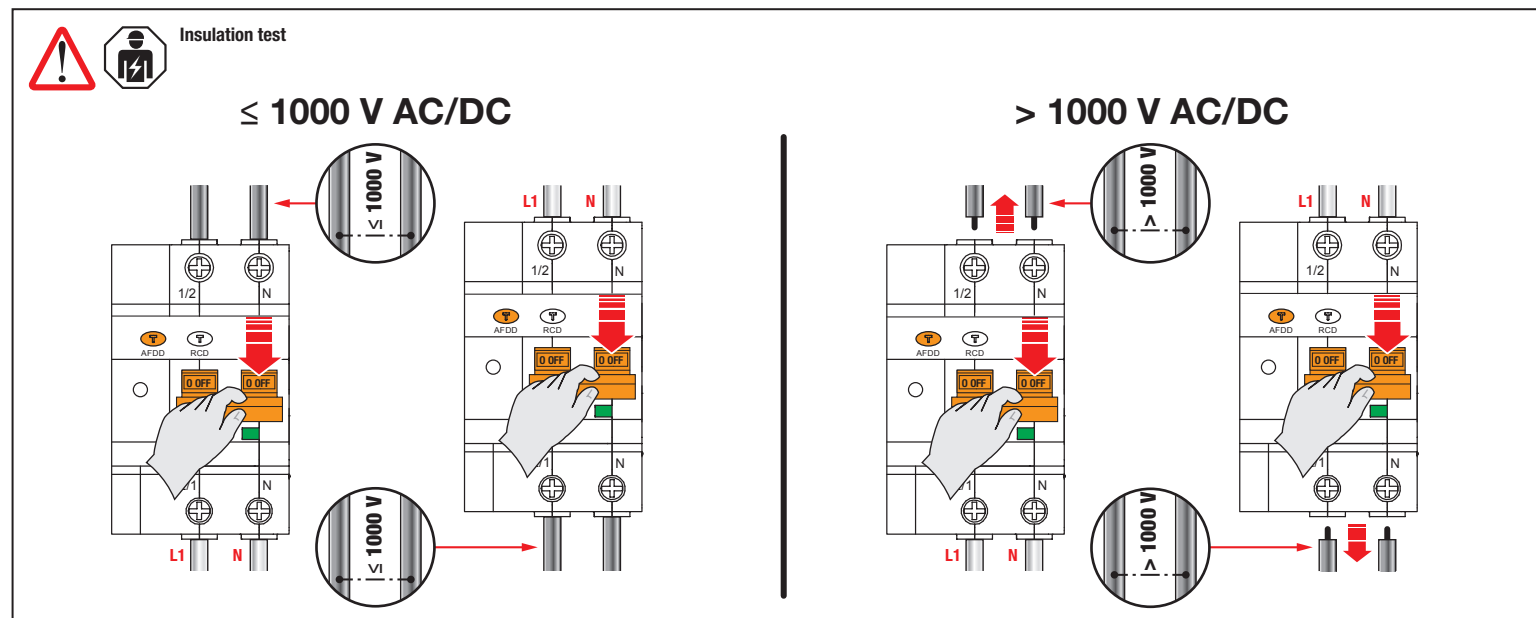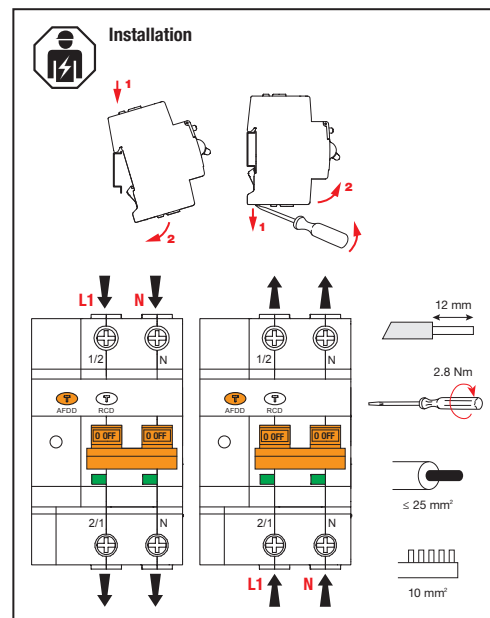
TEST AFDD

Suggested every six months

JUL JAN

OK

KO
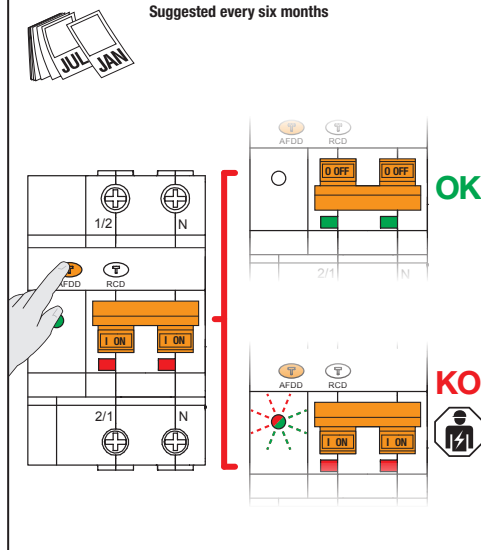
TEST RCD ⚠

Every six months

JUL JAN

OK

KO
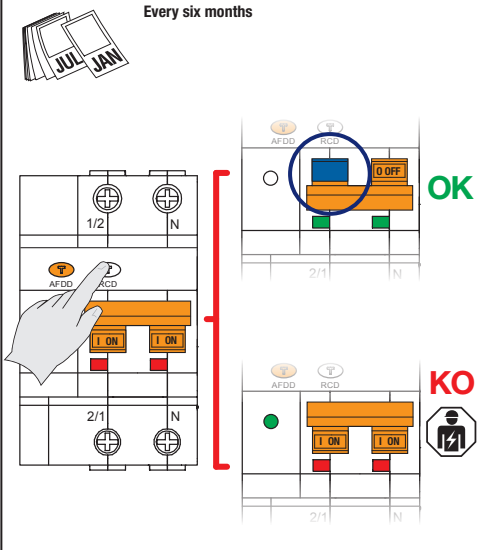
LED indications without tripping

OK

!

KO

KO

OK
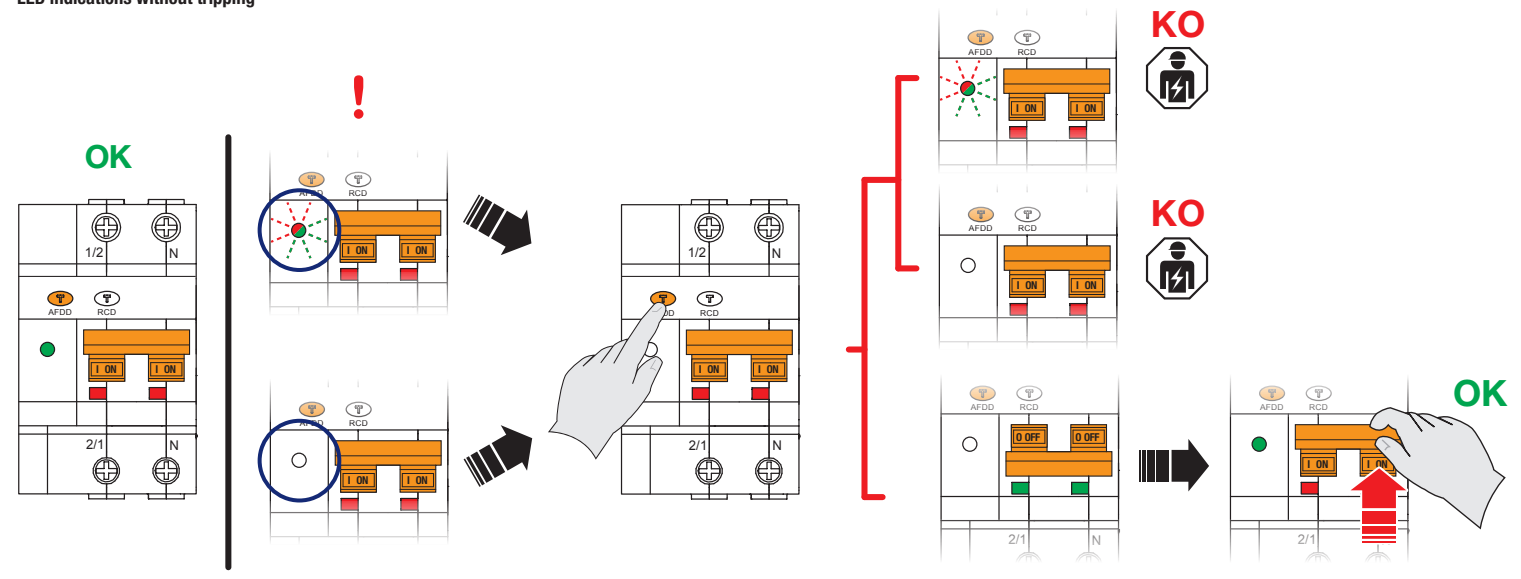
LED indications after tripping

I > In (MCB)

IΔ > IΔn (RCD)

		(AFDD)		
1 blink/sec	5 sec			
2 blink/sec	5 sec			
3 blink/sec	5 sec	**U > 275 V**		
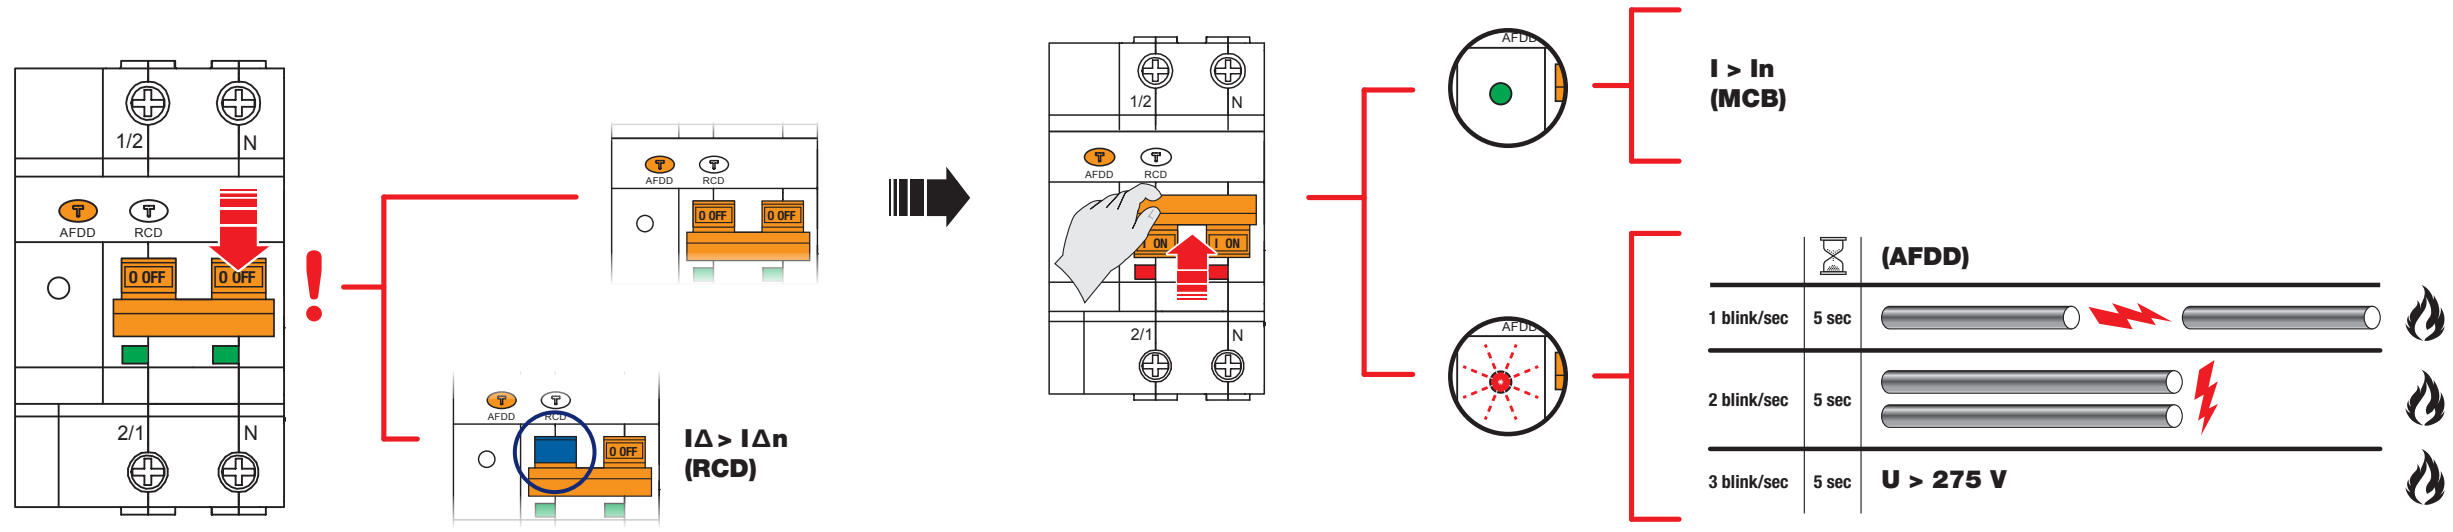
Recall of the last LED indication due to arc fault tripping or overvoltage

RECALL
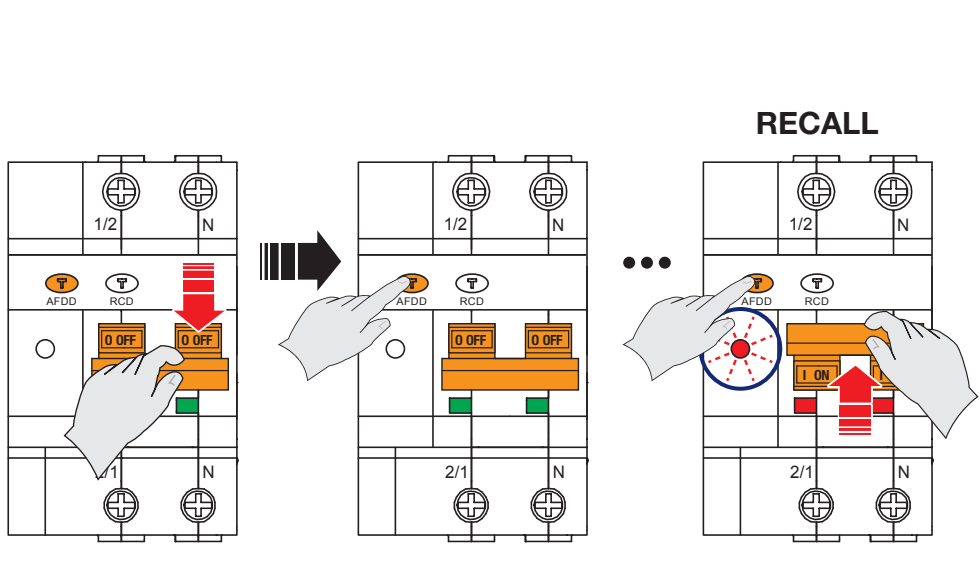
Clearing of the memory of the last LED indication due to arc fault tripping or overvoltage

CLEARING   **OK**