


# Application Guidelines

## Copeland™ Scroll Digital Compressors for Refrigeration Applications YBD17K1E to YBD36K1E



**COPELAND**

  
**EMERSON**

<b>About these guidelines .....</b>	<b>1</b>
<b>1 Safety instructions .....</b>	<b>1</b>
1.1 Icon explanation .....	1
1.2 Safety statements .....	2
1.3 General instructions .....	2
<b>2 Product description .....</b>	<b>3</b>
2.1 Compressor range .....	3
2.2 Nomenclature.....	3
2.3 BOM Variation.....	3
2.4 Application range .....	4
2.4.1 Qualified refrigerants and oils .....	4
2.4.2 Application limits.....	4
2.4.3 PED category and maximum allowable pressure PS .....	4
2.5 Dimensions .....	5
<b>3 Installation .....</b>	<b>6</b>
3.1 Compressor handling .....	6
3.1.1 Transport and storage .....	6
3.1.2 Positioning and securing .....	6
3.1.3 Installation location.....	6
3.2 Mounting parts .....	7
3.3 Brazing procedure.....	7
3.3.1 General brazing procedure.....	8
3.3.2 Brazing procedure for YBD*K1E compressors in parallel applications.....	8
3.4 Pressure safety controls .....	9
3.4.1 High-pressure protection .....	9
3.4.2 Low-pressure protection.....	9
3.5 Crankcase heater.....	9
3.6 Discharge gas temperature protection.....	11
3.6.1 Excessive discharge gas temperatures .....	11
3.6.2 Discharge line thermostat.....	11
3.7 Discharge temperature sensor NTC .....	12
3.8 Internal pressure relief valve.....	12
3.9 Discharge check valve .....	13
3.10 Digital solenoid valves .....	13
3.10.1 External solenoid valves for the design concept with internal lifting piston .....	13
3.10.2 External solenoid valve installation – General recommendations.....	14
3.10.3 External solenoid valve installation – Tubing recommendations .....	14
3.11 Filter screens .....	15
3.12 Mufflers .....	15
3.13 Sound shell .....	15

3.14	Insulation material .....	15
3.15	Sound and vibration .....	16
3.16	Compressor oil return, oil balancing and floodback tests .....	16
3.17	Suction line accumulator .....	17
<b>4</b>	<b>Electrical connection .....</b>	<b>18</b>
4.1	General recommendations .....	18
4.2	Electrical installation .....	18
4.3	Terminal box .....	19
4.4	Motor insulation .....	20
4.5	Motor protection .....	20
4.6	High potential testing .....	20
<b>5</b>	<b>Start-up &amp; operation.....</b>	<b>21</b>
5.1	Strength-pressure test .....	21
5.1.1	Compressor strength-pressure test.....	21
5.1.2	System strength-pressure test .....	21
5.2	Compressor tightness test .....	22
5.3	System evacuation.....	22
5.4	Preliminary checks – Pre-starting .....	22
5.5	Charging procedure .....	23
5.6	Run-in time.....	23
5.7	Initial start-up .....	23
5.8	Rotation direction .....	23
5.9	Pressure fluctuations .....	24
5.10	Starting sound .....	24
5.11	Deep vacuum operation .....	24
5.12	Shell temperature.....	24
5.13	Pumpdown cycle .....	24
5.14	Minimum run time .....	25
5.15	Sound characteristics.....	25
5.16	Shut-off sound.....	25
5.17	Supply frequency and voltage .....	25
5.18	Oil level .....	25
5.19	Controlling the digital scroll .....	26
5.20	Power factor and power input .....	26
<b>6</b>	<b>Maintenance &amp; repair .....</b>	<b>28</b>
6.1	Qualification of workers.....	29
6.2	Preparation and work procedure .....	29
6.3	Disassembling system components .....	29
6.4	Exchanging the refrigerant.....	30
6.5	Replacing a compressor .....	30

6.5.1	Compressor replacement.....	30
6.5.2	Start-up of a new or replacement compressor.....	30
6.5.3	Compressor return procedure for A2L systems .....	31
6.6	Lubrication and oil removal .....	31
6.7	Oil additives .....	32
<b>7</b>	<b>Dismantling &amp; disposal.....</b>	<b>33</b>
<b>8</b>	<b>References.....</b>	<b>33</b>
	<b>Appendix1: Tightening torques .....</b>	<b>34</b>
	<b>DISCLAIMER .....</b>	<b>34</b>

---



## About these guidelines

The purpose of these guidelines is to provide guidance in the application of Copeland™ scroll compressors in users' systems. They are intended to answer the questions raised while designing, assembling and operating a system with these products.

Besides the support they provide, the instructions listed herein are also critical for the proper and safe functioning of the compressors. The performance and reliability of the product may be impacted if the product is not used according to these guidelines or is misused.

These application guidelines cover stationary applications only. For mobile applications, please contact the Application Engineering department at Emerson as other considerations may apply.

## 1 Safety instructions

Copeland scroll compressors are manufactured according to the latest relevant US and European safety standards. Particular emphasis has been placed on the user's safety.

YBD\*K1E compressors are intended for installation in systems in accordance with the European Machinery Directive MD 2006/42/EC, the Pressure Equipment Directive PED 2014/68/EU and the Low Voltage Directive LVD 2014/35/EU. They may be put to service only if they have been installed in systems according to instructions and conform to the corresponding provisions of legislation.









**NOTE: Only dedicated compressors are allowed to be used with flammable refrigerants. Emerson marks all compressors that are qualified for flammable refrigerants with a sticker indicating the usage of such refrigerants. Systems using flammable refrigerants must be executed correctly while observing safety rules, as specified in corresponding safety standards such as, but not limited to EN 378. They must comply with any and all applicable legislation and regulations. Ensuring compliance remains the user's responsibility.**

The Material Safety Datasheet (MSDS) for the individual refrigerant shall be considered when working with this type of refrigerant – please check this document provided by the gas supplier.

These instructions shall be retained throughout the lifetime of the compressor.

**You are strongly advised to follow these safety instructions.**

### 1.1 Icon explanation

 <b>WARNING</b> This icon indicates instructions to avoid personal injury and material damage.	 <b>Fire hazard</b> This icon indicates a risk of flammable atmosphere.
 <b>High voltage</b> This icon indicates operations with a danger of electric shock.	 <b>CAUTION</b> This icon indicates instructions to avoid property damage and possible personal injury.
 <b>Danger of burning or frostbite</b> This icon indicates operations with a danger of burning or frostbite.	 <b>IMPORTANT</b> This icon indicates instructions to avoid malfunction of the compressor.
 <b>Explosion hazard</b> This icon indicates operations with a danger of explosion.	<b>NOTE</b> This word indicates a recommendation for easier operation.
 <b>Danger of explosive atmosphere</b> This icon indicates a risk of explosive atmosphere.	

## 1.2 Safety statements

- Refrigerant compressors must be employed only for their intended use. The system has to be labelled according to the applicable standards and legislation.
- Only qualified and authorized RACHP (refrigeration, air conditioning and heat pump) personnel are permitted to install, commission and maintain this equipment.
- Electrical connections must be made by qualified electrical personnel.
- All valid standards for connecting electrical and refrigeration equipment must be observed.
- The national legislation and regulations regarding personnel protection must be observed.

Additional requirements and statements for A2L refrigerant compressor/systems:

- Only competent personnel (as specified in EN 13313) qualified for flammable refrigerant handling is permitted to commission, initiate and maintain the compressor/refrigeration systems using flammable refrigerant; non-trained personnel, including the user, are not allowed to do so and must call on an expert.
- The maximum refrigerant charge is specified in standards such as, but not limited to EN 378, EN 60335-2-40 and EN 60335-2-89. The system designer shall implement all safety measures defined by the applicable standards and the maximum refrigerant charge shall not be exceeded.
- If a flammable atmosphere is detected, immediately take all necessary precautions to mitigate the risk as determined in the risk assessment.



**Use personal safety equipment.** Safety goggles, gloves, protective clothing, safety boots and hard hats should be worn where necessary.

## 1.3 General instructions



### WARNING

**Pressurized system! Serious personal injuries and/or system breakdown!** Accidental system start before complete set-up must be avoided. Never leave the system unattended without locking it out electrically when it is on vacuum and has no refrigerant charge, when it has a holding charge of nitrogen, or when the compressor service valves are closed.



### WARNING

**System breakdown! Personal injuries!** Only approved refrigerants and refrigeration oils must be used.



### WARNING

**High shell temperature! Burning!** Do not touch the compressor until it has cooled down. Ensure that other materials in the area of the compressor do not come into contact with it. Lock and mark accessible sections.




### CAUTION

**Overheating! Bearing damage!** Do not operate compressor without refrigerant charge or without it being connected to the system.



### CAUTION

**Contact with refrigerant oil! Material damage!** Polyolester (POE) lubricant must be handled carefully and the proper protective equipment (gloves, eye protection, etc.) must be used at all times. Refrigerant oil must not come into contact with any surface or material that it might damage, including without limitation, certain polymers, eg, PVC/CPVC and polycarbonate.



### IMPORTANT

**Transit damage! Compressor malfunction!** Use original packaging. Avoid collisions and tilting.

## 2 Product description

### 2.1 Compressor range

These application guidelines cover Copeland scroll compressor models YBD\*K1E for medium temperature refrigeration applications. YBD\*K1E scroll compressors can be operated with both A1 and A2L refrigerants.

Compressor	Cooling capacity* (kW)									Motor
	R404A	R407A	R407F	R448A	R449A	R407C	R513A	R134a	R450A	
YBD17K1E	4.86	4.78	5.19	4.89	4.89	4.46	3.14	2.91	2.51	TFMN
YBD24K1E	6.28	6.18	6.71	6.33	6.33	5.75	4.06	3.91	3.36	TFMN
YBD31K1E	7.98	7.84	8.51	8.04	8.04	7.34	5.18	4.92	4.24	TFMN
YBD36K1E	9.65	9.48	10.30	9.72	9.72	8.81	6.22	5.94	5.12	TFMN

Table 1: YBD\*K1E model overview for MT applications with A1 refrigerants

Compressor	Cooling capacity* (kW)				Motor
	R454C	R455A	R454A	R1234yf	
YBD17K1E	4.28	4.57	5.10	2.87	TFMN
YBD24K1E	5.55	5.88	6.60	3.71	TFMN
YBD31K1E	7.00	7.45	8.38	4.70	TFMN
YBD36K1E	8.41	8.97	10.15	5.60	TFMN

Table 2: YBD\*K1E model overview for MT applications with A2L refrigerants

\* Refrigerant dew temperature, evaporating temperature: -10 °C; condensing temperature: 45 °C; suction gas superheat: 10 K; liquid sub-cooling: 0 K; frequency: 50 Hz

### 2.2 Nomenclature

The model designation contains the following technical information about the compressor:

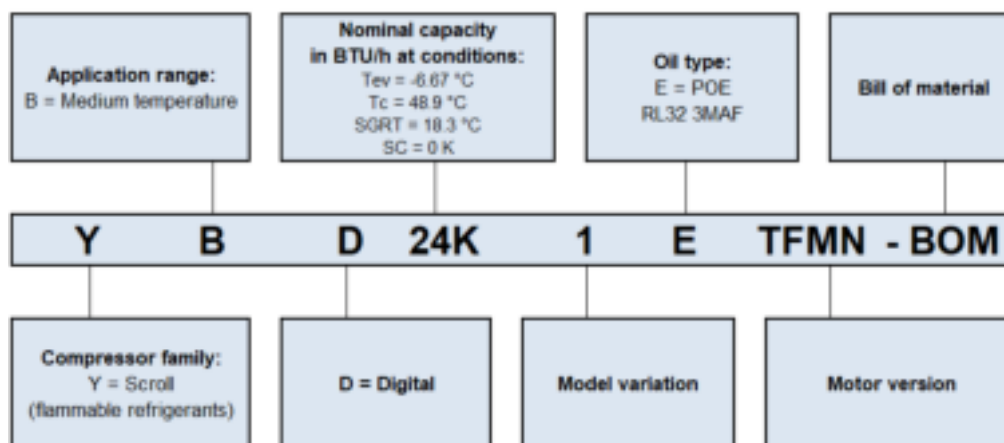


Figure 1: Nomenclature

### 2.3 BOM Variation

The BOM (bill of material) number at the end of the compressor designation indicates the different compressor layouts and details. YBD\*K1E compressor models are available in the following BOM versions:

BOM	Suction and discharge connections	T-Box	Mounting parts	Features
XBS	Braze stub tubes	IP54	Without	Single compressor
XCG				Extra tube for paralleling

Table 3: BOM designation

Please refer to the Emerson price list for more details.

## 2.4 Application range

### 2.4.1 Qualified refrigerants and oils



#### IMPORTANT

Some refrigerant blends have a significant temperature glide. It is essential that the glide of the refrigerant blends be carefully considered when adjusting pressure and superheat controls.



#### IMPORTANT

Refrigerant blends with low GWP containing HFO's have a low chemical stability in presence of air or humidity. The same levels of cleanliness, dryness and evacuation of the refrigerant circuit are required as in HFC & POE applications, including the use of filter dryers.

**NOTE:** R454C, R455A, R454A and R1234yf are classified as A2L (mildly flammable) refrigerants.

Compressors	YBD17K1E to YBD36K1E
Qualified refrigerants	R404A, R407A, R407F, R448A, R449A, R407C, R513A, R134a and R450A R454C, R455A, R454A and R1234yf
Qualified oil (factory charged)	RL32 3MAF
Servicing oil	RL32 3MAF

Table 4: Qualified refrigerants and oil

Oil recharge values can be taken from the compressor nameplate or from Copeland Select software available at [www.climate.emerson.com/en-gb](http://www.climate.emerson.com/en-gb).

**NOTE:** For systems using A1 refrigerants (R404A, R407A, R407F, R448A, R449A, R407C, R513A, R134a or R450A) the flammable refrigerant sticker is not of application and can be removed from the compressor.

### 2.4.2 Application limits



#### CAUTION

**Inadequate lubrication! Compressor breakdown!** The superheat at the compressor suction inlet must always be sufficient to ensure that no refrigerant droplets enter the compressor. For a typical evaporator-expansion valve configuration a minimum stable superheat of at least 5 K is required.

For application envelopes and technical data, please refer to Copeland Select software available at [www.climate.emerson.com/en-gb](http://www.climate.emerson.com/en-gb).

### 2.4.3 PED category and maximum allowable pressure PS

The nameplate of the compressor contains information about the maximum allowable pressure PS, the minimum and maximum allowed temperature TS, the internal free volume and the fluid groups of the refrigerants qualified for the compressor model range. Values are given for the two existing pressure ranges on low- and high-pressure side.

Compressor	PS High-pressure side	PS Low-pressure side	TS max. Low-pressure side	Internal free volume LP side (litres)	Internal free volume HP side (litres)
YBD17K1E	38 bar(g)	23.5 bar(g)	50 °C	4.3	0.5
YBD24K1E	38 bar(g)	23.5 bar(g)	50 °C	4.8	0.5
YBD31K1E	38 bar(g)	23.5 bar(g)	50 °C	6.4	0.6
YBD36K1E	38 bar(g)	23.5 bar(g)	50 °C	6.4	0.6

Table 5: Maximum allowable pressures, temperatures and internal free volumes

The PED category is assigned according to the Pressure Equipment Directive PED 2014/68/EU. Requirements apply to the relevant pressure levels in the compressor if a limit value for the product of pressure relative to the environment and relevant internal free volume exceeds certain limits. For

the calculation of the PED category, a differentiation must be made between the high- and low-pressure sides. The highest of the calculation results is considered to determine the PED category.

YBD\*K1E scroll compressors can be operated with both A1 and A2L refrigerants. To determine the PED category a distinction is made between refrigerants of fluid group 1 (flammable) and fluid group 2 (non-flammable). As a result, identical compressor models may be subject to different PED categories depending on the refrigerant used.

Compressor range	Refrigerant	Fluid group	PED class
YBD17K1E to YBD36K1E	R454C, R455A, R454A, R1234yf	1	2
	R404A, R407A, R407F, R448A, R449A, R407C, R513A, R134a, R450A	2	1

Table 6: PED class based on refrigerant used

## 2.5 Dimensions

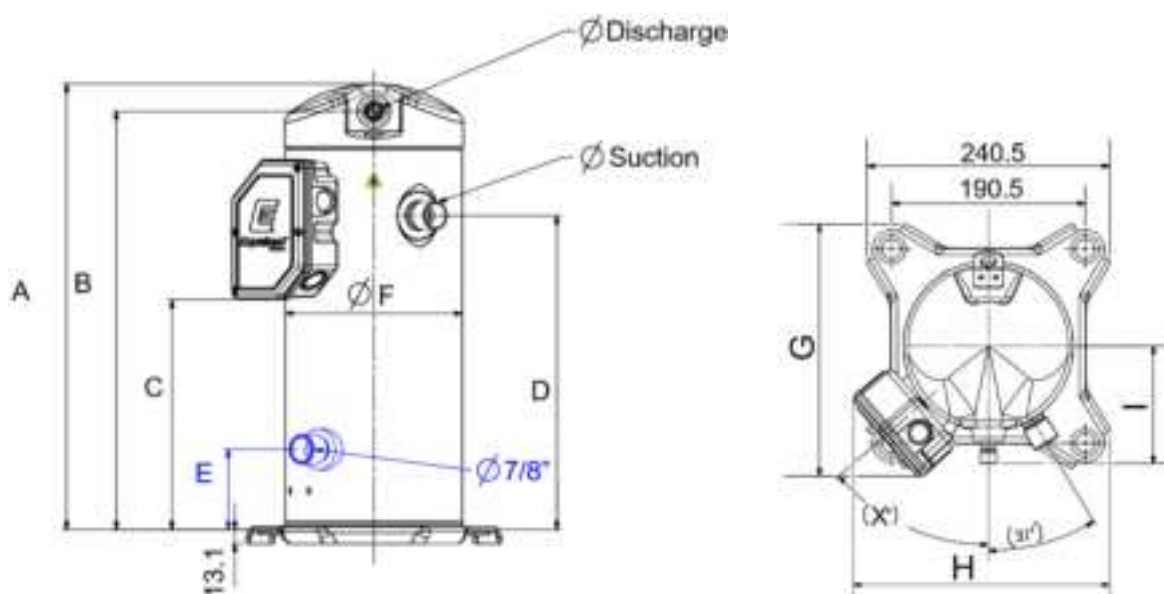


Figure 2

**NOTE:** The connection in blue colour is an additional connection for paralleling models (with BOM XCG).

Compressor	A ± 3.0 (mm)	B (mm)	C ± 3.0 (mm)	D (mm)	E (mm)	Ø F (mm)	G (mm)	H (mm)	I (mm)	X (°)
YBD17K1E	432.5	366.3	185.7	264.4	75.3	165.8	247.5	252.8	116.8	49
YBD24K1E	466	397.1	215.4	294.1	75.3	165.8	247.5	252.8	116.8	49
YBD31K1E	481	412.1	225.2	296.7	79.6	185.5	260.5	254.9	125.6	44
YBD36K1E	481	412.1	225.2	296.7	79.6	185.5	260.5	254.9	125.6	44

Table 7: Dimensions of YBD\*K1E compressors

Compressor	Suction (inch)	Discharge (inch)
YBD17K1E	3/4"	1/2"
YBD24K1E	7/8"	1/2"
YBD31K1E	7/8"	1/2"
YBD36K1E	7/8"	1/2"

Table 8: Connection sizes of YBD\*K1E compressors

## 3 Installation



### WARNING

**High pressure! Injury to skin and eyes possible!** Be careful when opening connections on a pressurized item.

### 3.1 Compressor handling

#### 3.1.1 Transport and storage



### WARNING

**Risk of collapse! Personal injuries!** Move compressors only with appropriate mechanical or handling equipment according to weight. Keep in the upright position. Respect stacking loads according to **Figure 3**. Check the tilting stability and if needed take action to ensure the stability of the stacked loads. Keep the packaging dry at all times.



Respect the maximum number of identical packages which may be stacked on one another, where "n" is the limiting number:


- **Transport: n = 1**
- **Storage: n = 2**

Figure 3: Maximum stacking loads for transport and storage

The compressor tilt angle should not exceed 30° during transport and handling. This will prevent oil from exiting through the suction stub. A tilt angle of maximum 45° is allowed for a very short time. Tilting the compressor more than 45° might affect its lubrication at start-up.

**NOTE:** The compressor is pre-charged with dry air to avoid any moisture contamination.

#### 3.1.2 Positioning and securing



### IMPORTANT

**Handling damage! Compressor malfunction!** Only use the lifting eyes whenever the compressor requires positioning. Using discharge or suction connections for lifting may cause damage or leaks.

The compressor should be kept vertical during handling.

The discharge connection plug should be removed first before pulling the suction connection plug to allow the dry air pressure inside the compressor to escape. Pulling the plugs in this sequence prevents oil mist from coating the suction tube making brazing difficult. The copper-coated steel suction tube should be cleaned before brazing.

The plugs must be removed as late as possible before brazing so that the air humidity does not affect the oil characteristics.

For YBD\*K1E compressors, as oil might spill out of the suction connection located low on the shell, the suction connection plug must be left in place until the compressor is set into the unit.

No object, eg, a swaging tool should be inserted deeper than 51 mm into the suction tube as it might damage the suction screen and motor.

#### 3.1.3 Installation location

Ensure the compressors are installed on a solid level base. For single-compressor applications, the compressor tilt angle during operation should not exceed 15° to allow adequate lubrication. For multiple-compressor parallel configurations, the compressors must be positioned completely vertically on a totally horizontal surface or rail.

### 3.2 Mounting parts

The compressors are designed to be mounted on vibration absorber grommets. The grommets dampen the start-up surge of the compressor and minimise sound and vibration transmission to the compressor base during operation. The metal sleeve inside is a guide designed to hold the grommet in place. It is not designed as a load-bearing member, and application of excessive torque to the bolts can crush the sleeve. Its inner diameter is approximately 8.5 mm to fit, eg, an M8 screw. The mounting torque should be  $13 \pm 1$  Nm. It is critically important that the grommet is not compressed.

If the compressors are mounted in tandem or used in parallel, then the hard mountings (bolt M8) are recommended. The mounting torque should be  $27 \pm 1$  Nm.

See Emerson spare parts software for reference.

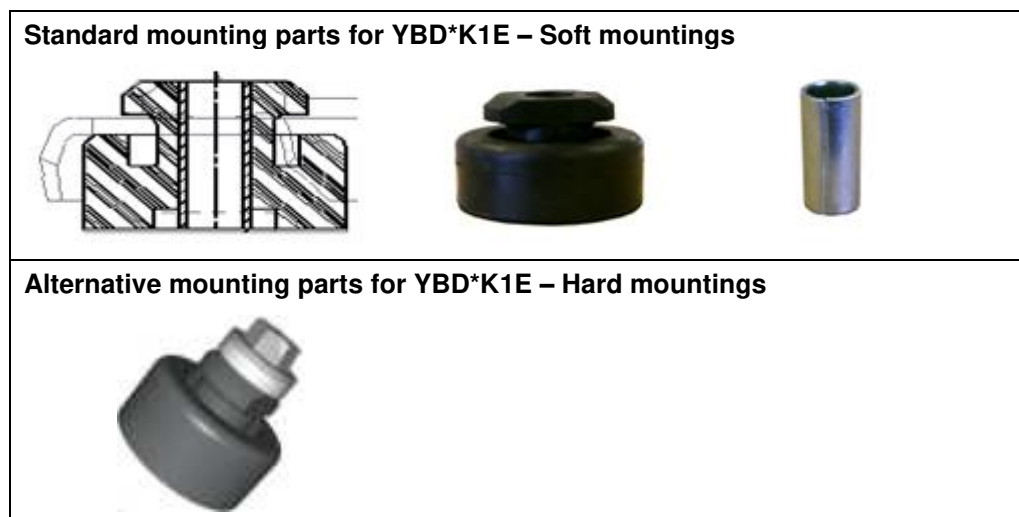


Figure 4: Mounting parts

### 3.3 Brazing procedure



#### WARNING

**Air/flamable refrigerant mixture! Creation of a potentially flammable atmosphere! Fire hazard!** Remove all refrigerant before opening the system. When working on a refrigerant-filled system, make sure to follow the safety and working instructions given in **Chapter 6 "Maintenance & repair"**.



#### WARNING

**High temperature! Burning!** Proceed with caution when brazing system components. Do not touch the compressor until it has cooled down. Ensure that other materials in the area of the compressor do not come into contact with it.



#### CAUTION

**Blockage! Compressor breakdown!** Maintain a flow of oxygen-free nitrogen through the system at very low-pressure during brazing. Nitrogen displaces the air and prevents the formation of copper oxides in the system. If allowed to form, the copper oxide material can later be swept through the system and block screens such as those protecting capillary tubes, thermal expansion valves, and accumulator oil return orifices.

**Contamination or moisture! Bearing failure!** Do not remove the connection plugs until the compressor is set into the unit. This minimises any entry of contaminants and moisture.

## 3.3.1 General brazing procedure




Figure 5: Brazing areas

Copeland scroll compressors have copper-plated steel suction and discharge stub tubes. These stub tubes are far more robust and less prone to leaks than copper tubes. Due to the different thermal properties of steel and copper, brazing must be carried out in an appropriate manner.

Refer to **Figure 5** and procedure below for the brazing of the stub tube connections of a scroll compressor.

- Flushing oxygen-free nitrogen through the piping during the brazing process is recommended for applications with A1 refrigerants and mandatory for applications with flammable A2L refrigerants.
- The copper-coated steel tubes on scroll compressors can be brazed in approximately the same manner as any copper tube.
- Recommended brazing materials: any silfos material is recommended, preferably with a minimum of 5 % silver. However, 0 % silver is acceptable.
- Be sure tube fitting inner diameter and tube outer diameter are clean prior to assembly.
- Using a double-tipped torch, apply heat in area 1.
- As the tube approaches brazing temperature, move the torch flame to area 2.
- Heat area 2 until braze temperature is attained, moving the torch up and down and rotating around the tube as necessary to heat the tube evenly. Add braze material to the joint while moving the torch around the joint to flow braze material around the circumference.
- After the braze material flows around the joint, move the torch to heat area 3. This will draw the braze material down into the joint. The time spent heating area 3 should be minimal.
- As with any brazed joint, overheating may be detrimental to the final result.

**NOTE:** Since the discharge stub contains a check valve, care must be taken not to overheat it to prevent brazing material from flowing into it.

## 3.3.2 Brazing procedure for YBD\*K1E compressors in parallel applications



### WARNING

**Air/flammable refrigerant mixture! Creation of a potentially flammable atmosphere! Fire hazard!** Remove all refrigerant before opening the system. When working on a refrigerant-filled system, make sure to follow the safety and working instructions given in **Chapter 6 "Maintenance & repair"**.

Only compressor models officially approved by Emerson in the qualified configuration may be used for parallel applications. For YBD\*K1E compressors in parallel applications with passive oil management, additional precautions shall be taken before brazing the oil and gas equalization ports. The sequence shall be as follows:

First, install the compressors on the base frame and tilt the assembly so that oil will not be lost when opening the cap. The gas and oil equalization line assembly should be ready for brazing at this point. For new compressors, release the protective gas charge: the rubber plug from the discharge port of the compressor has to be removed first, then the rubber plug from the oil port.

Most probably the oil port will be coated with some oil. It is mandatory to clean out the oil before brazing. If the inner surface is contaminated with oil the brazing material will not adhere to the surface and the joint will fail, generating leakage. The oil should be carefully wiped out with industrial absorption paper. Industrial solvents on a clean cloth can be used too but only with great care. Note that emery cloth will not remove the oil.

It is possible that the oil cannot be completely cleaned out. In this case additional measures should be taken. For instance, if a connection is coated with flux then the residual oil will be removed when brazing thanks to the applied heat.

If an active oil level control is to be used, eg, Alco Controls OM\* TraxOil, please refer to the product documentation when brazing the connection adaptor.

## 3.4 Pressure safety controls

### 3.4.1 High-pressure protection

Applicable regulations and standards, for example EN 378-2, shall be followed to apply appropriate control and ensure that the pressure never exceeds the maximum limit.

High-pressure protection is required to stop the compressor operating outside the allowable pressure limits. The high-pressure control must be installed correctly, which means that no service valve is allowed between the compressor and the pressure protection.

The high-pressure cut-out setting shall be determined according to the applicable standard, the type of system, the refrigerant and the maximum allowable pressure PS.

### 3.4.2 Low-pressure protection

#### 3.4.2.1 Applications with A1 refrigerants



#### CAUTION

**Operation outside the application envelope! Compressor breakdown!** A low-pressure protection shall be fitted in the suction line to stop the compressor when it operates outside the envelope limits.

Applicable regulations and standards shall be followed to apply appropriate control and ensure that the pressure is always above the required minimum limit.

Low-pressure protection is required to stop the compressor operating outside the allowable envelope limits. The low-pressure control must be installed correctly into the suction line, which means that no service valve is allowed between the compressor and the pressure protection.

The minimum cut-out setting shall be determined according to the refrigerant and the allowed operation envelope – see Select software at [www.climate.emerson.com/en-gb](http://www.climate.emerson.com/en-gb).

#### 3.4.2.2 Applications with A2L refrigerants



#### WARNING

**Operation below ambient pressure! Fire hazard!** During operation below ambient pressure, a flammable mixture can form inside the system. Make sure that air does not enter the system.



#### CAUTION

**Operation outside the application envelope! Compressor breakdown!** A low-pressure protection shall be fitted in the suction line to stop the compressor when it operates outside the envelope limits.

Make sure that the pressure never falls below atmospheric pressure. If it does, immediately de-energize the power supply of the compressor and check the cause of the low pressure before restarting the compressor.

Emerson requires that YBD\*K1E compressors be fitted with a low-pressure control, with no service valve between the low-pressure side and the pressure control.

For hermetically sealed systems, in case the approved application envelope is below atmospheric pressure, the following rules shall be observed:

- valid only for hermetically sealed systems – see safety standards for definition;
- the minimum absolute pressure is 0.5 bar;
- a discharge temperature control is mandatory to stop the compressor when exceeding the maximum discharge temperature – see **section 3.6 "Discharge gas temperature protection"**.

## 3.5 Crankcase heater



#### WARNING

**Ignition source in a potentially flammable atmosphere! Fire hazard!** The crankcase heater is not an ignition source during normal operation in A2L systems but could become one when not installed properly according to installation instructions. Ensure correct electrical and mechanical installation.



## CAUTION


**Overheating and burnout! Compressor damage!** Never apply power to the crankcase heater in free air, before the crankcase heater is installed on the compressor or when it is not in complete contact with the compressor shell.



## IMPORTANT

**Oil dilution! Bearing malfunction!** Turn the crankcase heater on 12 hours before starting the compressor.

A crankcase heater is used to prevent refrigerant from migrating into the shell during standstill periods. The installation of a crankcase heater is required when the system charge exceeds the charge limits indicated in **Table 9**. This requirement is independent from system type and configuration.

Compressor model	Refrigerant charge limit (kg)	Crankcase heater	
		Position	Height in mm
YBD17K1E & YBD24K1E	3.6		10 - 40
YBD31K1E & YBD36K1E	4.5		

**Table 9: Refrigerant charge limits & crankcase heater position**

The initial start-up in the field is a very critical moment for any compressor because all load-bearing surfaces are new and require a short break-in period to carry high loads under adverse conditions. **The crankcase heater must be turned on a minimum of 12 hours prior to starting the compressor.** This will prevent oil dilution and bearing stress on initial start-up. **The crankcase heater must remain energized during compressor off cycles.**

**NOTE:** Please refer to the Spare Parts list available at [www.climate.emerson.com/en-gb/tools-resources](http://www.climate.emerson.com/en-gb/tools-resources) to select the correct crankcase heater model.

**Caution:** Crankcase heaters must be properly grounded!

For installation, the manufacturer/installer shall follow the recommendations mentioned below.

### Assembly instructions

- Choose the appropriate model according to compressor size and required wattage.
- Check the compressor application guidelines for crankcase heater connection and operation.
- Position the crankcase heater between the lower cover and the lower bearing weld projection (**Fig. 6**).
- Fit the heater horizontally around the crankcase, ensuring that it is in close contact with the compressor housing along the entire length.
- Avoid having the heating portion of the heater in contact with any weld projection (**Fig. 7 & 8**).
- Avoid having the assembly heater inclined (**Fig. 9**).
- Close the lock and tighten the screw, torque: 2-3 Nm.
- The excess clamp bracket may be trimmed. Sharp edges must not come into contact with wires.
- The presence of the heater shall be made evident by the posting of caution signs or markings at appropriate locations.



**Figure 6**



**Figure 7**



**Figure 8**



**Figure 9**

## Electrical connection

- Connect the crankcase heater according to the compressor application guidelines.
- The crankcase heater must be connected only to its rated voltage.
- The metal braid of the heater must be connected to a suitable earthing terminal.
- Check the resistance according to the technical data.
- Perform an insulation test before start-up.
- Electrical security and safety measures are to be provided on site.

## 3.6 Discharge gas temperature protection



### CAUTION

**Inadequate lubrication! Scroll set damage!** All YBD\*K1E compressors must be equipped with a discharge gas temperature protection.

A good system control shall prevent the system from operating outside the published operating envelope and acceptable superheat range, whatever the climatic conditions and the capacity demand. However, under some extreme operating conditions such as loss of charge or improper control operation, the internal discharge gas temperature reached can cause compressor damage. In order to ensure positive compressor protection, discharge gas temperature protection is required for any application with Copeland brand compressors.

The maximum discharge gas temperature is 130 °C for YBD\*K1E compressors.

Discharge gas temperature protection is the "fall-back" for failure of the system control. It is essential that proper control of both the evaporating and condensing pressures and the superheat is maintained and has the ability to cope with all likely conditions and high loads. Reliance on protectors will cause inadequate system performance and short cycling.

**NOTE:** The maximum discharge gas temperatures indicated in this chapter are valid for safe operation within the approved application envelope. The discharge line thermostat has the function of a compressor protection device; it is not designed to control the operating envelope. For compressor envelope control, an additional control device or regulation must be used.

### 3.6.1 Excessive discharge gas temperatures

A few of the possible consequences of excessive discharge gas temperatures are listed below:

- Since the oil circulates in the system with the refrigerant, it is subjected to high discharge gas temperatures. If the discharge gas temperature becomes too high, the so-called "cooking" effect will occur (heating of oil under exclusion of air). Carbon deposits can form at points of high temperature, for example on the valves, oil channels, oil filters, etc. The oil lubricity will be reduced and a progressive wear process will occur which will prematurely damage the compressor.
- The stability of the refrigerant can also be affected, particularly if traces of contaminant are present.

The problems described above frequently occur simultaneously, particularly since the chemical reaction speed approximately doubles with every 10 °C temperature rise. This directly leads to chemical reactions of the oil with the refrigerant and the compounds extracted from sealants and insulation material. As a consequence, contaminants of various types, among them acids, will form inside the system.

### 3.6.2 Discharge line thermostat

YBD\*K1E compressors have no internal discharge gas temperature protection. Therefore, an external discharge line thermostat must be installed.



Figure 10: Discharge line thermostat with clamp






## Technical data of the discharge line thermostat

Voltage		120-240 V AC
Maximum amperage		5 A / 240 V
Operating temperatures	Open	134 °C (± 4 K)
	Close	106 °C (± 8 K)
Wire insulation maximum temperature		150 °C
Clips for tube		Ø 12.7 mm (0.5")

**Table 10: Discharge line thermostat – Technical data**

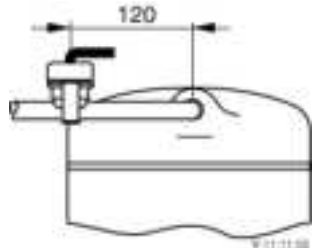To ensure proper functioning and to avoid false readings, the discharge line thermostat must be installed and insulated according to the procedure and recommendations hereunder.

## Assembly of the discharge line thermostat

<ul style="list-style-type: none"> <li>Install the discharge line thermostat on the discharge tube 120 mm from top cap.</li> </ul>	
<ul style="list-style-type: none"> <li>Snap the retainer clip over the tube and onto the thermostat.</li> <li>The thermostat should be placed on the discharge tube so that its body is in upward position on a horizontal tube installation.</li> <li>Ensure that the thermostat is not tilted.</li> </ul>	
<ul style="list-style-type: none"> <li>The wire must not be in contact with the top cap of the compressor or the discharge tube. Care should be taken to route wires so that they do not come into contact with sharp objects.</li> </ul>	
<ul style="list-style-type: none"> <li>To avoid any impact on tripping temperature by the ambient, the discharge line thermostat must be insulated.</li> <li>Wrap thermal insulation around the pipe left and right of the thermostat and secure it with plastic straps.</li> </ul>	
<ul style="list-style-type: none"> <li>Wrap a second layer of insulation around the first one and around the thermostat and secure it with plastic straps.</li> </ul>	

## 3.7 Discharge temperature sensor NTC

As an alternative to the discharge temperature thermostat, a discharge temperature sensor (NTC thermistor) can be used. Similar installation and insulation techniques should be used as described above in **section 3.6.2 "Discharge line thermostat"**.

**NOTE:** For compressor accessories selection, please refer to the Emerson Spare Parts Software, available at [www.climate.emerson.com/en-gb/tools-resources](http://www.climate.emerson.com/en-gb/tools-resources).

## 3.8 Internal pressure relief valve

There is an internal pressure relief valve on YBD\*K1E compressors. It opens at a differential pressure of 28 bar ± 3 bar between high- and low-pressure sides. A high-pressure protection must be provided by the system manufacturer/installer for each system and according to EN 378-2, clause 6.2.6.2. The IPR valve is a safety device, not an HP switch. It is not designed for repeated operation and there is no guarantee that it will reset correctly if it does have repeated operation.

## 3.9 Discharge check valve

There is no discharge check valve at the discharge port of YBD\*K1E digital compressors since the high-side pressure is needed to support the operation of the unloader mechanism.

Emerson recommends adding a suitable gas-tight external check valve in the discharge line of the YBD\*K1E digital scroll compressors for all parallel applications, to avoid any refrigerant gas flow through the digital scroll during standstill.


**NOTE:** Emerson recommends using an additional external gastight check valve for all YBD\*K1E compressors and operations where a leak-free seal of the compressor to the discharge side is required, for example for pump-down.

## 3.10 Digital solenoid valves



### WARNING

**Ignition source in a potentially flammable atmosphere! Fire hazard!** The solenoid valve and the electrical coil are not an ignition source during normal operation with flammable refrigerants but could become one when not installed properly according to installation instructions. Ensure correct electrical and mechanical installation. Never operate the solenoid coil when not positioned on the solenoid valve. Secure the installation with a screw.



### IMPORTANT

The external solenoid valve is a critical component for proper operation of these compressors. Only the Emerson-approved solenoid valve supplied as a requested accessory may be used.

Due to the high life-cycle requirements in a hot gas environment, a special valve has been developed. A screen is provided in the digital solenoid valve to prevent debris from disrupting valve operation.

To achieve reliability requirements, only Emerson-approved solenoid valves may be used for this application. All compressor warranties are null and void if the Emerson-approved valve is not used.

### 3.10.1 External solenoid valves for the design concept with internal lifting piston

YBD\*K1E digital scroll compressors use a lift piston mechanism to separate the scrolls during the unloaded state.

The solenoid valve is positioned outside the compressor in a piping configuration between the compressor top cap and the suction line.

External solenoid valves with 24 V AC and 230 V AC coils, also in combination with a tubing kit, are available as compressor accessories. For selection, see Emerson spare parts software available at [www.climate.emerson.com/en-gb/tools-resources](http://www.climate.emerson.com/en-gb/tools-resources).

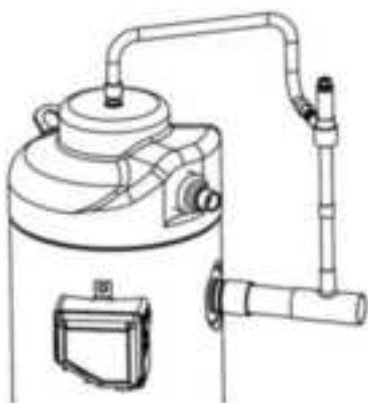


Figure 11: Position of the external solenoid valve

Care must be taken during the brazing process that no solid parts can enter the control piston compartment or the solenoid valve tubing. To prevent solid parts from entering the control valve seat, the solenoid valve kit contains a filter screen. The solenoid valve has to be fitted in such a way that the sleeve with the stem inside – which supports the solenoid coil – is fixed and aligned in the upright position.

**NOTE:** In case of compressor exchange, Emerson recommends replacing the high-cycle digital solenoid valve and coil at the same time. If the digital solenoid valve is defective, it is always good practise to exchange both the solenoid valve and the coil.

### 3.10.2 External solenoid valve installation – General recommendations

- The solenoid must be mounted vertically, within  $\pm 15^\circ$  of vertical. Horizontal mounting is not permitted.
- The valve operation is directional. See **Figure 12** below for inlet and outlet locations.
- Do not restrict the line size coming from or leaving the solenoid. Use 3/8" soft drawn copper.
- Mount the solenoid valve to the suction line. The tube from the solenoid to the suction should be as short as possible, in any case less than 76 mm (3 inches).
- From the top cap to the solenoid a series of bends and/or shock loops are required to dampen vibrations and resonance frequencies the assemblies might see during operation and start-up. Solenoid tubing mounting kits including solenoid valves are available from Emerson.
- The valve body contains a small filter mesh, to avoid large particles entering the inside (see **Figure 13**), which could lead to a defect and blockage. The filter is part of the valve delivery and already crimped inside; it cannot be changed. This is different from previous valve body versions, where the filter was delivered loose to the valve body and could be exchanged.
- The recommended tightening torque for the screw to fix the coil on the solenoid valve is 2 Nm.

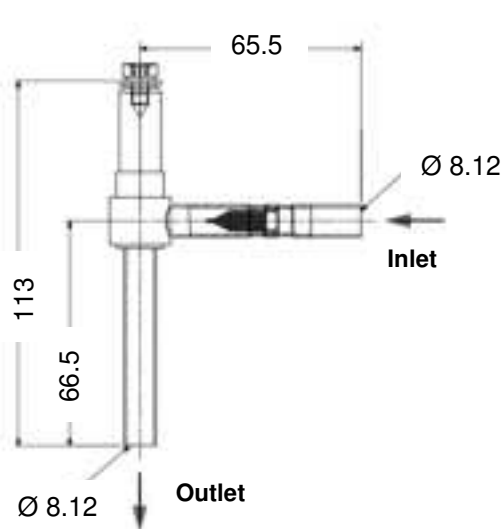


Figure 12: Control valve without coil

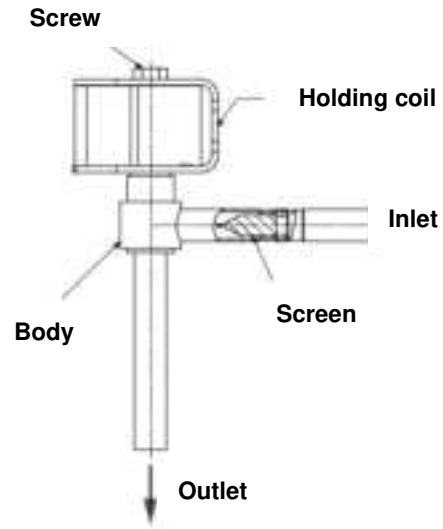


Figure 13: Control valve with coil

### 3.10.3 External solenoid valve installation – Tubing recommendations



#### IMPORTANT

This tube has been tested and qualified at 50 and 60 Hz operation for running stresses and resonance in a single compressor lab environment. However, in some compressor applications such as racks and transport applications, the OEM is strongly advised to re-confirm the acceptability of the tube when the compressor is subject to additional vibration inputs.


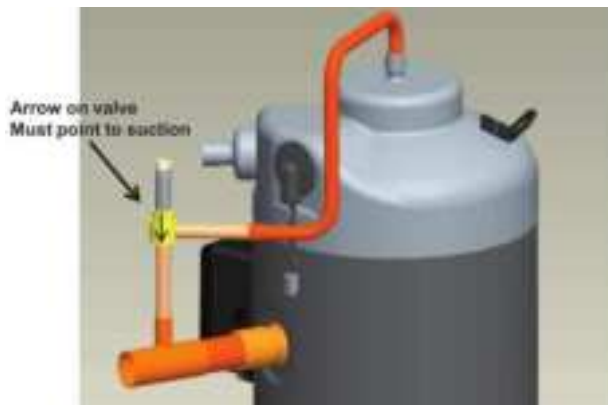


Figure 14: Recommended piping

The dimensions for a typical tube going from the top of the compressor are shown in **Figure 15**.

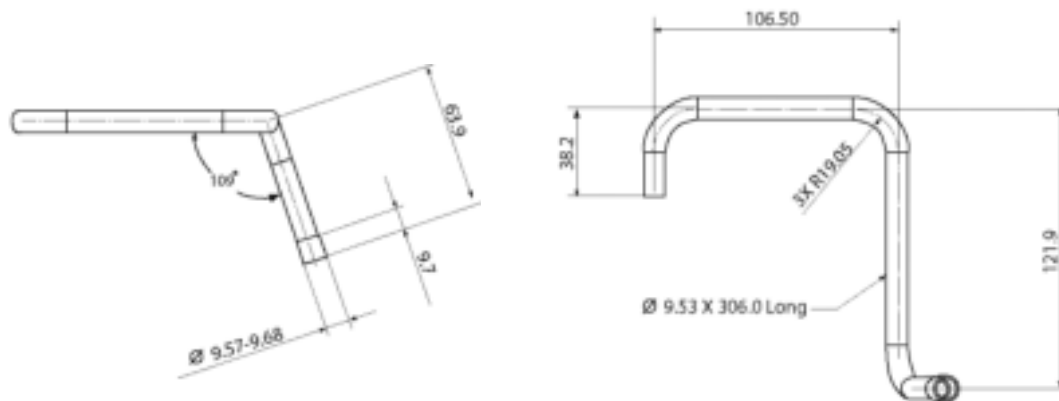

**Figure 15: Control valve pipe connection for compressor without sound shell**

Emerson has developed digital solenoid tubing kits for compressors with brazing stub tubes and 24 V or 230 V coils. The kits are optimized for fitting with or without sound shell and are valid for all compressor sizes using an external visible solenoid valve.

### 3.11 Filter screens



#### CAUTION

**Screen blocking! Compressor breakdown!** Use screens with at least 0.6 mm openings.

The use of filter screens finer than 30 x 30 mesh (0.6 mm openings) anywhere in the system should be avoided with these compressors. Field experience has shown that finer mesh screens used to protect thermal expansion valves, capillary tubes or accumulators can become temporarily or permanently plugged with normal system debris and block the flow of either oil or refrigerant to the compressor. Such blockage can result in compressor failure.

### 3.12 Mufflers

Gas flow through scroll compressors is continuous with relatively low pulsation. External mufflers may not be required on Copeland scroll compressors. Due to system variability, individual tests should be conducted by the system manufacturer to verify acceptable levels of sound and vibration.

If adequate attenuation is not achieved, use a muffler with a larger cross-sectional area to inlet area ratio. A ratio of 20:1 to 30:1 is recommended. A hollow shell muffler will work quite well. Locate the muffler at minimum 15 cm to maximum 45 cm from the compressor for the most effective operation. The farther the muffler is placed from the compressor within these ranges, the more effective. Choose a muffler with a length of 10 to 15 cm.

### 3.13 Sound shell

For the selection of sound reduction material in A2L applications, attention shall be paid to the electrostatic charge of the material, which could be a potential ignition source.

The standard Emerson sound shell material is not an ignition source for A2L refrigerants (R454C, R455A, R454A and R1234yf).

**NOTE:** Please see Emerson spare parts software at [www.climate.emerson.com/en-gb/tools-resources](http://www.climate.emerson.com/en-gb/tools-resources) to check the available sound shell kits according to compressor model.

### 3.14 Insulation material

Insulation material is commonly used in a system to insulate the suction line, suction accumulator, expansion valve bulb or discharge line thermostat. When choosing the insulation material for A2L applications, particular attention shall be paid to its non-electrostatic properties, as it could be a potential ignition source.


## 3.15 Sound and vibration



### WARNING

**Vibrations! Creation of a flammable atmosphere!** Carefully check the system for vibrations in applications with A2L refrigerants.

Vibrations during compressor operation can cause cracks which could lead to refrigerant leakage. This situation must be avoided by the system manufacturer/installer. To this end, the pipework must be carefully designed when connecting a scroll compressor to a system.

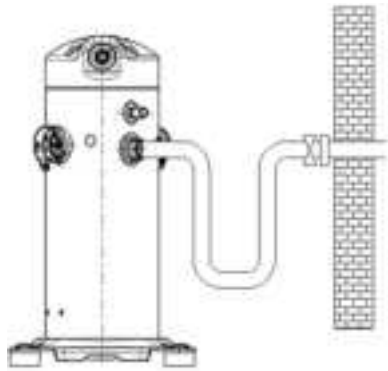

A scroll compressor makes both a rocking and twisting motion and enough flexibility must be provided in the pipework to allow starting, stopping and steady state running of the compressor without transmitting excessive stress into any line attached to the unit. In a split system, the most important goal is to ensure minimal vibration in all directions to avoid transmitting vibrations to the structure to which the lines are fastened.

Under some conditions, the Copeland scroll has a normal starting rotational motion that can transmit a transient noise along the lines. This may be particularly pronounced in compressors using a three-phase motor due to their

Figure 16: Example of suction tube design

inherently higher starting torque. This phenomenon, like the one described previously, can easily be avoided by using standard line isolation techniques.

The sound level of a system is the result of design, quality and application. Scroll compressors sound power levels generally increase with the compressor model capacity and the condition pressure ratio.

## 3.16 Compressor oil return, oil balancing and floodback tests



### CAUTION

**Inadequate lubrication! Bearing and moving parts destruction!** Ensure adequate oil return from the system into the compressor at any time. No liquid refrigerant return to the compressor. Liquid refrigerant dilutes the oil, could wash the oil off the bearings and moving parts and could lead to overheating and compressor failure.

The system piping must be carefully designed to ensure sufficient refrigerant gas velocity, so that oil returns to the compressor at all times and conditions. Individual piping diameter calculation depends on the refrigerant properties, pressure level, mass flow, and density.

Once a new system design is set and assembled, a functional test is required. The functional test includes a qualification for the general system oil return and a refrigerant flood-back test. Systems with multiple compressor applications (two, three, or more) require additional oil balancing qualification between the parallel compressors.


A sample compressor equipped with an external oil sight tube can be ordered from Emerson for lab testing.

Records of the evaporating temperature and the bottom shell temperature shall be taken with a high sampling rate during the entire oil return or oil balance testing and under all tested conditions. The liquid level in the sight tube has to be observed and recorded too. Testing conditions shall include defrost and varying loads. If the system is reversible, the tests should be conducted in both operation modes.

System engineers should review the system design and operation to identify the critical conditions and to check oil return, oil balancing and liquid flood-back. Typically, the following situations should be considered:

- **In single compressor systems:** to check oil return, testing conditions shall be at minimum mass flow and minimum density of suction gas in continuous and frequent start-stop-cycling.
- **In multiple compressor systems:** to check oil return and oil balancing in the tandem or trio, testing conditions shall be at the corner points of the system application envelope in continuous and frequent start-stop-cycling.

- **In all systems:** to test liquid flood-back, all possible transient operation conditions in the system should be checked, eg, compressor frequent start/stop, compressor start after long off time with migration, defrost, switching between the operation modes in reversible systems, load changes, fans or pumps cycling at low load and more. To evaluate the risk of liquid flood-back, please refer to the oil dilution chart in **Figure 17**. Liquid level and superheat at compressor inlet have to be checked.

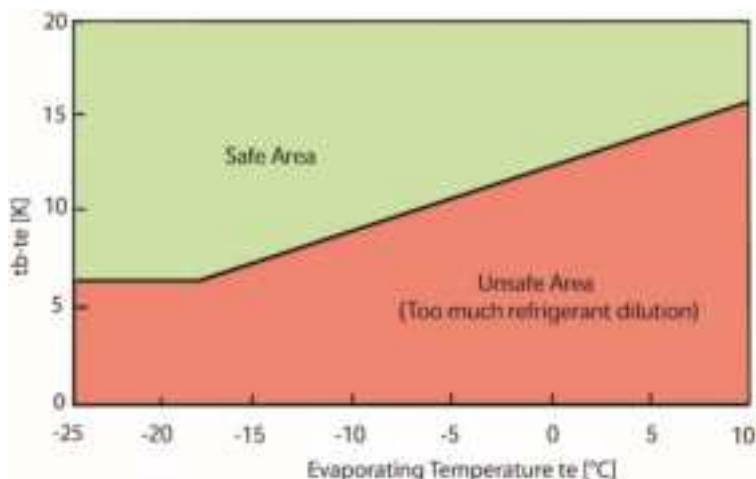

**Figure 17: Oil dilution chart ( $t_b$  = bottom shell temperature;  $t_e$  = evaporating temperature) and position of oil temperature sensor**

The bottom shell temperature together with the evaporating temperature gives an indication whether liquid refrigerant is returning or diluted in the compressor oil sump. The compressor sump temperature must remain in the (green) safe area, as shown in the oil dilution chart in **Figure 17**. In case of operation in the (red) unsafe area, adjustments are required in order to modify the system design, refrigerant charge or superheat setting of the expansion device(s). The bottom shell temperature should be measured accurately. The thermo-probe must be well insulated and positioned on the opposite side of the sight glass or at an angle of 90° clockwise from the suction inlet with view on the top.

### 3.17 Suction line accumulator

Due to Copeland scroll's inherent ability to handle liquid refrigerant, for example in flooded start and defrost cycle operation, an accumulator is not required in most systems.

To determine if a suction line accumulator is required, the system designer must check this with an appropriate test scenario. See **section 3.16 "Compressor oil return, oil balancing and floodback tests"**.

If an accumulator is used, the oil-return orifice should be from 1 to 1.4 mm in diameter for all YBD\*K1E models depending on compressor size and compressor flood-back results. To protect this small orifice from plugging with system debris a large-area protective screen no finer than 30 x 30 mesh (0.6 mm openings) is required. Tests have shown that a small screen with a fine mesh can easily become plugged causing oil starvation to the compressor bearings. The size of the accumulator depends upon the operating range of the system and the amount of sub-cooling and subsequent head pressure allowed by the refrigerant control. For the correct selection and size of the suction line accumulator, refer to the manufacturer's specifications.

## 4 Electrical connection

### 4.1 General recommendations

The compressor terminal box has a wiring diagram on the inside of its cover. Before connecting the compressor, ensure the supply voltage, the phases and the frequency match the nameplate data.

For safety reasons, Emerson recommends that the electrical installation be executed in compliance with standard EN 60204-1 and/or other standards and regulations of application when dealing with A2L mildly flammable refrigerants such as R454C, R455A, R454A and R1234yf.

When installing YBD\*K1E compressors in a system, the following measures must be taken:

- To ensure the wires are properly terminated, the correct terminal and clamping tool for the selected wire size must be used.
- The ground wiring must conform to local regulations and codes of practice (only the provided parts must be used).
- The grounding screw must be torqued to 2.4 to 2.6 Nm.
- A cable strain-relief device must be added.
- Cable and wires must be protected against sharp edges.

### 4.2 Electrical installation



#### WARNING

**Conductor cables! Electrical shock!** Shut off power supply before undertaking any task on electrical equipment.



#### WARNING

**Ignition source in a potentially flammable atmosphere! Fire hazard!** In applications with A2L refrigerants, the electrical connection of the scroll compressors is not an ignition source during normal operation but could become one if not installed properly according to installation instructions. Ensure correct mechanical and electrical installation. System capacitors may remain charged for several minutes after shutdown. Before starting to work on the electrical installation make sure sparking is not possible. Continuously check if the ambient atmosphere is non-flammable when working on the electrical installation.

For recommended wiring diagrams, see **Figure 14** next page.

**NOTE:** A contactor K2 has to be used for the safety chain to comply with EN 60335 and EN 60204-1.

**NOTE:** It is mandatory to install a residual current device (RCD) in any electrical system associated with YBD\*K1E compressors and A2L flammable refrigerants such as R454C, R455A, R454A and R1234yf. The purpose of the RCD is to detect current leaks to the ground in case of electrical issues, for example with the terminal connection pins or electrical accessories.



Figure 18: Residual current device (RCD)

## Three-phase compressors (TF\*) with internal motor protection:

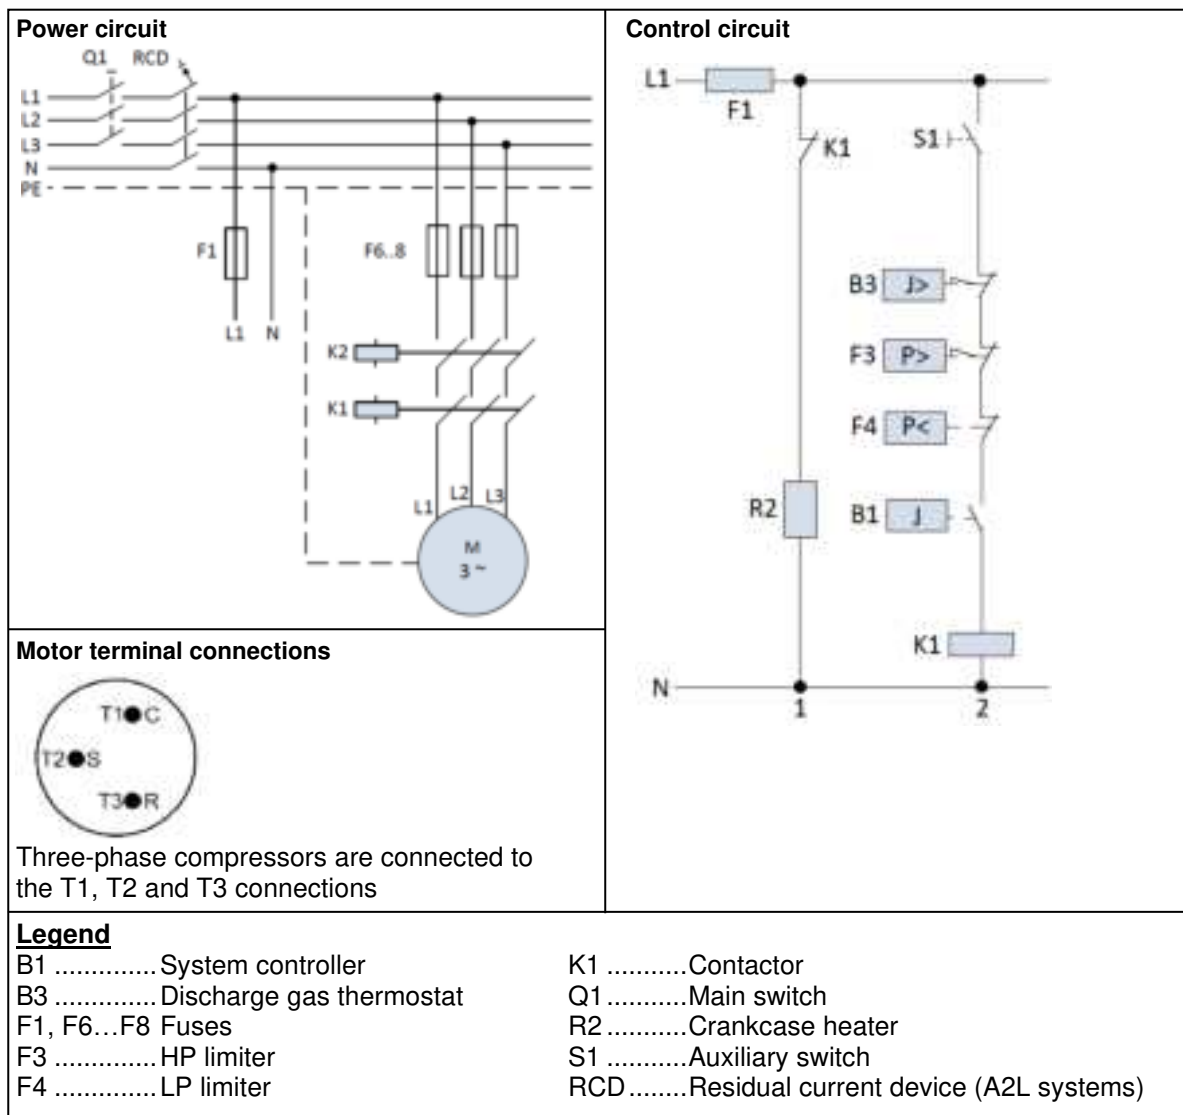


Figure 19

### 4.3 Terminal box



#### WARNING

#### Ignition source in a potentially flammable atmosphere! Fire hazard!

Particular attention must be paid in A2L refrigerant systems as any work on the energized terminals in the compressor terminal box could create an ignition. Do not touch the energized terminals with a tool or cable when the compressor is energized.

Compressors operating with flammable refrigerants shall use only the qualified terminal box supplied with the compressor.



#### CAUTION

**Mechanical stress or shock! Overheating! Terminal Fusite damage and leakage!** Mechanical stress and shocks to the Fusite must be avoided as they could damage the glass and/or ceramic. This might result in hermetic failure or loss of terminal performance. Precautions are required to prevent striking or bending of pins. Bent or damaged pins may result in loss of hermeticity and/or terminal performance.

Ensure correct connection of cables to the compressor terminal Fusite to avoid local overheating of Fusite pins which might lead to refrigerant leaks.

The terminal box is IP54 for all YBD\*K1E compressors. This terminal box variation cannot be applied in an ATEX environment.

Cable glands have an influence on the protection class of the terminal box. Emerson strongly recommends using appropriate cable glands according to EN 50262 in order to reach the rated protection class. Examples of correct electrical installations are shown in **Figure 20** below.



Figure 20: IP54 T-Box and correct electrical installation with cable gland

## 4.4 Motor insulation

The motor insulation material is class "B" (TFMN) within maximum allowable operating temperatures according to IEC 34-1 or DIN 57530.

## 4.5 Motor protection

Independently from the internal motor protection, fuses must be installed before the compressor. The selection of fuses has to be made according to EN 60269-1 or EN 60204-1 and compressor maximum operating current (MOC). Not installing fuses before the compressor or selecting inappropriate fuses may result in compressor failure.

Conventional inherent internal line break motor protection is provided for all YBD\*K1E compressor models.

## 4.6 High potential testing



### WARNING

**High potential testing in a flammable atmosphere! Fire hazard!** For A2L refrigerant systems, make sure the atmosphere is non-flammable before performing high potential testing. DO NOT perform any high potential test when the compressor is charged with flammable refrigerant.



### WARNING

**Conductor cables! Electrical shock!** Shut off power supply before high-potential testing.



### CAUTION

**Internal arcing! Motor destruction!** Do not perform high-voltage or insulation tests if the compressor housing is under vacuum.

Emerson subjects all scroll compressors to a high-voltage test after final assembly. Each motor phase winding is tested according to EN 60034-1 at a differential voltage of 1000 V plus twice the nominal voltage.

Since high-voltage tests lead to premature ageing of the winding insulation, further additional tests of that nature are not recommended. However, if it has to be done for any reason, it shall not be made with the compressor charged with refrigerant. Run the test with a lower voltage, as described above. Disconnect all electronic devices, eg, motor protection module, fan speed control, etc prior to testing.

Special attention should be paid when performing a high-potential test and reading the Megohm resistance on A2L compressors, as such tests can induce an electrical arc and cause a fire hazard.

For the same reason, compressors removed from a system with A2L refrigerant will need to have the oil drained and a nitrogen purge introduced to flush any remaining refrigerant from the compressor prior to high-potential testing and Megohm resistance reading.

## 5 Start-up & operation




### WARNING

**Diesel effect! System explosion!** The mixture of air and oil at high temperature can lead to an explosion. Avoid operating with air.



### WARNING

**Air/flammable refrigerant mixture! Creation of a flammable atmosphere!** Make sure the atmosphere is non-flammable before starting the system. Ensure that the system contains only refrigerant.



### IMPORTANT


**Oil dilution! Bearing malfunction!** It is important to ensure that new compressors are not subjected to liquid abuse. It is mandatory to have a crankcase heater installed if the refrigerant charge exceeds 1.54 kg for compressors YBD17K1E to YBD24K1E and 1.93 kg for compressors YBD31K1E & YBD36K1E. Turn the crankcase heater on 12 hours before starting the compressor.

### 5.1 Strength-pressure test



### WARNING

**High pressure! Personal injuries!** Consider personal safety requirements and refer to test pressures prior to test.



### IMPORTANT

**System contamination! Bearing malfunction!** Use only dry nitrogen for pressure testing. DO NOT USE other industrial gases.

#### 5.1.1 Compressor strength-pressure test

The compressor has been strength-pressure tested in the Emerson factory. Therefore, it is not necessary for the system manufacturer/installer to strength-pressure test the compressor again.

Scroll compressors are divided into two pressure zones. The compressor high-side and low-side maximum allowable pressures PS have to be respected at all times.

#### 5.1.2 System strength-pressure test

A strength-pressure test of individual sections of the entire system is permitted. Once the compressor is isolated, the rest of the system can be tested with the required pressure values.

The strength-pressure test can also be conducted with the compressor connected, but in that case the two pressure zones of the scroll compressor need to be respected:

- System high-pressure section:
  - Define the system high-side PS  $\leq$  compressor high-side PS.
  - Isolate the high- and low-pressure sections of the system by closing valves, solenoid valves, expansion valves or by other means.
  - Use the internal check valve of the compressor on the discharge side or add an external check valve. To protect the compressor internal check valve, observe a maximum pressure delta of  $\leq 40$  bar between the high-pressure side and the low-pressure side.
  - Activate the check valve with a fast pressure increase. Once the check valve is activated, the pressure increase can be slowed down.
  - At this stage the system test pressure of  $1.1 \times$  system high-side PS can be applied for a short time.
  - During the system test, make sure the pressure inside the compressor does not exceed the maximum PS value, which corresponds to the compressor low-pressure PS.
- System low-pressure section:
  - Define the system low-side PS  $\leq$  compressor low-side PS.
  - The system test pressure of  $1.1 \times$  system low-side PS can be applied for a short time.

## 5.2 Compressor tightness test



### WARNING

**High pressure! Personal injuries!** Consider personal safety requirements and refer to test pressures prior to test.



### IMPORTANT

**System contamination! Bearing malfunction!** Use only dry inert gases (for example nitrogen) for leak testing. DO NOT USE other industrial gases.

The compressor has been leak-pressure tested in the Emerson factory.

All compressors get a factory holding charge of dry air (about 1 to 2.5 bar, relative pressure). An intact holding charge serves as a proof of quality against penetrating moisture.

When removing plugs from the compressor, the plugs may pop out due to pressure and oil can spurt.

Any later modification to compressor connections can have an impact on the compressor tightness. Always leak-pressure test the compressor after opening or modifying the connections.

Never add refrigerant to the test gas (as leak indicator).

## 5.3 System evacuation

Before the installation is put into commission, it has to be evacuated with a vacuum pump. For A2L systems, the vacuum pump and all tools have to be approved for A2L refrigerant/air mixture. The installation should be evacuated down to an absolute pressure of 3 mbar. Proper evacuation reduces residual moisture to 50 ppm. During the initial procedure, suction and discharge shut-off valves on the compressor remain closed. The installation of adequately sized access valves at the furthest point from the compressor on the suction and liquid lines is advisable. The pressure must be measured using a vacuum pressure gauge on the access valves and not on the vacuum pump; this serves to avoid incorrect measurements resulting from the pressure gradient along the connecting lines to the pump.

Evacuating the system only on the suction side of a scroll compressor can occasionally result in a temporary no-start condition for the compressor. The reason for this is that the floating seal could axially seal with the scroll set, with the higher pressure on the floating seal. Consequently, until the pressures equalise, the floating seal and scroll set can be held tightly together.

The highest demands are placed on the leak-proof design of the installation and on the leak testing methods – please refer to EN 378.

## 5.4 Preliminary checks – Pre-starting



### WARNING

**Air/A2L refrigerant mixture in a potentially flammable or explosive atmosphere! Fire and explosion hazard!** Whenever starting up a system charged with A2L refrigerant, eg, after filling, repair, or maintenance, make sure not to start and operate accidentally in a flammable or explosive atmosphere.

Discuss details of the installation with the installer. If possible, obtain drawings, wiring diagrams, etc. It is ideal to use a check-list but always check the following:

- no explosive atmosphere or flammable gas in the ambient;
- suitable ventilation according to the room volume and to the refrigerant charge;
- visual check of the electrics, wiring, fuses etc;
- visual check of the plant for leaks, loose fittings such as TXV bulbs etc;
- compressor oil level;
- calibration of HP & LP switches and any pressure-actuated valves;
- check setting and operation of all safety features and protection devices;
- all valves in the correct running position;
- pressure and compound gauges fitted;
- correctly charged with refrigerant;
- compressor electrical isolator location & position.

## 5.5 Charging procedure



### WARNING

**Air/A2L refrigerant mixture in a potentially flammable or explosive atmosphere! Fire and explosion hazard!** Only use filling equipment designed and approved for use and operation with A2L refrigerants. Make sure all connections are tight to avoid leakage. Make sure to fill with pure A2L refrigerant.



### CAUTION

**Low suction pressure operation! Compressor damage!** Do not operate with a restricted suction. Do not operate with the low-pressure limiter bridged. Do not operate compressor at pressures that are not allowed by the operating envelope. Allowing the suction pressure to drop below the envelope limit for more than a few seconds may overheat scrolls and cause early drive bearing and moving parts damage.

Prior to charging or re-charging, the refrigerant system must be leak- and pressure-tested with appropriate purging gas.

Ensure that the system is grounded prior to charging with refrigerant.

The system shall be liquid-charged through the liquid-receiver shut-off valve or through a valve in the liquid line. The use of a filter drier in the charging line is highly recommended. Systems shall be liquid-charged on both the high and low sides simultaneously to ensure a positive refrigerant pressure is present in the compressor before it runs. The majority of the charge shall be placed in the high side of the system to prevent bearing washout during first-time start on the assembly line.

Extreme care shall be taken not to overfill the system with refrigerant.

**NOTE: For applications with A2L refrigerants, the system manufacturer/installer must respect the charge limitations according to valid standards, such as EN 378.**

## 5.6 Run-in time

Scroll compressors exhibit a slight decrease in input power during the initial running period. Published performance ratings are based on calorimeter testing which is carried out after run-in. Therefore, users should be aware that before the performance specified by EN 12900 is achieved the compressor needs to be run in. Recommended run-in times for YBD\*K1E compressors to attain the published performance are 16 hours at the standard conditions.

## 5.7 Initial start-up



### CAUTION

**High discharge pressure operation! Compressor damage!** Do not use compressor to test opening setpoint of high-pressure cut-out. Internal parts are susceptible to damage before they have had several hours of normal running in.

Liquid and high-pressure loads could be detrimental to new bearings. It is therefore important to ensure that new compressors are not subjected to liquid abuse and high-pressure run tests. It is not good practice to use the compressor to test the high-pressure switch function on the production line. Switch function can be tested with nitrogen prior to installation and wiring can be checked by disconnecting the high-pressure switch during the run test.

## 5.8 Rotation direction

Scroll compressors, like several other types of compressors, will only compress in one rotational direction. Three-phase compressors will rotate in either direction depending upon phasing of the power. Since there is a 50-50 chance of connecting power in such a way as to cause rotation in the reverse direction, **it is important to include notices and instructions in appropriate locations on the equipment to ensure proper rotation direction when the system is installed and operated.**

Observing that suction pressure drops and discharge pressure rises when the compressor is energized allows verification of proper rotation direction. There is no negative impact on durability

caused by operating three-phase Copeland scroll compressors in the reverse direction for a short period of time (under one hour) but oil may be lost. Oil loss can be prevented during reverse rotation if the tubing is routed at least 15 cm above the compressor. After several minutes of operation in reverse, the compressor protection system will trip due to high motor temperature. The operator will notice a lack of cooling. However, if allowed to repeatedly restart and run in reverse without correcting the situation, the compressor will be permanently damaged.

All three-phase scroll compressors are identically wired internally. Therefore, once the correct phasing is determined for a specific system or installation, connecting properly phased power leads to the identified compressor terminals will ensure proper rotation direction.

## 5.9 Pressure fluctuations

Digital scroll compressors are capable of capacity modulation from 10 to 100 %. A normally closed (de-energized) solenoid valve is a key component for achieving modulation. When the solenoid valve is energized, the two scroll elements move apart axially into the unloaded state. In the unloaded state, the compressor motor continues running, but there is no compression. Within scroll modulation the suction and the discharge pressure could fluctuate. During the unloaded state, the discharge pressure will decrease and the suction pressure will increase. This normal pressure fluctuation has no observable effect on the reliability of the compressor or system components. However, the installation and setting of pressure controls should take this into account.

## 5.10 Starting sound

During the very brief start-up, a clicking sound resulting from the initial contacting of the spirals is audible and is normal. Due to the design of the Copeland scroll compressors, the internal compression components always start unloaded even if system pressures are not balanced. In addition, since internal compressor pressures are always balanced at start-up, low voltage starting characteristics are excellent for Copeland scroll compressors.

## 5.11 Deep vacuum operation



### WARNING

**Operation below ambient pressure! Fire hazard!** In A2L refrigerant systems, a flammable mixture can form inside the system during operation below ambient pressure. Make sure that air does not enter the system and that the pressure never falls below atmospheric pressure.



### CAUTION

**Vacuum operation! Compressor damage!** Copeland scroll compressors should never be used to evacuate refrigeration or air-conditioning systems. Operating scroll compressors in deep vacuum could damage internal motor parts and lead to unacceptable high temperatures in the compressor housing.

## 5.12 Shell temperature

During normal operation, the discharge gas as well as the compressor top shell and discharge line can reach temperatures up to the maximum discharge gas temperature of 130 °C – see **section 3.6 "Discharge gas temperature protection"**.

In a failure mode, the discharge gas temperatures can even get higher. Care must be taken to ensure that wiring or other materials that could be damaged by these temperatures do not touch the shell.

## 5.13 Pumpdown cycle



### WARNING

**Operation below ambient pressure! Fire hazard!** In A2L refrigerant systems, a flammable mixture can form inside the system during operation below ambient pressure. Make sure that air does not enter the system and that the pressure never falls below atmospheric pressure.



### CAUTION

**Vacuum operation! Compressor damage!** Compressor operation outside the operating envelope is not allowed.

A pumpdown cycle to control refrigerant migration may have to be used for several reasons, for example when the compressor is located outdoors without any housing so that cold air blowing over the compressor makes the crankcase heater ineffective.

**If a pumpdown cycle is used, a separate external check valve must be added.** The scroll discharge check valve is designed to stop extended reverse rotation and prevent high-pressure gas from leaking rapidly into the low side after shut-off. The check valve might in some cases leak more than reciprocating compressor discharge reeds, normally used with pumpdown, causing the scroll compressor to recycle more frequently. Repeated short cycling of this nature can result in a low oil situation and consequent damage to the compressor. The hysteresis of the low-pressure control differential has to be reviewed since a relatively large volume of gas will re-expand from the high side of the compressor into the low side after shutdown.

**For pressure control setting, never set the low-pressure limiter to shut off outside of the operating envelope. To prevent the compressor from running into problems during such faults as loss of charge or partial blockage, the low-pressure limiter shall not be set lower than the minimum suction pressure allowed by the operating envelope.**

## 5.14 Minimum run time

Emerson recommends a maximum of 10 starts per hour. There is no minimum off time because scroll compressors start unloaded, even if the system has unbalanced pressures. The most critical consideration is the minimum run time required to return oil to the compressor after start-up. To establish the minimum run time, a sample compressor equipped with an external oil sight glass is available from Emerson. The minimum on time becomes the time required for oil lost during compressor start-up to return to the compressor sump and to restore a minimal oil level that will ensure oil pick-up through the crankshaft. Cycling the compressor for a shorter period than this, for instance to maintain very tight temperature control, will result in progressive loss of oil and damage to the compressor.

## 5.15 Sound characteristics

Copeland scroll digital compressors incorporate comparable sound characteristics as the fixed-speed scroll models though the sound behaviour during capacity modulation is different. The unloaded sound power is approximately 2 dB(A) higher than the loaded sound power. For noise-sensible applications, an observation of the individual system sound characteristics, particularly during the transition between loading and unloading state, is recommended. Depending on the individual system properties, suitable noise reduction measures, for example the use of sound-absorbing material, should be considered.

## 5.16 Shut-off sound

Scroll compressors incorporate a device that minimizes reverse rotation. The residual momentary reversal of the scrolls at shut off could cause a clicking sound. It is entirely normal and has no effect on compressor durability.

## 5.17 Supply frequency and voltage

There is no general release of Copeland digital scroll compressors for use with variable speed drives. Only frequencies from 50 to 60 Hz are acceptable.

The last letter of the motor code indicates which frequency and voltage must be applied - see **section 2.2 "Nomenclature"**.

50 Hz	Code
380-420 V / 3 ph	M

**Table 11: Electrical code for motors**

## 5.18 Oil level

Some systems may contain higher than normal refrigerant charges. Systems with large coils, low ambient condenser flooding, or systems with multiple heat exchangers are among some system configurations that may require additional lubricant.

There is no oil sight glass on YBD\*K1E compressors.

During the system development phase, adequate oil return from the system to the compressor should be evaluated and qualified. For this purpose, a sample compressor for lab testing, equipped with an external oil sight tube, is available from Emerson. See also information in **section 3.16 "Compressor oil return, oil balancing and floodback tests"**.

If an oil regulator is used the oil level should be set within the top half of the oil regulator sight glass.

BOM XCG version contains a stub tube connection 7/8" (22.2 mm) for paralleling on the compressor housing at oil level height.

## 5.19 Controlling the digital scroll

The capacity of the digital scroll compressor is controlled via a PWM (pulse-width modulation) signal to the compressor solenoid valve. The longer the solenoid valve is not energized within the cycle time, the higher the capacity delivered to the system. During the period when the solenoid valve is energized, the refrigerant mass flow through the compressor is interrupted while the motor continues to run at full speed.

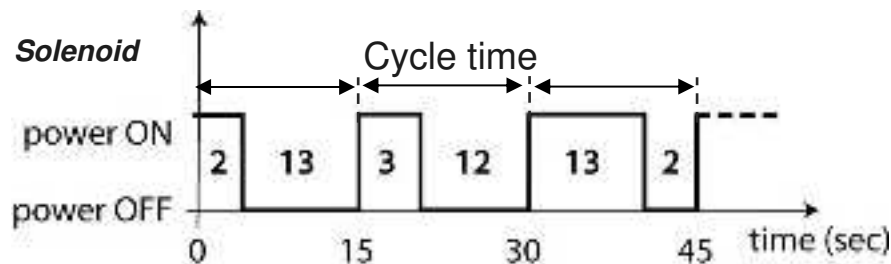


Figure 21: Pulse-width modulation principle for digital scroll

The cycle time must not exceed 30 seconds, while the minimum is 10 seconds. The cycle time can be adjusted within this range. Optimum performance is achieved around 12-second cycle times, depending on system design.

When developing suitable control concepts and algorithms for digital scroll, special attention must be paid to compressor protection and minimum requirements for compressor cooling.

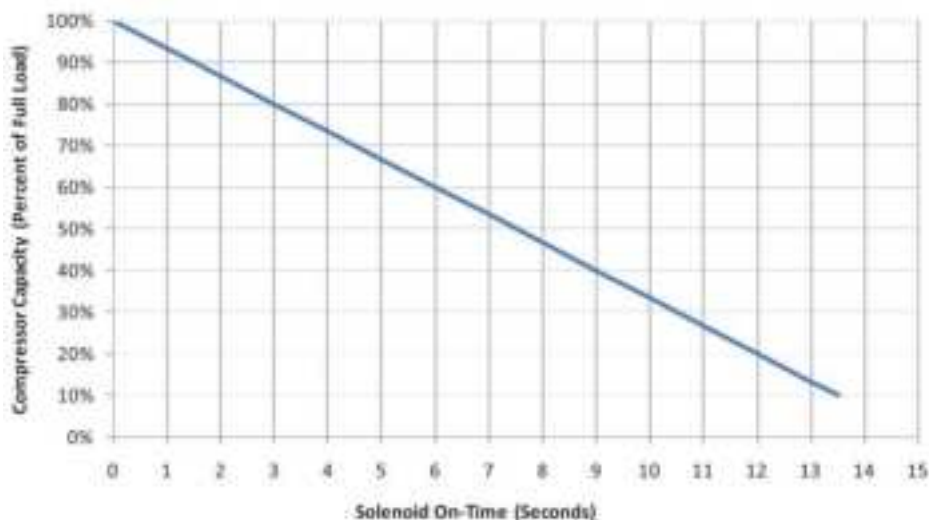


Figure 22: Solenoid opening time depending on the load in a 15-second cycle time

**NOTE:** Emerson offers various controller and driver solutions, such as complete condensing unit controllers, for capacity regulation and control of the digital scroll solenoid valve. Please contact your Emerson Sales or Application Engineering representative for further details.

## 5.20 Power factor and power input

During the loaded state of the digital scroll, when the compressor operates at full capacity, the power factor of the motor is equivalent to standard fixed-speed scrolls. However, during part-load, when the scrolls are unloaded, the power factor is lower.

The power input of a digital scroll varies between loading and unloading processes. During unloading, the power input is approximately 10 % of the maximum power input. Even though the

capacity regulation is a dynamic process, the average power consumption can be calculated with the following method:

$$P_{av} = (P_{op} \times \text{Proportion of loaded time}) + (0.1 \times P_{max} \times \text{Proportion of unloaded time})$$

where:

$P_{av}$  = Digital scroll average power consumption

$P_{op}$  = Compressor power input operation point

$P_{max}$  = Maximum power input in the table of the application envelope

Example: Cooling capacity requirement = 40 %,  $P_{op}$  = 3.23 kW,  $P_{max}$  = 5.33 kW

$$P_{av} = (3.23 \text{ kW} \times 0.4) + (0.1 \times 5.33 \times 0.6) = 1.61 \text{ kW}$$

**NOTE:** An estimate of the digital scroll energy consumption only by measuring the amps gives wrong results. For a realistic estimate, a correct power measurement must be made.

## 6 Maintenance & repair



### WARNING

**Conductor cables! Electrical shock!** Follow the lockout/tag out procedure and the national regulations before undertaking any maintenance or service work on the system.

Use compressor with grounded system only. Screwed electrical connections must be used in all applications. Refer to original equipment wiring diagrams. Electrical connections must be made by qualified electrical personnel.



### WARNING

**Explosive flame! Fire hazard!** Oil-refrigerant mixtures are highly flammable. Remove all refrigerant before opening the system. Avoid working with an unshielded flame in a refrigerant-charged system.



### WARNING

**Ignition source in a potentially flammable or explosive atmosphere! Fire and explosion hazard!** When opening an A2L refrigerant system, the atmosphere could be explosive. All electrical components that are a source of ignition must always be switched off during service and maintenance. Ensure that the surface temperatures of the components never exceed the limits set by the applicable safety standard, eg, EN 378-2.

**Air/flammable refrigerant mixture! Fire and explosion hazard!** Remove all refrigerant before opening the system. Make sure to remove refrigerant completely from all components such as heat exchangers, refrigerant accumulators, etc. Flush the system and the components with inert gas before undertaking any work and before brazing.



### WARNING

**Open flame in a potentially flammable or explosive atmosphere! Fire and explosion hazard!** The area shall be checked with an appropriate refrigerant detector prior to and during work on an A2L refrigerant system, to ensure the technician is aware of a potentially toxic or flammable atmosphere. Ensure that the leak detection equipment being used is suitable for use with all applicable refrigerants.

Personnel performing work on a refrigeration system that involves exposing the pipework shall avoid using any ignition source in a way that could lead to a fire or explosion hazard. All sources of ignition shall be kept sufficiently far from the site of installation, repair, removal or disposal during the entire time when refrigerant could be released into the surrounding space.

Open flames and smoking are strictly forbidden at all times.

During service make sure that:

- the area is well ventilated;
- the materials and equipment used are suitable for use under flammable conditions;
- only non-sparking tools are used;
- antistatic gloves and clothes are used;
- build-up of electrostatic charges is avoided;
- no unshielded or naked flame is used;

If parts of the refrigeration system are charged with flammable refrigerant, make sure that all the valves are tightly closed and that the open pipes after the valves are free of refrigerant and oil.

A risk analysis to evaluate all possible risks shall be carried out by the service technician before any repair work on the A2L systems.

## 6.1 Qualification of workers

Personnel working on the maintenance, repair and decommissioning of an A2L refrigerant system shall be adequately trained. Any work procedure affecting safety shall only be executed by qualified and trained personnel in compliance with national or other equivalent certification systems.

Examples of such work procedures are:

- breaking into the refrigerating circuit;
- opening sealed components;
- opening ventilated enclosures...

## 6.2 Preparation and work procedure

For all A2L refrigerant systems, a work procedure shall be provided in the preparation stage. All maintenance personnel and others working at the site shall be instructed on the nature of the work being carried out.

If any work is to be conducted on the refrigeration systems or any associated parts, appropriate fire extinguishing equipment shall be provided. Dry powder or CO<sub>2</sub> fire extinguishers are considered appropriate. Confirm that appropriate fire extinguishing equipment is available near the work area.

Prior to starting to work on systems containing flammable refrigerants, safety checks are necessary to ensure that the risk of ignition is minimized.

Work shall be undertaken under a controlled procedure so as to minimize the risk of a flammable gas or vapour being present while the work is being performed.

Avoid working on systems filled with flammable refrigerant in a confined space.

## 6.3 Disassembling system components

When disassembling system components please follow the main steps described hereunder:

1. For A1 refrigerant systems (R404A, R407A, R407F, R448A, R449A, R407C, R513A, R134a and R450A), recover refrigerant and evacuate system using a recovery unit and vacuum pump. All the refrigerant shall be recovered to avoid significant release.
2. For A2L refrigerant systems (R454C, R455A, R454A and R1234yf), recover refrigerant and evacuate system using an A2L-dedicated recovery unit and vacuum pump. Ensure that the outlet of the vacuum pump is not close to any potential ignition source and that ventilation is available.
3. Flush system with inert gas (dry nitrogen). Compressed air or oxygen shall not be used for purging refrigerant systems.
4. Disassemble components with a cutting tool.
5. Drain, recover and dispose of compressor oil as appropriate.




Figure 23: Tube connecting areas

### To disconnect:

- Using a pipe cutting tool, cut off the suction and discharge lines in such a manner that the new compressor can easily be re-connected into the system.
- Heat joint areas 2 and 3 slowly and uniformly until the braze material softens and the tube end can be pulled out from the fitting.

### To reconnect:

- Recommended brazing material: Silfos with minimum 5 % silver or silver braze used on other compressors.
- Due to the different thermal properties of steel and copper, brazing procedures may have to be changed from those commonly used.

**NOTE:** Since the discharge stub contains a check valve, care must be taken not to overheat it to prevent brazing material from flowing into it.

## 6.4 Exchanging the refrigerant



### WARNING

**Air/A2L mixture in a potentially flammable or explosive atmosphere! Fire and explosion hazard!** For applications with A2L refrigerants, air/A2L mixture in the refrigeration system must be avoided in any case. Make sure that the system is filled with pure A2L refrigerant. In the event that the refrigerant needs replacing, the charge should be recovered using A2L-qualified refrigerant recovery unit and recycling bottles.



### CAUTION

**Low suction pressure operation! Compressor damage!** Do not operate with a restricted suction. Do not operate with the low-pressure limiter bridged. Do not operate compressor at pressures that are not allowed by the operating envelope. Allowing the suction pressure to drop below the envelope limit for more than a few seconds may overheat scrolls and cause early drive bearing and moving parts damage.

For qualified refrigerants and oil, see **section 2.4.1 "Qualified refrigerants and oils"**.

It is not necessary to replace the refrigerant unless contamination, for example due to an error such as topping up the system with a non-condensable gas or incorrect refrigerant, is suspected. To verify correct refrigerant composition, a sample can be taken for chemical analysis. A check can be made during shutdown by comparing the refrigerant temperature and pressure using precision measurements at a location in the system where liquid and vapour phases are present and when the temperatures have stabilised.

## 6.5 Replacing a compressor



### CAUTION

**Inadequate lubrication! Bearing destruction!** For systems with a refrigerant accumulator, exchange the accumulator after replacing a compressor with a burned-out motor. The accumulator oil return orifice or screen may be plugged with debris or may become plugged. This will result in starvation of oil to the new compressor and a second failure.

Remove refrigerant and oil completely from the replaced compressor.

### 6.5.1 Compressor replacement

In the case of A2L refrigerant compressor replacement, the oil has to be drained out of the compressor and the compressor should be flushed with dry nitrogen. **DO NOT** close the stubs with plugs.

In case of a motor burnout, the majority of contaminated oil will be removed with the compressor. The rest of the oil is cleaned through the use of suction and liquid line filter driers. A 100 % activated alumina suction line filter drier is recommended but must be removed after 72 hours. When a single compressor or tandem is exchanged in the field, it is possible that a major portion of the oil may still be in the system. While this may not affect the reliability of the replacement compressor, the extra oil will add to rotor drag and increase power usage.

### 6.5.2 Start-up of a new or replacement compressor

Rapid charging only on the suction side of a scroll-equipped system can occasionally result in a temporary no-start condition for the compressor. The reason for this is that, if the flanks of the scrolls happen to be in a sealed position, rapid pressurisation of the low side without opposing high-side pressure can cause the scrolls to seal axially. As a result, until the pressures eventually equalise, the scrolls can be held tightly together preventing rotation. The best way to avoid this situation is to charge on both the high and low sides simultaneously at a rate which does not result in axial loading of the scrolls.

A minimum suction pressure specified in the published operating envelope must be maintained during charging. Allowing the suction pressure to drop below that value may overheat the scrolls and cause early drive bearing and moving parts damage. Never install a system in the field and leave it unattended when it has no charge, a holding charge, or with the service valves closed without securely electrically locking out the system. This will prevent unauthorised personnel from accidentally operating the system and potentially ruining the compressor by operating with no refrigerant. **Do not start the compressor while the system is in a deep vacuum.** Internal arcing

may occur when a scroll compressor is started in a vacuum causing burnout of the internal lead connections.

### 6.5.3 Compressor return procedure for A2L systems

If a compressor has to be returned to the manufacturer for analysis, the refrigerant and the oil have to be removed completely. For the shipping process, all compressor connections must remain open and warning stickers for flammable refrigerant must be placed on the shipping box.

- During the entire working procedure continuously check if the ambient atmosphere is flammable. If a flammable atmosphere is detected, ensure proper ventilation of the working space and immediately cut-off the power supply.
- Resume working after the atmosphere is no longer dangerous.
- Recover the refrigerant from the system using a suitable recovery unit. During this action, the compressor crankcase heater could be energized – immediately de-energize in case a flammable atmosphere is detected.
- Recover to 3 mbar absolute pressure or lower. For best results and to recover also the refrigerant solved in the oil, run the recovery unit two or three times as necessary.
- Flush the whole system with oxygen-free dry nitrogen.
- Open the system with a cutting tool and flush the entire system with dry nitrogen.
- Disassemble the compressor with a cutting tool. Drain and recover compressor oil properly. Flush the compressor with dry nitrogen again for a few minutes.
- The compressor should be returned free of oil and with connections open – do not close connections with plugs.
- Collect and secure the oil properly. Provide information about the quantity of oil drained from the compressor and its colour. Ideally, send a good picture.
- Dispose of the oil according to local rules and regulations.
- Use a proper cardboard box package when preparing the compressor for shipment. Place



warning icons on each side and on the top of the box. Mention the following message on the box: **"Warning! Flammable A2L refrigerant compressor for analysis"**.

- The compressor must be kept in the upright position – mark the box accordingly.
- If more than one compressor has to be returned, each compressor must be packed individually.

**NOTE: Check with the transport company that all the requirements that apply to such shipments are complied with.**

### 6.6 Lubrication and oil removal



#### WARNING

**Air/A2L flammable refrigerant mixture! Flammable and explosive atmosphere! Fire and explosion hazard!** When removing oil from an A2L refrigerant system, use suitable recovery unit and recycling bottles also for oil disposal as A2L refrigerant may still be solved in the oil.




#### CAUTION

**Chemical reaction! Compressor destruction!** Do not mix up ester oils with mineral oil and/or alkyl benzene when used with chlorine-free (HFC) refrigerants.

The compressor is supplied with an initial oil charge. The standard oil for use with YBD\*K1E compressors is a polyolester (POE) lubricant Emkarate RL32 3MAF. See nameplate for original oil charge shown in litres. A field recharge is from 0.05 to 0.1 litre less.

One disadvantage of POE is that it is far more hygroscopic than mineral oil – see **Figure 24**. Only brief exposure to ambient air is needed for POE to absorb sufficient moisture to make it unacceptable for use in a refrigeration system. Since POE holds moisture more readily than mineral oil it is more difficult to remove it through the use of vacuum. The compressors supplied by Emerson contain oil with low moisture content, which may rise during the system assembling process. Therefore, it is recommended that a properly sized filter-drier be installed in all POE systems. This will maintain the moisture level in the oil to less than 50 ppm. If oil is charged into a system, it is recommended to use POE with a moisture content no higher than 50 ppm.

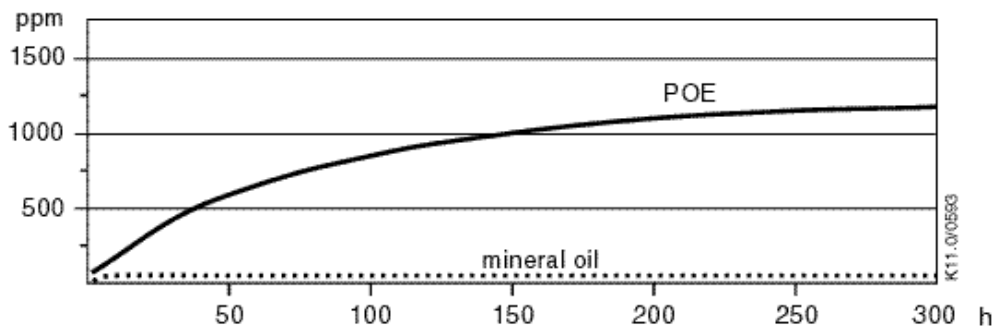

**Figure 24: Absorption of moisture in ester oil in comparison to mineral oil in ppm by weight at 25 °C and 50 % relative humidity (h= hours)**

If the moisture content of the oil in a refrigeration system reaches unacceptably high levels, corrosion and copper plating may occur. The system should be evacuated down to 0.3 mbar or lower. If there is uncertainty as to the moisture content in the system, an oil sample should be taken and tested for moisture. Sight glass/moisture indicators currently available can be used with the HFC refrigerants and lubricants; however, the moisture indicator will just show the moisture content of the refrigerant. The actual moisture level of POE would be higher than the sight glass indicates. This is due to the high hygroscopicity of the POE oil. To determine the actual moisture content of the lubricant, samples have to be taken from the system and analysed.

## 6.7 Oil additives

Although Emerson cannot comment on any specific product, from our own testing and past experience, we do not recommend the use of any additives to reduce compressor bearing losses or for any other purpose. Furthermore, the long-term chemical stability of any additive in the presence of refrigerant, low and high temperatures, and materials commonly found in refrigeration systems is complex and difficult to evaluate without rigorously controlled chemical laboratory testing. The use of additives without adequate testing may result in malfunction or premature failure of components in the system and, in specific cases, in voiding the warranty on the component.

## 7 Dismantling & disposal

---



### Removing oil and refrigerant:

- Do not disperse in the environment.
- Use the correct equipment and method of removal.
- Dispose of oil and refrigerant according to national legislation and regulations.

Dispose of compressor according to national legislation and regulations.

## 8 References

---

Please visit [www.climate.emerson.com/en-gb](http://www.climate.emerson.com/en-gb) for free download of Application Guidelines and Technical Information.

### **Performance and technical data:**

The latest version of Copeland Select software with performance data and technical data is available from the webpage [www.climate.emerson.com/en-gb](http://www.climate.emerson.com/en-gb).

### **Spare parts and accessories:**

Visit [www.climate.emerson.com/en-gb/tools-resources](http://www.climate.emerson.com/en-gb/tools-resources) for an online version of the Emerson spare parts and accessories software.

## Appendix1: Tightening torques

---

Connection	Torque (Nm)
M10	45 - 55
Mounting bolts M8 (grommet for single operation)	13 ± 1
Mounting bolts M8 (hard mounting parts for parallel operation)	27 ± 1
Crankcase heater	2 - 3
Digital coil screw	2
Terminal block screw	2.8
Ground screw	2.3

## DISCLAIMER

---

1. The contents of this publication are presented for informational purposes only and are not to be construed as warranties or guarantees, express or implied, regarding the products or services described herein or their use or applicability.
2. Emerson Climate Technologies GmbH and/or its affiliates (collectively "Emerson"), as applicable, reserve the right to modify the design or specifications of such products at any time without notice.
3. Emerson does not assume responsibility for the selection, use or maintenance of any product. Responsibility for proper selection, use and maintenance of any Emerson product remains solely with the purchaser or end user.
4. Emerson does not assume responsibility for possible typographic errors contained in this publication.

#### BENELUX

Josephinastraat 19  
NL-6462 EL Kerkrade  
Tel: +31 45 535 06 73  
Fax: +31 45 535 06 71  
benelux.sales@emerson.com

#### GERMANY, AUSTRIA & SWITZERLAND

Theo-Mack Str. 3  
DE-63477 Maintal  
Tel: +49 6109 605 90  
Fax: +49 6109 60 59 40  
ECTGermany.sales@emerson.com

#### FRANCE, GREECE & MAGHREB

8, Allée du Moulin Berger  
FR-69134 Ecully Cédex, Technoparc - CS 90220  
Tel: +33 4 78 66 85 70  
Fax: +33 4 78 66 85 71  
mediterranean.sales@emerson.com

#### ITALY

Via Ramazzotti, 26  
IT-21047 Saronno (VA)  
Tel: +39 02 96 17 81  
Fax: +39 02 96 17 88 88  
italy.sales@emerson.com

#### SPAIN & PORTUGAL

C/ Pujades, 51-55 Box 53  
ES-08005 Barcelona  
Tel: +34 93 412 37 52  
iberica.sales@emerson.com

#### CZECH REPUBLIC

Hajkova 22  
CZ - 133 00 Prague  
Tel: +420 733 161 651  
Fax: +420 271 035 655  
Pavel.Sudek@emerson.com

#### ROMANIA & BULGARIA

Parcul Industrial Tetarom 2  
Emerson Nr. 4 400641 Cluj-Napoca  
Tel: +40 374 13 23 50  
Fax: +40 374 13 28 11  
ro-bg.sales@emerson.com

#### ASIA PACIFIC

Suite 2503-8, 25/F., Exchange Tower  
33 Wang Chiu Road, Kowloon Bay  
Kowloon, Hong Kong  
Tel: +852 2866 3108  
Fax: +852 2520 6227

#### UK & IRELAND

Unit 17, Theale Lakes Business Park  
Reading, Berkshire RG7 4GB  
Tel: +44 1189 83 80 00  
Fax: +44 1189 83 80 01  
uk.sales@emerson.com

#### SWEDEN, DENMARK, NORWAY & FINLAND

Pascalstr. 65  
DE-52076 Aachen  
Tel: +49 2408 929 0  
Fax: +49 2408 929 525  
nordic.sales@emerson.com

#### EASTERN EUROPE & TURKEY

Pascalstr. 65  
DE-52076 Aachen  
Tel: +49 2408 929 0  
Fax: +49 2408 929 525  
easterneurope.sales@emerson.com

#### POLAND

Szturmowa 2  
PL-02678 Warsaw  
Tel: +48 22 458 92 05  
Fax: +48 22 458 92 55  
poland.sales@emerson.com

#### RUSSIA & CIS

Dubininskaya 53, bld. 5, 4<sup>th</sup> floor  
RU-115054, Moscow  
Tel: +7 499 403 64 03  
ECT.Holod@emerson.com

#### BALKAN

Selska cesta 93  
HR-10 000 Zagreb  
Tel: +385 1 560 38 75  
Fax: +385 1 560 38 79

#### MIDDLE EAST & AFRICA

PO Box 26382  
Jebel Ali Free Zone - South, Dubai - UAE  
Tel: +971 4 811 81 00  
Fax: +971 4 886 54 65  
mea.sales@emerson.com

For more details, see [www.climate.emerson.com/en-gb](http://www.climate.emerson.com/en-gb)  
Connect with us: [facebook.com/EmersonCommercialResidentialSolutions](https://facebook.com/EmersonCommercialResidentialSolutions)



Emerson Commercial & Residential Solutions  
Emerson Climate Technologies GmbH - Pascalstrasse 65 - 52076 Aachen, Germany  
Tel. +49 (0) 2408 929 0 - Fax: +49 (0) 2408 929 570 - Internet: [www.climate.emerson.com/en-gb](http://www.climate.emerson.com/en-gb)

The Emerson logo is a trademark and service mark of Emerson Electric Co. Emerson Climate Technologies Inc. is a subsidiary of Emerson Electric Co.  
Copeland is a registered trademark and Copeland Scroll is a trademark of Emerson Climate Technologies Inc.. All other trademarks are property of their respective owners.  
Emerson Climate Technologies GmbH shall not be liable for errors in the stated capacities, dimensions, etc., as well as typographic errors. Products, specifications, designs and technical data contained in this document are subject to modification by us without prior notice. Illustrations are not binding.

© 2019 Emerson Climate Technologies, Inc.

**EMERSON. CONSIDER IT SOLVED.™**