

013R9067

013R9067

Montering/Fitting/Montage/Montage/Montaje/Installazione/Montering/Montage/Asennus/Montaža

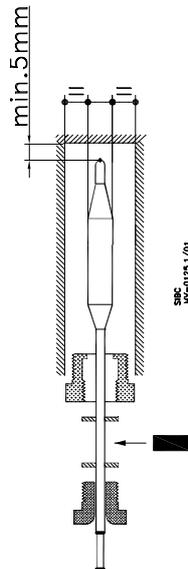
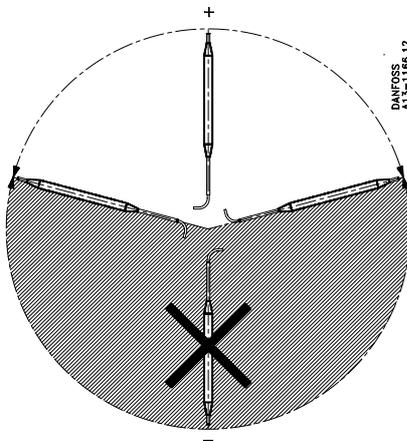
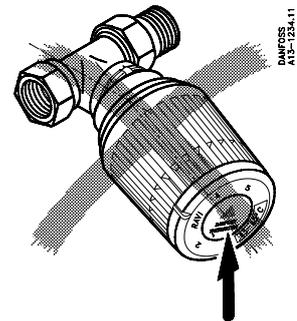
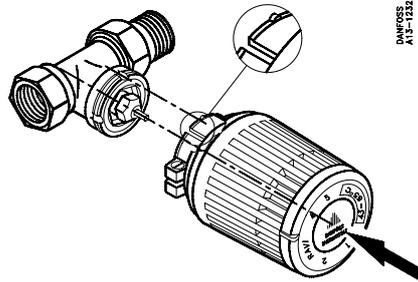

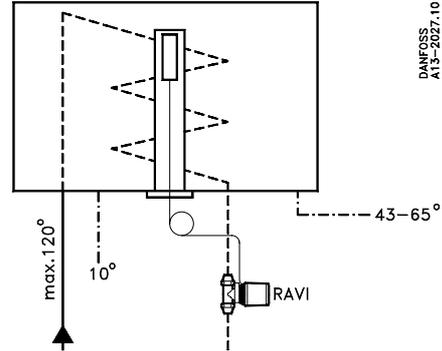
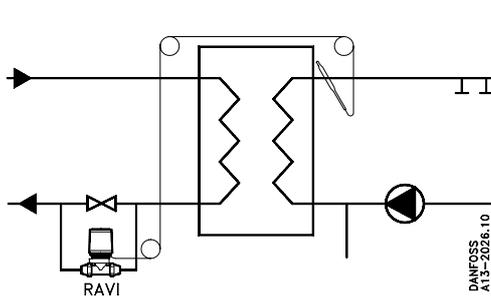


Fig. A

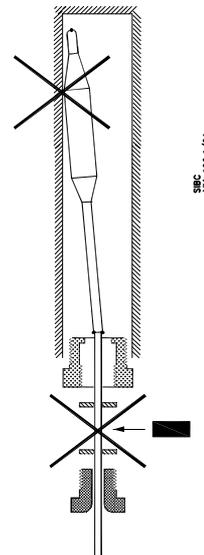


Fig. B

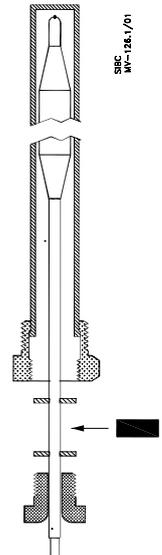


Fig. C



- Install sensor part as shown on **figure A** in order to assure at least 5 mm distance between sensor housing made of brass and other metal parts.
- Consider adequate distance over the whole side length and end part of the sensor (**fig. A**).
- Assure that sensor is properly fixed; larger dimension of capillary tube has to be fixed with stuffing box (2 washers with rubber gasket in between, tightened with screw), (**fig. A**).

- By installation shown on **figure A** you also assure the optimal arm (distance between stuffing box where sensor is fixed and end part of the sensors inserted in the media in heat exchanger or boiler) which will reduce the risk of vibrations which could cause a metal contact.
- Please avoid installation which is shown on **figure B** (thinner diameter of capillary tube fits in stuffing box, longer arm etc.).



- If you can not avoid or at least you assume the possibility of metal contact, than you have to use a protecting pocket (sleeve) made of stainless steel (**figure C**).

By using this standard type of accessory you will be faced with longer response time of RAV's performance due to slower heat transition.


Indstilling/Setting/Einstellung/Réglage/Reglaje/Regolazione/Inställning/Instelling/Asettelu/Nastawianie

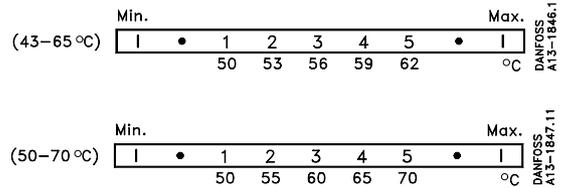


Begrænsning eller blokering af indstillingsområde/Limiting or locking of setting range/
 Begrenzung oder Verriegelung des Einstellsbereich/Limitation ou blocage de réglage/
 Limitación o bloqueo del campo de ajuste/Limitazione o bloccaggio del campo di taratura/
 Begrænsning eller låsning av verkningsområde/Begrenzing of blokkering van het instelbereik/
 Asetusalueen rajoittaminen tai lukitseminen/Ograniczenie lub blokada nastawy

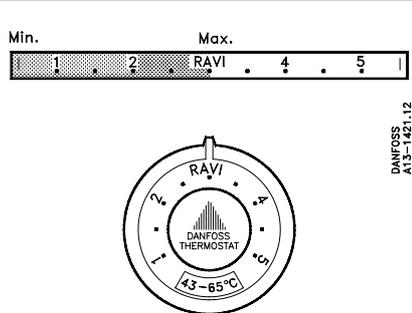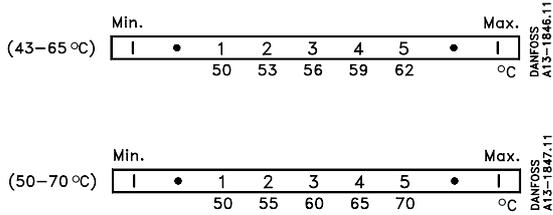




1a

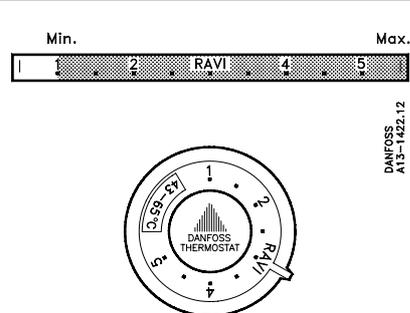


2a

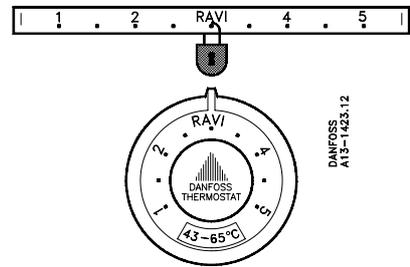


3a

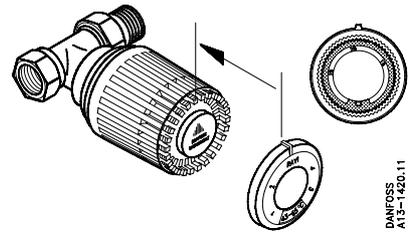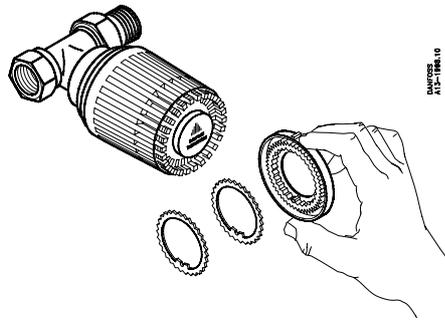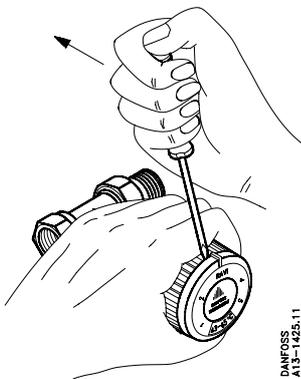


1b/2b/3b




1c




2c




3c



1d



2d



3d