

MYPIN

TA Series of Temperature Controller Instruction Manual

Thank you for selecting our controller!

Before operating this instrument, please carefully read this manual and fully understand its contents. If any problems, please contact our sales or distributors whom you buy from. This manual is subject to change without prior notice.

Warning

Please do not connect your controller to main power until all of your wiring is complete and checked. Otherwise electrical shock, fire or malfunction may result. Do not wire when the power is on. Do not turn on the power supply when cleaning this instrument. Do not disassemble, repair or modify the instrument. This may cause electrical shock, fire or malfunction. Use this instrument in the scope of its specifications. Otherwise fire or malfunction may result. The internal relay's service life is greatly dependent on the current and voltage switched by its contacts. Over-stressing the contacts with too much current or switching voltage above the contact rating will greatly shorten the life of the relay.

Caution


This instrument is not rated for outdoor use and should be used in a climate controlled environment. Installing in an environment heavy laden with dust or containing corrosive gasses will cause your controller to fail. Do not install near water spray, oil spray, or in an environment where water can condense inside the unit. Avoid running power leads in parallel with high voltage or heavy current carrying conductors that may induce high voltages into the unit. If you must run incoming power near high voltage or heavy current carrying conductors, we suggest that you run the power inside metal conduit that is grounded on one end only. If installing in an electrically noisy environment, we suggest that you protect the unit with a current suppressor or noise filter.

Applications

TA series of temperature controller is available for many TC or RTD input, adopt some advanced technology such multi digital filter circuit, autotune PID, fuzzy PID that make it is very precise, stable, strong anti-interference and simple operation. The instrument is widely applied to

automation systems of mechanism, chemical industrial, chinaware, light industrial, metallurgy and petroleum chemical industrial. It is also applied to the production line of foodstuff, packing, printing, dry machine, metal heat process equipment to control the temperature.

Panel

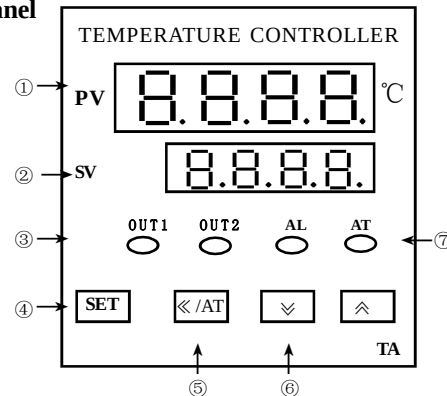

①. PV / parameter symbols

②. SV / parameters set value

③. Indication lamps

OUT1: Heating/Main control output lamp

On: Output Off: No output

OUT2: Alarm2 output lamp

On: Output Off: No output

AT: On: Autotune Off: Non-autotune

AL: Alarm 1 lamp On: Alarm Off: No Alarm

④. Set key Parameter Setting/Changing


⑤. Shift/Autotune key

Press this key to shift digit of parameter value setting. Or hold this key for more than 3s can enter/quit autotune estate. When enter autotune estate, AT lamp on. When quit autotune estate, AT lamp off.

⑥. Up key

⑦. Down key


Models

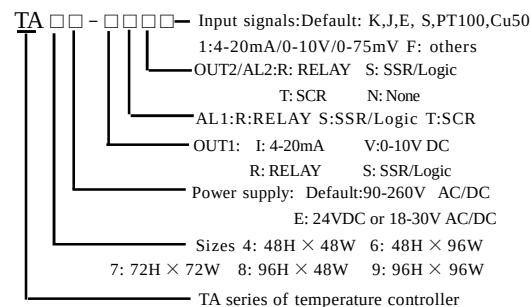

Specifications

Power supply	90-260V AC/DC 50/60Hz		
Consumption	≤ 5VA		
Display range	-199~1800℃		
Accuracy	0.3%F. S ± 2digit		
Sampling cycle	≤ 300ms		
Main output	RELAY: normal open AC 250V/5A DC 30V/5A COS ϕ=1 SSR/LOGIC: 24V DC ± 2V/ 20mA		
Alarm	RELAY: normal open AC 250V/5A DC 30V/5A COS ϕ=1 SSR/LOGIC: 24V DC ± 2V/ 30mA		
Input	T/C	K	0~1200℃ (negative temp customized)
		J	0~1200℃ (negative temp customized)
		T	-150~400℃ (customized only)
		S	0~1600℃
		E	0~1000℃
	Rt	Pt100	-199~600℃
		Cu50	-50~150℃
	Others	Please mention when ordering	
Withstand voltage strength	1500V Rms (Between power terminal and the housing)		
Insulation resistance	Min 50M Ω (500VDC) (Between power terminal and the housing)		
Environment temperature	0~50℃		
Storage temperature	-10~60℃		
Environment humidity	35~85%RH		
Weight	≤ 350g		

Mounting and Sizes

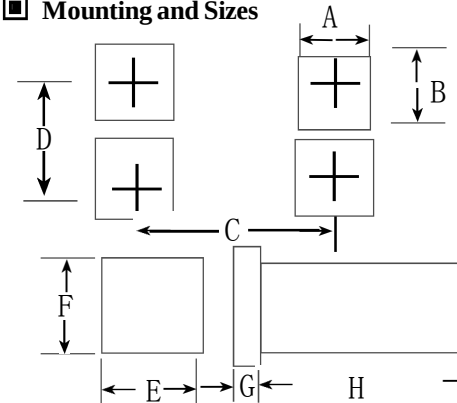

Sizes Model	A	B	C	D	E	F	G	H
TA4	44.5±0.5	45±0.5	65	65	48	48	8	80
TA6	43.5±0.5	91±0.5	65	115	48	96	12	80
TA7	67.5±0.5	67.5±0.5	115	115	72	72	12	80
TA8	91±0.5	43.5±0.5	65	115	96	48	12	80
TA9	91±0.5	91±0.5	95	95	96	96	12	80

Parameter Setting


Setting steps

A: Select the parameter you want to modify


B: Press the <</AT key to select the digit you want to modify

C: Press ^ key and v key to modify the numerals

D: Press SET key to confirm

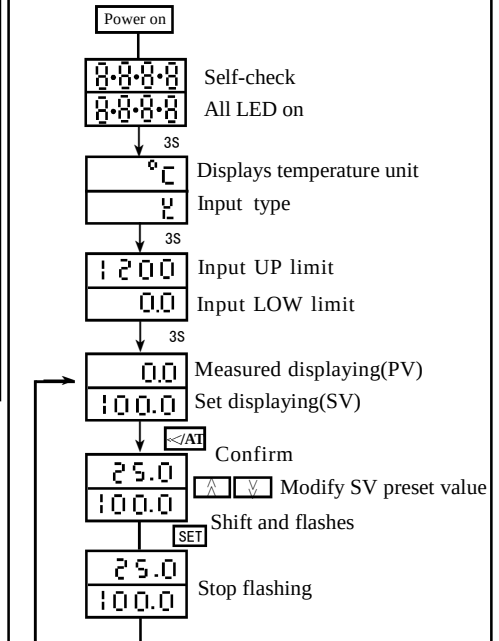

In Non-autotune estate, press and hold ^ / v key for more than 5 seconds can enter/quit the under menu: (Normally the program will refresh the value of the parameters by itself, the user no need make modifications.)

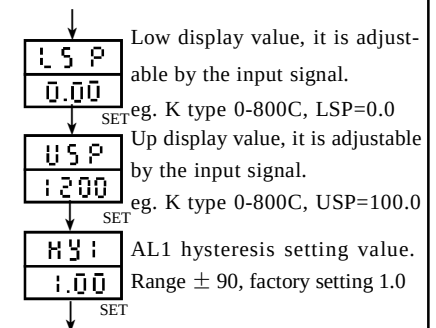

H Y 2 AL2 hysteresis setting value.
 1.00 Range ± 90 , factory setting 1.0
 SET
 d P Decimal point setting:
 0 0: INT display 1: One decimal point
 SET
 S c P Password setting.
 A 1 S Factory setting 015


HOLD SET > 3S
 A L 1 AL1 set range: -1999-9999
 9000 AL1 mode:
 SET
 A 0 1 0: Deviation HI alarm 1: Deviation LO alarm
 2: PV HI alarm 3: PV LO alarm
 4: SV-PV > AL1 alarm 5: SV-PV < AL1 alarm
 6: TC broken alarm, 7: The first Low won't alarm
 The factory setting is 2
 SET
 A L 2 AL2 set range: -1999-9999.
 900 AL2 mode: The same as AL1.
 SET
 P V F Offset value, range: ± 100 .
 0.00 Display value PV = Measured value - PVF
 SET
 I n P Input signal selection K J E S P t L n
 2 stands for K, J, E, S, Pt100, Cu50 or mA/V/mV
 The factory setting is K
 SET
 P Proportional band (%) range 0.1-3600.
 300 If P=OFF, it means ON/OFF control
 SET
 I Integral time range 0.1-3600.
 200 I=OFF means cancel integral time.
 SET
 D Derivative time range 0.1-3600. D=OFF means
 000 cancel derivative time.
 SET
 H E A T Control directions: HEAT: heating
 C O O L COOL: cooling
 SET
 H Y S Control hysteresis, range: ± 100 .
 100 It is not available when P $\neq$ OFF
 SET
 C t L Control Cycle Time (adjust to best fit your process)
 020 Recommended starting settings: Relay = 020sec
 SSR = 001sec. 4-20mA = 000 sec.

SET
 t r L Low analog output (when available)
 0.00 eg. 10-100°C for 4-20mA output, trL=10
 SET
 t r H High analog output (when available)
 100.0 eg. 10-100°C for 4-20mA output, trH=100
 SET
 b s L Only function for 4-20mA/0-10V
 t P V PID means PID control;
 t P V means 4-20mA/0-10V analog output
 SET
 C F Temperature unit. C: °C degree,
 C F: °F degree.
 SET
 L c K Parameter lock code setting. LcK=000
 000 means unlocked. LcK=010 means locked.


Note: Please operate according to the process in this instruction manual. Press <</AT key 2s to enter auto-tune mode, AT lamp ON, it goes off when auto-tuned.
 In most cases you should start-out by placing your controller in auto-tune mode. Once auto-tuned, your controllers should not require additional auto-tune cycle if the environment its working in changes little. If your controllers is being used to heat or cool a load with a large thermal mass, then the auto-tuned values need to be reduced by 5% -10%.
 The CtL setting. In most cases our control cycle should be set to 10-20 seconds. For heating or coolin a load with a large thermal mass, the value should be set to 30-40 seconds. If you are using a controller with a relay, setting longer values will help to extend the life of your relay contacts. Unless your process dictates longer cycle times, the value should be set to 1-3 seconds to non-relay(SSR) controls. The value should be set to 000 if 4-20mA current controls.

Terminal configurations


(If any changed, please refer to the product showing.)

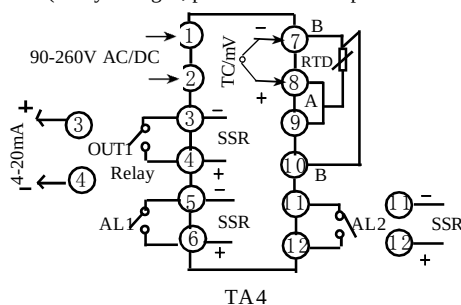

TA4

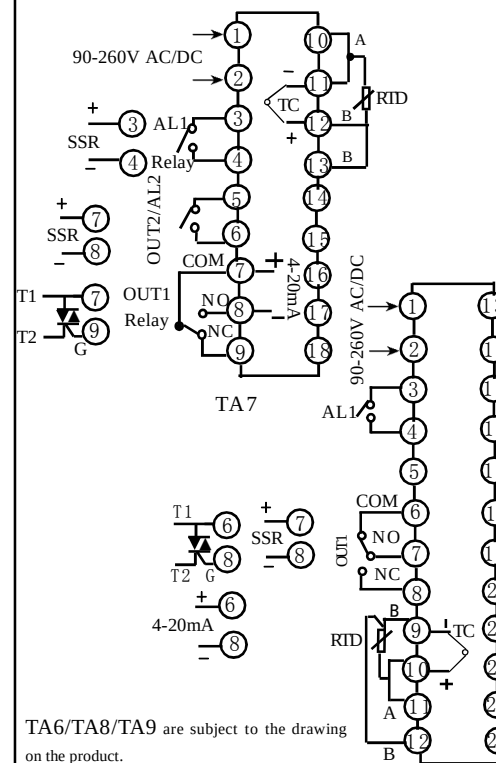

TA6/TA8/TA9 are subject to the drawing on the product.

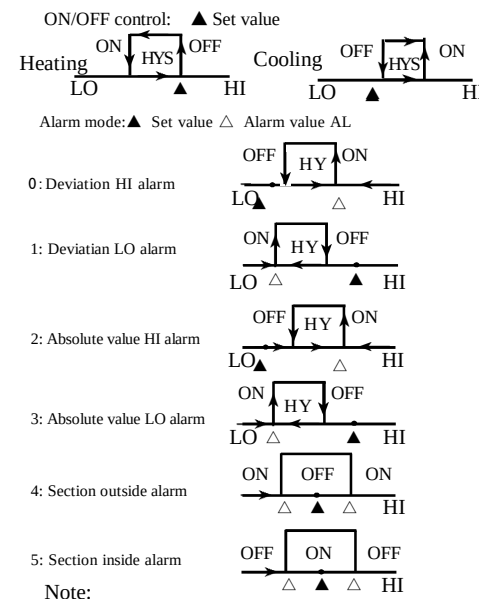


Note:

All the factory setting value of deviation alarm is 1.0.

Application examples

1. Relay output control (for TA7)

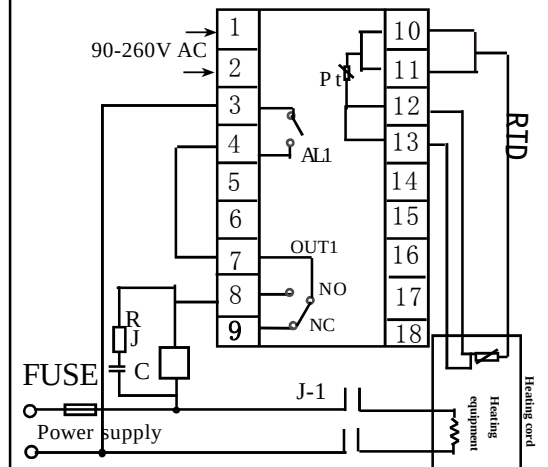

Malfunction estimate

- ① No Display : Check all the connection and wiring if it is all correct. Specially pay attention to the power supply terminals and signal input terminals.
- ② Incorrect Display: Check if the input signal is conformity with the selected symbol.
For TC input, please use the relative compensation cable.
For RTD input, please use low impedance cable. The 3 wires should at the same length.
If all above mentioned is collect, please use parameter PVF to modify.
- ③ Incorrect Control : If the instrument has been used for a long time, the user find the temperature is hard to rise up to the set value, meanwhile the outsidetystem running well, there must be something wrong with the parameters of the instrument.
The user need to re-autotuning the instrument. If the instrument lost control, please check if the connection of the control is correct. If external load is shorted, broken, wrong connection or components is damaged, it will cause lost control as well.
- ④ Display malfunction : "UUUU": The input signal exceed the measured range, or check "USP" value.