

Installation guide

Hot gas bypass regulator type CPCE

Liquid gas mixer type LG (accessory)





034R9507

034R9507

CPCE Refrigerants:

R22, R1270, R134a, R290, R404A, R407A, R407C, R407F, R448A, R449A, R450A, R452A, R507A, R513A, R600, R600a

For complete list of approved refrigerants, visit www.products.danfoss.com and search for individual code numbers, where refrigerants are listed as part of technical data.

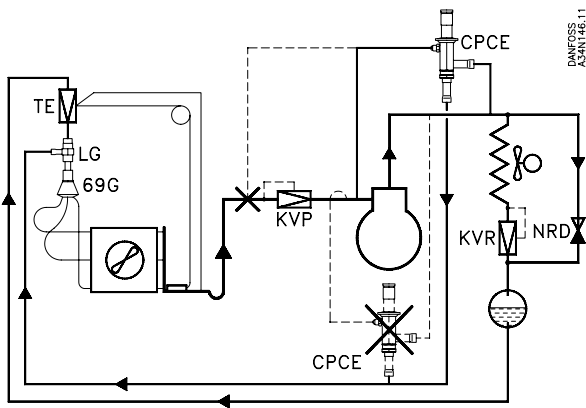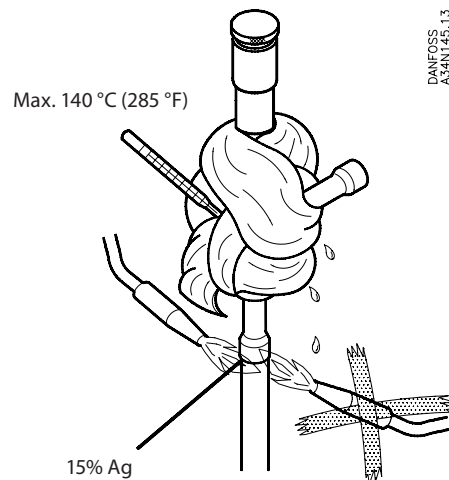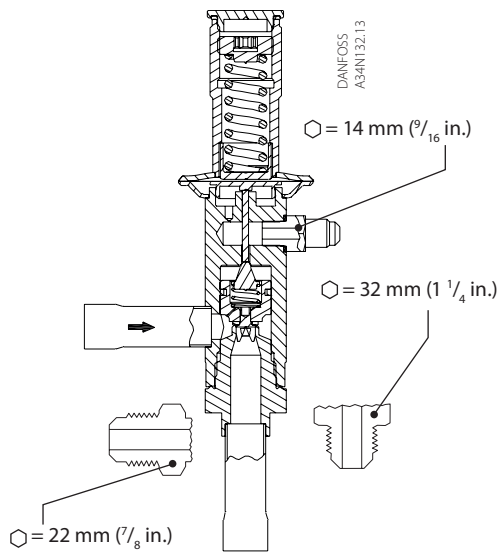

$t_{\text{max.}} = 140^\circ\text{C (285 }^\circ\text{F)}$
 $t_{\text{min.}} = -50^\circ\text{C (-60 }^\circ\text{F)}$

PS/MWP = 28 bar p_e (405 psig)
 $P_{\text{max. test}} = 31 \text{ bar } p_e$ (450 psig)

NB! Tightening torque must be respected especially when used with flammable refrigerants

4Nm (finger tight + 1/4 turn)

