



K100 Programmable Display Beacon Product Manual

Original Instructions

p/n: 245810 Rev. A

02-Sep-25

© Banner Engineering Corp. All rights reserved. www.bannerengineering.com

Contents

Chapter 1 Features	3
Models	3
Chapter 2 Wiring.....	4
Chapter 3 Pro Editor Configuration for the K100 Programmable Display Beacon.....	5
Discrete Control.....	5
Basic I/O State	6
Advanced I/O State	6
I/O Block I/O State	7
Sequence Mode	7
Timer Mode.....	7
Counter Mode.....	8
Measure Mode.....	9
Pulse Control	10
Demo Mode	10
Factory Reset	10
Display Settings.....	10
Chapter 4 Specifications	12
FCC Part 15 Class B for Unintentional Radiators.....	13
Industry Canada ICES-003(B).....	13
Dimensions.....	14
Chapter 5 Accessories.....	15
Cordsets	15
Brackets.....	15
Elevated Mount System.....	16
Pro Editor Hardware	16
Chapter 6 Product Support and Maintenance	17
UTF-8 Encoding Table and Unicode Characters	17
Clean with Mild Detergent and Warm Water	21
Repairs	21
Contact Us.....	22
Banner Engineering Corp Limited Warranty	22

Chapter Contents

Models 3

Chapter 1

Features

The K100 Programmable Display Beacon provides diagnostics and indication for control engineers and OEMs who need to improve the interaction between operators and equipment to drive response speed and productivity improvements.



- Easily configurable, versatile display can be installed nearly anywhere, making it a simple yet powerful alternative to complex HMIs and other displays
- Great for displaying takt time, equipment status, assembly sequences, counts, and measurements where they are most useful
- Discrete models integrate into many different systems and applications, especially Banner sensing, safety, and monitoring solutions
- Quick and easy configuration—simply define the desired text and call it via discrete control or process data
- Bright white LED display and multicolored beacon LEDs legible from 10 meters away inform operators about exactly what is going on so they can respond quickly and accurately
- IP66- and IP69K per ISO 20653-rated polycarbonate housing resists impact and condensation to provide clear communication in challenging and changing environmental conditions
- Wireless communication facilitates remote monitoring and control

Models

Model Key

Series	Style	Type	Voltage	Color	Control	Audible	Connector ⁽¹⁾
K100P	D	BL		RGB	D15		Q
K100P = K100 Pro	D = Display	BL = Beacon Light	Blank = DC	RGB = Multicolor	D15 = Discrete 15 states	Blank = No Audible A = Audible	Q = Integral 5-pin M12 male quick-disconnect connector


⁽¹⁾ Models with a quick-disconnect connector require a mating cordset.

Chapter Contents

Chapter 2

Wiring

Wiring

5-Pin Male M12 Pinout	Pinout Key and Wiring
	1. Brown - Input 2 2. White - Input 3 3. Blue - DC Common 4. Black - Input 1 5. Gray - Input 4

Chapter Contents

Discrete Control.....	5
Sequence Mode	7
Timer Mode	7
Counter Mode.....	8
Measure Mode	9
Pulse Control.....	10
Demo Mode.....	10
Factory Reset.....	10
Display Settings.....	10

Chapter 3 Pro Editor Configuration for the K100 Programmable Display Beacon

Applications




Banner's Pro Editor software offers an easy way to configure Pro Series-enabled indication, touch, and illumination devices, allowing users full control of device states and device logic modes. The easy-to-use configuration software provides a variety of tools and capabilities to solve a wide range of applications such as indicating machine status or warm-up time, indicating unique steps in an assembly process, or incorporating status information into touch buttons.

Set up any Pro Series-enabled device using the free Pro Editor software, available for download at www.bannerengineering.com/proeditor.

Discrete Control

Selecting the Discrete Control tile displays three I/O State tiles:


- Basic
- Advanced
- I/O Block

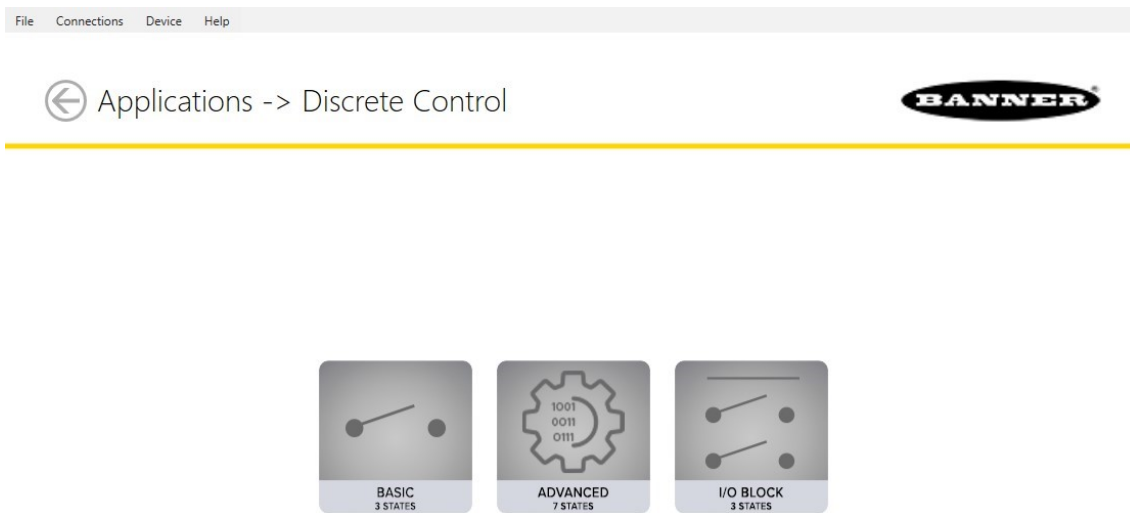

Basic I/O State


Basic four-state control. Configurations made in Basic I/O State assign one wire to one state, with the following override control:

- Pin 1 (Brown) overrides Pin 4 (Black)
- Pin 2 (White) overrides Pins 1 and 4 (Brown and Black)
- Pin 5 (Gray) overrides Pins 1, 2, and 4 (Brown, White, and Black)

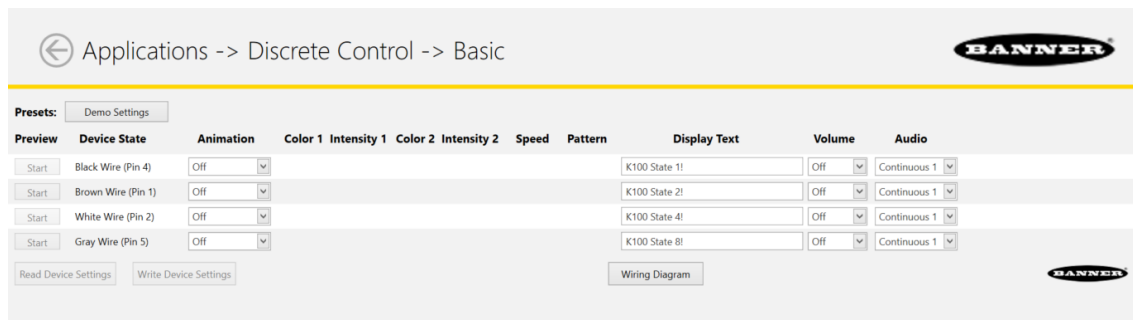

Advanced I/O State

Advanced, default I/O state, with fifteen state options for maximum configuration ability. Configurations made in Advanced I/O State assign binary wiring combinations of all valid inputs to each state. Both the indication LEDs and the display text can be programmed for each of the states.

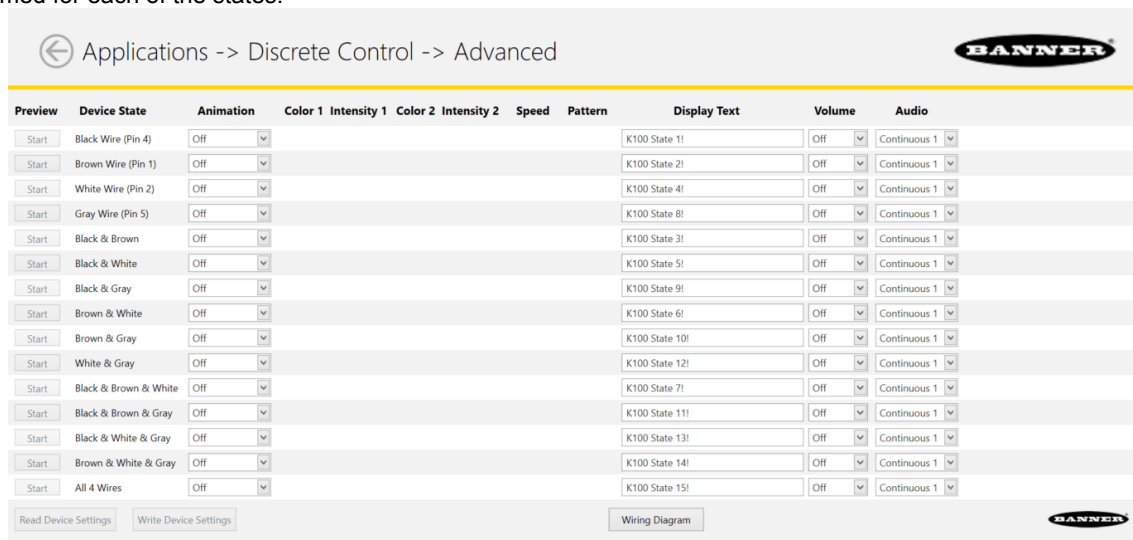

I/O Block I/O State

Three-state control for use with I/O block. Configurations made in I/O Block assign state to the black, white, and combination of black and white wires for use with the I/O blocks, for which power (brown) and common (blue) are always on for five-pin connections.

← Applications -> Discrete Control -> I/O Block

Start

Black (Pin 4)

Off

Start

White (Pin 2)

Off

Start

Black & White

Off

Read Device Settings

Write Device Settings

Wiring Diagram

Sequence Mode

Sequence Mode allows up to sixteen states that a single input can control. A pulse on the input wire moves the K100 Pro to the next state.

← Applications -> Sequence

Presets: Demo Settings

Reset State Input: DisabledNext State Input: DisabledFirst Animation: 1Last Animation: 16

Preview	State	Animation	Color 1	Intensity 1	Color 2	Intensity 2	Speed	Pattern	Display Text	Volume	Audio
Start	1	Off							K100 State 0!	Off	Continuous 1
Start	2	Off							K100 State 1!	Off	Continuous 1
Start	3	Off							K100 State 2!	Off	Continuous 1
Start	4	Off							K100 State 3!	Off	Continuous 1
Start	5	Off							K100 State 4!	Off	Continuous 1
Start	6	Off							K100 State 5!	Off	Continuous 1
Start	7	Off							K100 State 6!	Off	Continuous 1
Start	8	Off							K100 State 7!	Off	Continuous 1
Start	9	Off							K100 State 8!	Off	Continuous 1
Start	10	Off							K100 State 9!	Off	Continuous 1
Start	11	Off							K100 State 10!	Off	Continuous 1
Start	12	Off							K100 State 11!	Off	Continuous 1
Start	13	Off							K100 State 12!	Off	Continuous 1
Start	14	Off							K100 State 13!	Off	Continuous 1
Start	15	Off							K100 State 14!	Off	Continuous 1
Start	16	Off							K100 State 15!	Off	Continuous 1

Read Device Settings

Write Device Settings

Reset State Input	Choose the desired input wire to restart the K100 Pro to the First Animation as chosen in the dropdown menu.
Next State Input	Choose the desired input wire to move K100 Pro to the next state in the series until the Last Animation is reached.
First Animation	Choose the initial state to display as the sequence is initiated.
Last Animation	Choose the final state to include in the sequence.

Timer Mode

Set a total time and up to four thresholds. Start and stop the timer counting up or down with discrete control. Colors change across threshold values.

← Applications -> Timer



Count: 30 Units: Days Direction: Up Auto Restart: Disabled

Bar Graph Orientation: 3

Display Bar Graph: ☒ Bar Graph Only: ☐ Display Slim Bar Graph: ☐ Display Level as Time: ☐

Data Label: Time= Value Label: s Decimal Places: 1

Presets: Standard Settings Demo Settings

Threshold	Enabled	Percent	Animation	Colors	Intensities	Speed	Pattern	Display Text	Volume	Audio
				Color 1 Color 2 Color 1 Color 2						
#4:	☒	100	Intensity Sweep		High	Standard		Warning!	Off	Continuous
#3:	☒	75	Steady		High			Thresh 3	Off	Continuous
#2:	☒	50	Steady		High			Thresh 2	Off	Continuous
#1:	☒	25	Steady		High			Thresh 1	Off	Continuous

Read Write

Wiring Diagram

Count Seconds	The total time of the timer.
Direction	Up: Counts up from zero to Count Seconds. Down: Counts down from Count Seconds to zero.
Reset Input	Enable or disable the input wire to reset the timer to the initial value.
Auto Restart	The timer loops back to the original value automatically when it reaches its final value.

Bar Graph Orientation	Determine the starting side of the bar graph.
Decimal Places	Determine the number of decimal places displayed on the Count Value.
Display Graph Only	Only display the bar graph, and not the numerical Count Value.
Display Bar Graph	Display the bar graph across the full display.
Display Slim Bar Graph	Display the bar graph as a single line of LEDs.
Display Level as Time	Display the time in HH:MM:SS format without data labels.
Data Label	Text that displays before the Count Value.
Value Label	Text that displays after the Count Value to indicate the units displayed. This can be up to three characters.
Standard Settings	Reset the K100 Pro to predetermined settings.

Counter Mode

Set a total count and up to four thresholds. Discrete, rising edge pulses count up or down. Colors change across threshold values.

← Applications -> Counter



Pulses: 30 Direction: Up Control Input Function: Reset

Bar Graph Orientation: 3

Display Bar Graph: ☒ Bar Graph Only: ☐ Display Slim Bar Graph: ☐ Display Level as Time: ☐

Data Label: Time= Value Label: s

Presets: Standard Settings Demo Settings

Threshold	Enabled	Percent	Animation	Colors	Intensities	Speed	Pattern	Display Text	Volume	Audio
				Color 1 Color 2 Color 1 Color 2						
#4:	☒	100	Intensity Sweep		High	Standard		Warning!	Off	Continuous
#3:	☒	75	Steady		High			Thresh 3	Off	Continuous
#2:	☒	50	Steady		High			Thresh 2	Off	Continuous
#1:	☒	25	Steady		High			Thresh 1	Off	Continuous

Read Write

Wiring Diagram

Pulses	Determine the number of counts that are either counted up to or counted down from, depending on the chosen direction.
--------	---

Continued on page 9

Continued from page 8

Direction	Up: Counts from zero to Pulses. Down: Counts from Pulses to zero.
Reset Input	Enable or disable the input wire to reset the count to the initial value.

Bar Graph Orientation	Determine the starting side of the bar graph.
Decimal Places	Determine the number of decimal places displayed on the Count Value.
Display Graph Only	Only display the bar graph, and not the numerical Count Value.
Display Bar Graph	Display the bar graph across the full display.
Display Slim Bar Graph	Display the bar graph as a single line of LEDs.
Data Label	Text that displays before the Count Value.
Value Label	Text that displays after the Count Value to indicate the units displayed. This can be up to three characters.
Standard Settings	Reset the K100 Pro to predetermined settings.

Measure Mode

Measure Mode uses the K100 Pro to display a measurement as either PWM control or PFM control.

← Applications -> Measure

The screenshot shows the Banner K100 Pro Measure Mode configuration interface. At the top, there are settings for PWM/PFM (Pulse-Width/Frequency Modulation), including Low and High frequency values, Filter Level, Hysteresis Level, Output Scale Value Low/High, Bar Graph Orientation, Display Bar Graph, Display Slim Bar Graph, Data Label, Value Label, and Decimal Places. Below these are Presets (Standard Settings, Demo Settings) and a table for Thresholds (1-4) with columns for Enabled, Percent, Animation, Colors, Intensities, Speed, Pattern, Display Text, Volume, and Audio. A Wiring Diagram button is located at the bottom right.

PWM/PFM	PWM: Pulse-Width Modulation. PFM: Pulse-Frequency Modulation.
PWM/PFM Low	The lowest frequency of the input range.
PWM/PFM High	The highest frequency of the input range.
Filter Level	The level of filtering used to minimize the effects of noise on the output.
Hysteresis Level	The level of lag between the measurement thresholds to minimize the flickering at switch points.
Output Scale Value Low	The low-end value of the output translated from the input frequency.
Output Scale Value High	The high-end value of the output translated from the input frequency.

Bar Graph Orientation	Determine the starting side of the bar graph.
Decimal Places	Determine the number of decimal places displayed on the Count Value.
Display Graph Only	Only display the bar graph, and not the numerical value.
Display Bar Graph	Display the bar graph across the full display.
Display Slim Bar Graph	Display the bar graph as a single line of LEDs.
Data Label	Text that displays before the Count Value.
Value Label	Text that displays after the Count Value to indicate the units displayed. This can be up to three characters.
Standard Settings	Reset the K100 Pro to predetermined settings.

Pulse Control

Selecting the Pulse Control tile displays up to sixteen states that correspond to input frequencies on the white wire. The number of states (1) and input characteristics (2) are user-defined. Ranges are calculated (3).

Applications -> Pulse Control

Number of States: 16

PWM/PFM: PFM

PFM Low: 100

PFM High: 600

Preview	State	Animation	Color 1	Intensity 1	Color 2	Intensity 2	Speed	Pattern	Display Text	Range (Hz)	Volume	Audio
Start	1	Off							K100 State 0!	100 - 131	Off	Continuous 1
Start	2	Off							K100 State 1!	131 - 163	Off	Continuous 1
Start	3	Off							K100 State 2!	163 - 194	Off	Continuous 1
Start	4	Off							K100 State 3!	194 - 225	Off	Continuous 1
Start	5	Off							K100 State 4!	225 - 256	Off	Continuous 1
Start	6	Off							K100 State 5!	256 - 288	Off	Continuous 1
Start	7	Off							K100 State 6!	288 - 319	Off	Continuous 1
Start	8	Off							K100 State 7!	319 - 350	Off	Continuous 1
Start	9	Off							K100 State 8!	350 - 381	Off	Continuous 1
Start	10	Off							K100 State 9!	381 - 413	Off	Continuous 1
Start	11	Off							K100 State 10!	413 - 444	Off	Continuous 1
Start	12	Off							K100 State 11!	444 - 475	Off	Continuous 1
Start	13	Off							K100 State 12!	475 - 506	Off	Continuous 1
Start	14	Off							K100 State 13!	506 - 538	Off	Continuous 1
Start	15	Off							K100 State 14!	538 - 569	Off	Continuous 1
Start	16	Off							K100 State 15!	569 - 600	Off	Continuous 1

Read

Write

Wiring Diagram

Number of States	Determine the number of states from 1 to 16.
PWM/PFM	Select either PWM (Pulse Width Modulation) or PFM (Pulse Frequency Modulation) as the device's input.
PWM/PFM Low	Determine the low end of the input signal range.
PWM/PFM High	Determine the high end of the input signal range.

Demo Mode

Activate Demo Mode on the device to cycle through various modes automatically as a demonstration.

Factory Reset

Restore the K100 Pro to default settings.

Display Settings

Display Settings are a type of advanced settings that are accessible across all Applications.


Advanced Settings
—
□
×

Display Settings

Text Color: White ▼

Brightness: High ▼

Scroll Direction: CCW ▼

Scroll Speed: Standard ▼

Scroll Mode: Auto ▼

Connector Orientation: Bottom ▼

Text Justification: Left ▼

Mirror: Disabled ▼

Repeat Display Value: Disabled ▼

Deadspace: Disabled ▼

Confirm

Text Color	Configure the primary text color as either white or black.
Brightness	Control the brightness of the display text.
Scroll Direction	Scroll the display text either clockwise or counterclockwise when looking at the top of the device.
Scroll Speed	Control the speed the display text scrolls.
Scroll Mode	Auto: Scrolls if the number of characters is greater than fourteen. Off: Does not scroll the display text. On: Scrolls the display text regardless of the number of characters.
Connector Orientation	Determine the orientation of the connector when installed. The display text automatically adjusts to the correct orientation.
Text Justification	Control the alignment of the display text: left, right, or center.
Mirror	Enable this setting to reverse the display text so that it can be read in a mirror.
Repeat Display Value	Display the dynamic value of Timer, Counter, or Measure Mode multiple times around the device for increased visibility. The value repeats the maximum number of times allowed by the display size. As the size of the value increases, the device updates the number of times the value is displayed. The Data Label should be blank when this setting is enabled.
Deadspace	Enable this setting to add a blank space at the end of the display to separate scrolling text.

Chapter Contents

FCC Part 15 Class B for Unintentional Radiators	13
Industry Canada ICES-003(B).....	13
Dimensions.....	14

Chapter 4 Specifications

Supply Voltage

12 V DC to 30 V DC

Use only with a suitable Class 2 power supply (UL) or SELV power supply (CE)

Supply Current

550 mA max. at 12 V DC

270 mA max. at 24 V DC

220 mA max. at 30 V DC

Supply Protection Circuitry

Protected against reverse polarity and transient voltages

Leakage Current Immunity400 μ A**Indicator Response Time**

On response: 325 ms (max)

Off response: 20 ms (max)

Connections

Integral 5-pin M12 male quick-disconnect connector

Models with a quick-disconnect connector require a mating cordset

Do not spray cable with high-pressure sprayer or cable damage will result

Operating Temperature

-40 °C to +50 °C (-40 °F to +122 °F)

Storage Temperature

-40 °C to +70 °C (-40 °F to +158 °F)

Environmental Rating

Rated IP66 and IP69K per ISO 20653

UL Type 4X

Vibration and Mechanical Shock

Meets IEC 60068-2-6 requirements (Vibration: 10 Hz to 55 Hz, 1.0 mm amplitude, 5 minutes sweep, 30 minutes dwell)

Meets IEC 60068-2-27 requirements (Shock: 15G 11 ms duration, half sine wave)

Impact: IK10 (60068-2-75)

Audible Characteristics

Sound Intensity at 2.5 KHz, at 1 m (typical):

Low volume setting: 93 dB

Medium volume setting: 96 dB

High volume setting: 101 dB

Character Limit

Discrete Control: 29 characters

All other modes: 32 characters

Construction

Black polycarbonate housing

Smoky polycarbonate dome

Certifications

Banner Engineering BV
Park Lane, Culliganlaan 2F bus 3
1831 Diegem, BELGIUM

**Required Overcurrent Protection**

WARNING: Electrical connections must be made by qualified personnel in accordance with local and national electrical codes and regulations.

Overcurrent protection is required to be provided by end product application per the supplied table.

Overcurrent protection may be provided with external fusing or via Current Limiting, Class 2 Power Supply.

Supply wiring leads < 24 AWG shall not be spliced.

For additional product support, go to www.bannerengineering.com.

Supply Wiring (AWG)	Required Overcurrent Protection (A)	Supply Wiring (AWG)	Required Overcurrent Protection (A)
20	5.0	26	1.0
22	3.0	28	0.8
24	2.0	30	0.5

Mounting

M36 x 2 threaded base, maximum torque 5 N·m (44 inch-lbf)

Interior 3/4-14 NPT thread

Mounting nut included

Indicator Characteristics

Color	Dominant Wavelength (nm) or Color Temperature (CCT)	Color Coordinates ⁽²⁾		Lumen Output (Typical at 25 °C)
		x	y	
Green	523	0.159	0.6987	30.4
Red	620	0.6895	0.3087	14.6
Orange	599	0.5992	0.3752	17.7
Amber	588	0.535	0.4223	19.8
Yellow	575	0.4518	0.4834	22.4
Lime Green	560	0.3655	0.5471	25
Spring Green	506	0.1572	0.5171	26.6
Cyan	491	0.1565	0.3201	21.3
Sky Blue	484	0.1443	0.2271	16.8
Blue	467	0.1371	0.0555	5.4
Violet	415	0.2141	0.0904	7.9
Magenta	-	0.3661	0.1644	11.4
Rose	-	0.4976	0.2201	12.9
White	5500K	0.3309	0.3385	41.7

FCC Part 15 Class B for Unintentional Radiators

(Part 15.105(b)) This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

(Part 15.21) Any changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate this equipment.

Industry Canada ICES-003(B)


This device complies with CAN ICES-3 (B)/NMB-3(B). Operation is subject to the following two conditions: 1) This device may not cause harmful interference; and 2) This device must accept any interference received, including interference that may cause undesired operation.

Cet appareil est conforme à la norme NMB-3(B). Le fonctionnement est soumis aux deux conditions suivantes : (1) ce dispositif ne peut pas occasionner d'interférences, et (2) il doit tolérer toute interférence, y compris celles susceptibles de provoquer un fonctionnement non souhaité du dispositif.

⁽²⁾ Refer to CIE 1931 chromaticity diagram or color chart, to show equivalent color with indicated color coordinates. Actual coordinates may differ by 10%.

Dimensions

All measurements are listed in millimeters [inches], unless noted otherwise. The measurements provided are subject to change.

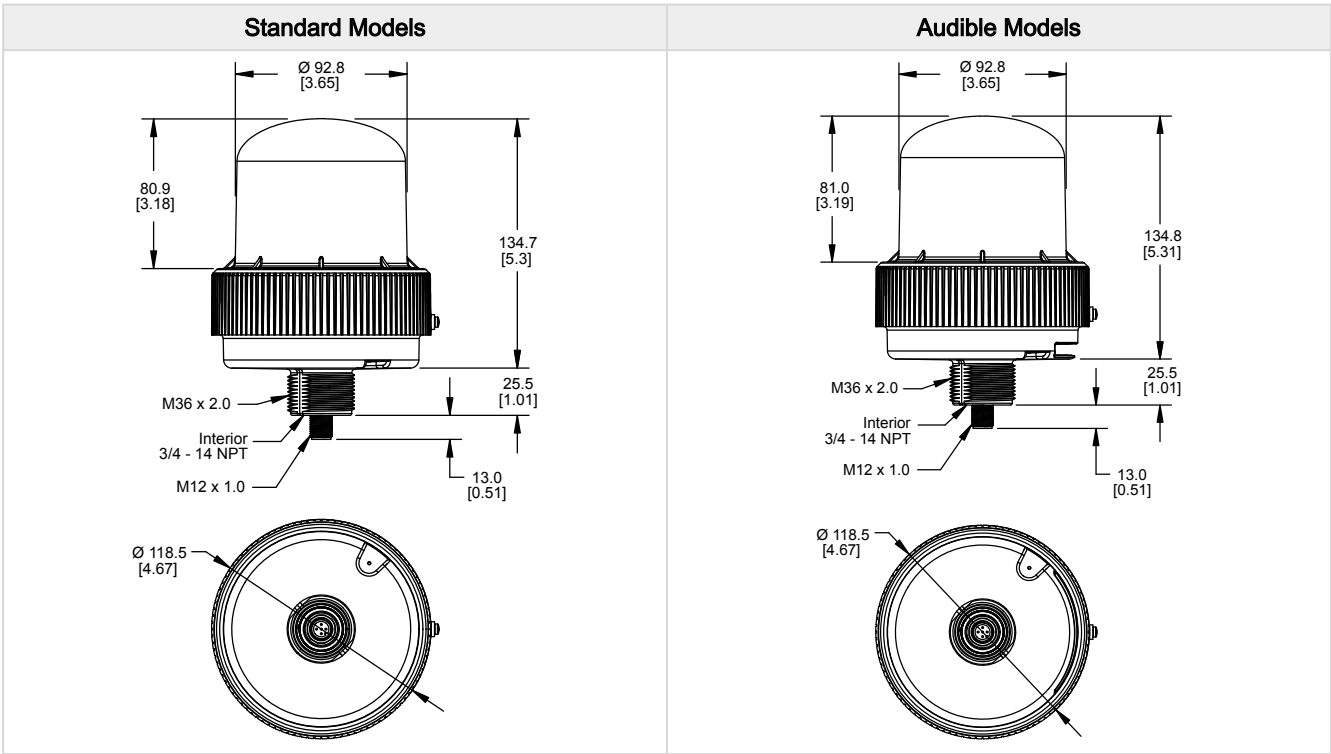

Chapter Contents

Cordsets

Brackets

Elevated Mount System

Pro Editor Hardware

15

15

16

16

Chapter 5

Accessories

Cordsets

All measurements are listed in millimeters [inches], unless noted otherwise. The measurements provided are subject to change.

5-pin A-Code Double-Ended M12 Female to M12 Male Cordsets (datasheet p/n 236183)				
Model	Length	Dimensions (mm)	Pinouts	
BC-M12F5-M12M5-22-1	1 m (3.28 ft)		Female Male 1 = Brown 2 = White 3 = Blue 4 = Black 5 = Gray	
BC-M12F5-M12M5-22-2	2 m (6.56 ft)			
BC-M12F5-M12M5-22-5	5 m (16.4 ft)			
BC-M12F5-M12M5-22-8	8 m (26.25 ft)			
BC-M12F5-M12M5-22-10	10 m (30.81 ft)			
BC-M12F5-M12M5-22-15	15 m (49.2 ft)			


5-pin A-Code Double-Ended M12 Female Right-Angle to M12 Male Right-Angle Cordsets (datasheet p/n 236183)				
Model	Length	Dimensions (mm)	Pinouts	
BC-M12F5A-M12M5A-22-1	1 m (3.28 ft)		Female Male 1 = Brown 2 = White 3 = Blue 4 = Black 5 = Gray	
BC-M12F5A-M12M5A-22-2	2 m (6.56 ft)			
BC-M12F5A-M12M5A-22-5	5 m (16.4 ft)			
BC-M12F5A-M12M5A-22-8	8 m (26.25 ft)			
BC-M12F5A-M12M5A-22-10	10 m (30.81 ft)			
BC-M12F5A-M12M5A-22-15	15 m (49.2 ft)			

Brackets

LMB36RA - Indicator light right-angle mounting 36 mm mounting hole - Stainless steel	
---	--


Elevated Mount System

Elevated Mount System (1/2" Pipes)

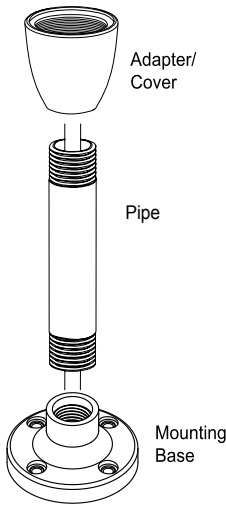

Adapter/Cover Model		Description
SA-M36E12		• Adapter from M36 thread to ½-14 NPSM thread • Streamlined black plastic mounting base adapter/cover • Drilled hole
Black Anodized Aluminum, ½ in. NPT Pipe Models	Clear Anodized Aluminum, ½ in. NPT Pipe Models	Description
SOP-E12-150A, 150 mm (6 in) long	SOP-E12-150AC, 150 mm (6 in) long	• Elevated-use stand-off pipe • Threaded at both ends • Compatible with most industrial environments
SOP-E12-300A, 300 mm (12 in) long	SOP-E12-300AC, 300 mm (12 in) long	
SOP-E12-600A, 600 mm (24 in) long	-	
SOP-E12-900A, 900 mm (36 in) long	SOP-E12-900AC, 900 mm (36 in) long	
Mounting Base Model	Description	
SA-F12	• Elevated-use stand-off pipes (½ in, NPSM/DN15) • M5 mounting hardware and nitrile gasket included • Die-cast zinc base with black paint	

Elevated Mount System (3/4" Pipes)

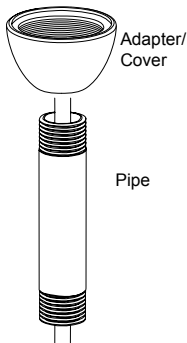

Adapter/Cover Model	Description
SA-M36SOP	• M36 thread adapter with clearance for ¾ pipe mount • Streamlined black plastic mounting base adapter/cover • Drilled hole

Black Anodized Aluminum, ¾ in. NPT Pipe Models	Description
SOP-E34-150A, 150 mm (6 in) long	• Elevated-use stand-off pipe • Threaded at both ends • Compatible with most industrial environments
SOP-E34-300A, 300 mm (12 in) long	
SOP-E34-600A, 600 mm (24 in) long	
SOP-E34-900A, 900 mm (36 in) long	

Pro Editor Hardware

PRO-KIT Includes: • Pro Converter Cable (MQDC-506-USB) • Splitter (CSB-M1251FM1251M) • Power Supply (PSW-24-1)	A diagram showing three pieces of hardware: a coiled cable with connectors, a small electronic splitter unit, and a rectangular power supply unit with a power cord.
---	--

Chapter Contents

UTF-8 Encoding Table and Unicode Characters.....	17
Clean with Mild Detergent and Warm Water	21
Repairs	21
Contact Us.....	22
Banner Engineering Corp Limited Warranty.....	22

Chapter 6 Product Support and Maintenance

UTF-8 Encoding Table and Unicode Characters

Unicode Code Point	Character	UTF-8 (hex.)	Name
U+0020		20	SPACE
U+0021	!	21	EXCLAMATION MARK
U+0022	"	22	QUOTATION MARK
U+0023	#	23	NUMBER SIGN
U+0024	\$	24	DOLLAR SIGN
U+0025	%	25	PERCENT SIGN
U+0026	&	26	AMPERSAND
U+0027	'	27	APOSTROPHE
U+0028	(	28	LEFT PARENTHESIS
U+0029	)	29	RIGHT PARENTHESIS
U+002A	*	2a	ASTERISK
U+002B	+	2b	PLUS SIGN
U+002C	,	2c	COMMA
U+002D	-	2d	HYPHEN-MINUS
U+002E	.	2e	FULL STOP
U+002F	/	2f	SOLIDUS
U+0030	0	30	DIGIT ZERO
U+0031	1	31	DIGIT ONE
U+0032	2	32	DIGIT TWO
U+0033	3	33	DIGIT THREE
U+0034	4	34	DIGIT FOUR
U+0035	5	35	DIGIT FIVE
U+0036	6	36	DIGIT SIX
U+0037	7	37	DIGIT SEVEN
U+0038	8	38	DIGIT EIGHT
U+0039	9	39	DIGIT NINE
U+003A	:	3a	COLON
U+003B	;	3b	SEMICOLON
U+003C	<	3c	LESS-THAN SIGN
U+003D	=	3d	EQUALS SIGN
U+003E	>	3e	GREATER-THAN SIGN

Continued on page 18

Continued from page 17

Unicode Code Point	Character	UTF-8 (hex.)	Name
U+003F	?	3f	QUESTION MARK
U+0040	@	40	COMMERCIAL AT
U+0041	A	41	LATIN CAPITAL LETTER A
U+0042	B	42	LATIN CAPITAL LETTER B
U+0043	C	43	LATIN CAPITAL LETTER C
U+0044	D	44	LATIN CAPITAL LETTER D
U+0045	E	45	LATIN CAPITAL LETTER E
U+0046	F	46	LATIN CAPITAL LETTER F
U+0047	G	47	LATIN CAPITAL LETTER G
U+0048	H	48	LATIN CAPITAL LETTER H
U+0049	I	49	LATIN CAPITAL LETTER I
U+004A	J	4a	LATIN CAPITAL LETTER J
U+004B	K	4b	LATIN CAPITAL LETTER K
U+004C	L	4c	LATIN CAPITAL LETTER L
U+004D	M	4d	LATIN CAPITAL LETTER M
U+004E	N	4e	LATIN CAPITAL LETTER N
U+004F	O	4f	LATIN CAPITAL LETTER O
U+0050	P	50	LATIN CAPITAL LETTER P
U+0051	Q	51	LATIN CAPITAL LETTER Q
U+0052	R	52	LATIN CAPITAL LETTER R
U+0053	S	53	LATIN CAPITAL LETTER S
U+0054	T	54	LATIN CAPITAL LETTER T
U+0055	U	55	LATIN CAPITAL LETTER U
U+0056	V	56	LATIN CAPITAL LETTER V
U+0057	W	57	LATIN CAPITAL LETTER W
U+0058	X	58	LATIN CAPITAL LETTER X
U+0059	Y	59	LATIN CAPITAL LETTER Y
U+005A	Z	5a	LATIN CAPITAL LETTER Z
U+005B	[	5b	LEFT SQUARE BRACKET
U+005C	\	5c	REVERSE SOLIDUS
U+005D	]	5d	RIGHT SQUARE BRACKET
U+005E	^	5e	CIRCUMFLEX ACCENT
U+005F	_	5f	LOW LINE
U+0060	`	60	GRAVE ACCENT
U+0061	a	61	LATIN SMALL LETTER A
U+0062	b	62	LATIN SMALL LETTER B
U+0063	c	63	LATIN SMALL LETTER C
U+0064	d	64	LATIN SMALL LETTER D
U+0065	e	65	LATIN SMALL LETTER E
U+0066	f	66	LATIN SMALL LETTER F
U+0067	g	67	LATIN SMALL LETTER G
U+0068	h	68	LATIN SMALL LETTER H

Continued on page 19

Continued from page 18

Unicode Code Point	Character	UTF-8 (hex.)	Name
U+0069	i	69	LATIN SMALL LETTER I
U+006A	j	6a	LATIN SMALL LETTER J
U+006B	k	6b	LATIN SMALL LETTER K
U+006C	l	6c	LATIN SMALL LETTER L
U+006D	m	6d	LATIN SMALL LETTER M
U+006E	n	6e	LATIN SMALL LETTER N
U+006F	o	6f	LATIN SMALL LETTER O
U+0070	p	70	LATIN SMALL LETTER P
U+0071	q	71	LATIN SMALL LETTER Q
U+0072	r	72	LATIN SMALL LETTER R
U+0073	s	73	LATIN SMALL LETTER S
U+0074	t	74	LATIN SMALL LETTER T
U+0075	u	75	LATIN SMALL LETTER U
U+0076	v	76	LATIN SMALL LETTER V
U+0077	w	77	LATIN SMALL LETTER W
U+0078	x	78	LATIN SMALL LETTER X
U+0079	y	79	LATIN SMALL LETTER Y
U+007A	z	7a	LATIN SMALL LETTER Z
U+007B	{	7b	LEFT CURLY BRACKET
U+007C		7c	VERTICAL LINE
U+007D	}	7d	RIGHT CURLY BRACKET
U+007E	~	7e	TILDE
U+00A0		c2 a0	NO-BREAK SPACE
U+00A1	¡	c2 a1	INVERTED EXCLAMATION MARK
U+00A2	¢	c2 a2	CENT SIGN
U+00A3	£	c2 a3	POUND SIGN
U+00A4	¤	c2 a4	CURRENCY SIGN
U+00A5	¥	c2 a5	YEN SIGN
U+00A6	¦	c2 a6	BROKEN BAR
U+00A7	§	c2 a7	SECTION SIGN
U+00A8	¨	c2 a8	DIAERESIS
U+00A9	©	c2 a9	COPYRIGHT SIGN
U+00AA	ª	c2 aa	FEMININE ORDINAL INDICATOR
U+00AB	«	c2 ab	LEFT-POINTING DOUBLE ANGLE QUOTATION MARK
U+00AC	¬	c2 ac	NOT SIGN
U+00AD		c2 ad	SOFT HYPHEN
U+00AE	®	c2 ae	REGISTERED SIGN
U+00AF	—	c2 af	MACRON
U+00B0	°	c2 b0	DEGREE SIGN
U+00B1	±	c2 b1	PLUS-MINUS SIGN
U+00B2	²	c2 b2	SUPERSCRIPT TWO
U+00B3	³	c2 b3	SUPERSCRIPT THREE

Continued on page 20

Continued from page 19

Unicode Code Point	Character	UTF-8 (hex.)	Name
U+00B4	´	c2 b4	ACUTE ACCENT
U+00B5	μ	c2 b5	MICRO SIGN
U+00B6	¶	c2 b6	PILCROW SIGN
U+00B7	·	c2 b7	MIDDLE DOT
U+00B8	¸	c2 b8	CEDILLA
U+00B9	¹	c2 b9	SUPERSCRIPT ONE
U+00BA	º	c2 ba	MASCULINE ORDINAL INDICATOR
U+00BB	»	c2 bb	RIGHT-POINTING DOUBLE ANGLE QUOTATION MARK
U+00BC	¼	c2 bc	VULGAR FRACTION ONE QUARTER
U+00BD	½	c2 bd	VULGAR FRACTION ONE HALF
U+00BE	¾	c2 be	VULGAR FRACTION THREE QUARTERS
U+00BF	¿	c2 bf	INVERTED QUESTION MARK
U+00C0	À	c3 80	LATIN CAPITAL LETTER A WITH GRAVE
U+00C1	Á	c3 81	LATIN CAPITAL LETTER A WITH ACUTE
U+00C2	Â	c3 82	LATIN CAPITAL LETTER A WITH CIRCUMFLEX
U+00C3	Ã	c3 83	LATIN CAPITAL LETTER A WITH TILDE
U+00C4	Ä	c3 84	LATIN CAPITAL LETTER A WITH DIAERESIS
U+00C5	Å	c3 85	LATIN CAPITAL LETTER A WITH RING ABOVE
U+00C6	Æ	c3 86	LATIN CAPITAL LETTER AE
U+00C7	Ç	c3 87	LATIN CAPITAL LETTER C WITH CEDILLA
U+00C8	È	c3 88	LATIN CAPITAL LETTER E WITH GRAVE
U+00C9	É	c3 89	LATIN CAPITAL LETTER E WITH ACUTE
U+00CA	Ê	c3 8a	LATIN CAPITAL LETTER E WITH CIRCUMFLEX
U+00CB	Ë	c3 8b	LATIN CAPITAL LETTER E WITH DIAERESIS
U+00CC	Ì	c3 8c	LATIN CAPITAL LETTER I WITH GRAVE
U+00CD	Í	c3 8d	LATIN CAPITAL LETTER I WITH ACUTE
U+00CE	Î	c3 8e	LATIN CAPITAL LETTER I WITH CIRCUMFLEX
U+00CF	Ï	c3 8f	LATIN CAPITAL LETTER I WITH DIAERESIS
U+00D0	Ð	c3 90	LATIN CAPITAL LETTER ETH
U+00D1	Ñ	c3 91	LATIN CAPITAL LETTER N WITH TILDE
U+00D2	Ò	c3 92	LATIN CAPITAL LETTER O WITH GRAVE
U+00D3	Ó	c3 93	LATIN CAPITAL LETTER O WITH ACUTE
U+00D4	Ô	c3 94	LATIN CAPITAL LETTER O WITH CIRCUMFLEX
U+00D5	Õ	c3 95	LATIN CAPITAL LETTER O WITH TILDE
U+00D6	Ö	c3 96	LATIN CAPITAL LETTER O WITH DIAERESIS
U+00D7	×	c3 97	MULTIPLICATION SIGN
U+00D8	Ø	c3 98	LATIN CAPITAL LETTER O WITH STROKE
U+00D9	Ù	c3 99	LATIN CAPITAL LETTER U WITH GRAVE
U+00DA	Ú	c3 9a	LATIN CAPITAL LETTER U WITH ACUTE
U+00DB	Û	c3 9b	LATIN CAPITAL LETTER U WITH CIRCUMFLEX
U+00DC	Ü	c3 9c	LATIN CAPITAL LETTER U WITH DIAERESIS
U+00DD	Ý	c3 9d	LATIN CAPITAL LETTER Y WITH ACUTE

Continued on page 21

Continued from page 20

Unicode Code Point	Character	UTF-8 (hex.)	Name
U+00DE	þ	c3 9e	LATIN CAPITAL LETTER THORN
U+00DF	ß	c3 9f	LATIN SMALL LETTER SHARP S
U+00E0	à	c3 a0	LATIN SMALL LETTER A WITH GRAVE
U+00E1	á	c3 a1	LATIN SMALL LETTER A WITH ACUTE
U+00E2	â	c3 a2	LATIN SMALL LETTER A WITH CIRCUMFLEX
U+00E3	ã	c3 a3	LATIN SMALL LETTER A WITH TILDE
U+00E4	ä	c3 a4	LATIN SMALL LETTER A WITH DIAERESIS
U+00E5	å	c3 a5	LATIN SMALL LETTER A WITH RING ABOVE
U+00E6	æ	c3 a6	LATIN SMALL LETTER AE
U+00E7	ç	c3 a7	LATIN SMALL LETTER C WITH CEDILLA
U+00E8	è	c3 a8	LATIN SMALL LETTER E WITH GRAVE
U+00E9	é	c3 a9	LATIN SMALL LETTER E WITH ACUTE
U+00EA	ê	c3 aa	LATIN SMALL LETTER E WITH CIRCUMFLEX
U+00EB	ë	c3 ab	LATIN SMALL LETTER E WITH DIAERESIS
U+00EC	ì	c3 ac	LATIN SMALL LETTER I WITH GRAVE
U+00ED	í	c3 ad	LATIN SMALL LETTER I WITH ACUTE
U+00EE	î	c3 ae	LATIN SMALL LETTER I WITH CIRCUMFLEX
U+00EF	ï	c3 af	LATIN SMALL LETTER I WITH DIAERESIS
U+00F0	ð	c3 b0	LATIN SMALL LETTER ETH
U+00F1	ñ	c3 b1	LATIN SMALL LETTER N WITH TILDE
U+00F2	ò	c3 b2	LATIN SMALL LETTER O WITH GRAVE
U+00F3	ó	c3 b3	LATIN SMALL LETTER O WITH ACUTE
U+00F4	ô	c3 b4	LATIN SMALL LETTER O WITH CIRCUMFLEX
U+00F5	õ	c3 b5	LATIN SMALL LETTER O WITH TILDE
U+00F6	ö	c3 b6	LATIN SMALL LETTER O WITH DIAERESIS
U+00F7	÷	c3 b7	DIVISION SIGN
U+00F8	ø	c3 b8	LATIN SMALL LETTER O WITH STROKE
U+00F9	ù	c3 b9	LATIN SMALL LETTER U WITH GRAVE
U+00FA	ú	c3 ba	LATIN SMALL LETTER U WITH ACUTE
U+00FB	û	c3 bb	LATIN SMALL LETTER U WITH CIRCUMFLEX
U+00FC	ü	c3 bc	LATIN SMALL LETTER U WITH DIAERESIS
U+00FD	ý	c3 bd	LATIN SMALL LETTER Y WITH ACUTE
U+00FE	þ	c3 be	LATIN SMALL LETTER THORN
U+00FF	ÿ	c3 bf	LATIN SMALL LETTER Y WITH DIAERESIS

Clean with Mild Detergent and Warm Water

Wipe down the device with a soft cloth dampened with a mild detergent and warm water solution. Do not use any other chemicals for cleaning.

Repairs

Contact Banner Engineering for troubleshooting of this device. **Do not attempt any repairs to this Banner device; it contains no field-replaceable parts or components.** If the device, device part, or device component is determined to be defective by a Banner Applications Engineer, they will advise you of Banner's RMA (Return Merchandise Authorization) procedure.

IMPORTANT: If instructed to return the device, pack it with care. Damage that occurs in return shipping is not covered by warranty.

Contact Us

Banner Engineering Corp. | 9714 Tenth Avenue North | Plymouth, MN 55441, USA | Phone: + 1 888 373 6767

For worldwide locations and local representatives, visit www.bannerengineering.com.

Banner Engineering Corp Limited Warranty

Banner Engineering Corp. warrants its products to be free from defects in material and workmanship for one year following the date of shipment. Banner Engineering Corp. will repair or replace, free of charge, any product of its manufacture which, at the time it is returned to the factory, is found to have been defective during the warranty period. This warranty does not cover damage or liability for misuse, abuse, or the improper application or installation of the Banner product.

THIS LIMITED WARRANTY IS EXCLUSIVE AND IN LIEU OF ALL OTHER WARRANTIES WHETHER EXPRESS OR IMPLIED (INCLUDING, WITHOUT LIMITATION, ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE), AND WHETHER ARISING UNDER COURSE OF PERFORMANCE, COURSE OF DEALING OR TRADE USAGE.

This Warranty is exclusive and limited to repair or, at the discretion of Banner Engineering Corp., replacement. **IN NO EVENT SHALL BANNER ENGINEERING CORP. BE LIABLE TO BUYER OR ANY OTHER PERSON OR ENTITY FOR ANY EXTRA COSTS, EXPENSES, LOSSES, LOSS OF PROFITS, OR ANY INCIDENTAL, CONSEQUENTIAL OR SPECIAL DAMAGES RESULTING FROM ANY PRODUCT DEFECT OR FROM THE USE OR INABILITY TO USE THE PRODUCT, WHETHER ARISING IN CONTRACT OR WARRANTY, STATUTE, TORT, STRICT LIABILITY, NEGLIGENCE, OR OTHERWISE.**

Banner Engineering Corp. reserves the right to change, modify or improve the design of the product without assuming any obligations or liabilities relating to any product previously manufactured by Banner Engineering Corp. Any misuse, abuse, or improper application or installation of this product or use of the product for personal protection applications when the product is identified as not intended for such purposes will void the product warranty. Any modifications to this product without prior express approval by Banner Engineering Corp will void the product warranties. All specifications published in this document are subject to change; Banner reserves the right to modify product specifications or update documentation at any time. Specifications and product information in English supersede that which is provided in any other language. For the most recent version of any documentation, refer to: www.bannerengineering.com.

For patent information, see www.bannerengineering.com/patents.

