R27 - 2 Zone Programmer

Installation Instructions

or use in normal environments



Installation and connection should only be carried out by a qualified person and in accordance with national wiring regulations.

- Before commencing any work on the electrical connections, you must first disconnect the programmer from the mains. None of the 230V connections must be live until the installation has been completed and the housing is closed. Only qualified electricians or authorised service staff are permitted to open the programmer. Disconnect from mains supply in the event of any damage to any buttons.
- There are parts that carry mains voltage behind the cover. The programmer must not be left unsupervised when open. (Prevent non specialists and especially children from gaining access to it.)
- If the programmer is used in a way not specified by the manufacturer, its safety may be impaired.
- Prior to setting the timeswitch, it is neccessary to complete all required settings described in this section.
- Never remove this product from the electrical baseplate. Do not use sharp tools to push any button.





Important: Keep this document


This 2 zone programmer is designed to provide ON/OFF control for 2 zones, with the value added application of in built frost protection.





This programmer can be mounted in the following ways: 1. Directly wall mounted 2. Mounted to a recessed conduit box

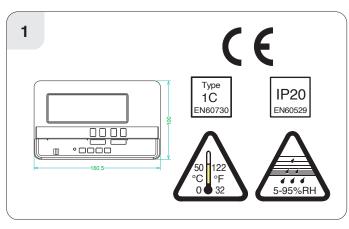


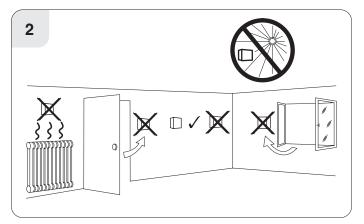

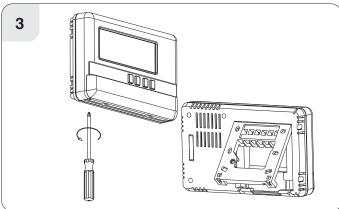

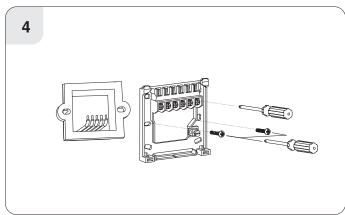

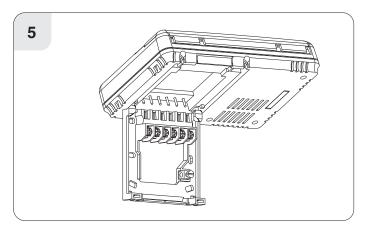

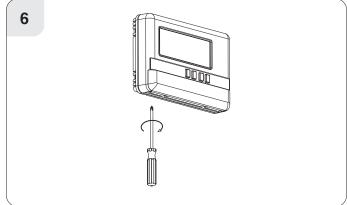



R27 - 2 Zone Programmer

Page 2 of 2

Installation Instructions

For use in normal environments.

Contents

- 1. Factory default settings
- 2. Specifications & wiring
- 3. Master reset



1. Factory default settings



Contacts: 230 Volt
Program: 5/2D
Backlight: On
Keypad: Unlocked
Frost Protection: Off
Clock type: 24 Hr Clock

Day-Light Saving

2. Specifications & wiring

Power Supply: 230 Vac Ambient Temp: 0~35°C Contact Rating: 250 Vac 3A(1A)

Program Memory

backup: 1 year

Battery: 3Vdc Lithium LIR 2032


Backlight: Blue IP rating: IP20

Backplate: British System Standard

Pollution degree 2: Resistance to voltage surge 2000V

as per EN 60730

Automatic Action: Type 1.C Software: Class A



3. Master reset

Lower the cover on the front of the programmer. There are four hinges holding the cover in place.

Between the 3rd and 4th hinges there is a circular hole. Insert a ball point pen or similar object to master reset the programmer.

After pressing the master reset button, the date and time will now need to be reprogrammed.



technical@ephcontrols.com www.ephcontrols.com