

BATTERY-MAX LITE Service Manual

LITE 30.0/ 37.5/ 45.0/ 52.5/ 60.0/ 67.5/ 75.0/ 82.5/ 90.0

Version 1.0



Always make sure to use the latest version of this service manual,
available at: <https://bydbatterybox.com> and www.bydenenergy.com

Content

1. Overview.....	4
1.1. Claim and Contact.....	4
1.2. General Steps.....	5
2. Error Analysis.....	6
2.1. System cannot be turned on/off.....	6
2.2. Indicator is red or off after a period of operation.....	6
3. Frequently Asked Questions.....	7
3.1. WiFi Issues.....	7
3.2. Firmware Update Issue.....	8
3.3. Changes in SOC.....	8
4. Tools and Methods.....	9
4.1. BYD Max Lite Plus (For Battery-Max Lite).....	9
4.2. Faulty module identification.....	10
4.2.1. Single Module Failure.....	10
4.2.2. Communication failure between modules.....	10
4.2.3. Voltage Measurement.....	10
4.2.4. Under-voltage.....	12
Appendix 1 Event and Operation.....	13

1. Overview

This manual is subject to technical revisions, and no responsibility is accepted for the accuracy of this manual.

Before contacting the service team, please read this manual to try to solve the problem. If the problem persists, please contact BYD service team.

Attention: High Voltage! Improper handling can cause danger and damage.

Important Note: The installation and all other kinds of works or measurements related to the battery are only allowed by professional and qualified personnel.

1.1. Claim and Contact

If after completing the inspection with the steps described in this manual or under the guidance of the service team, it is confirmed that there could be a part failure that needs to be resolved by replacement.

If the appearance of the product is damaged, please take photos of the product and the packaging on site and provide them to the service team.

The contact information for the service team is as follows:

Europe	EFT-Systems GmbH
Email	service@eft-systems.de +49 9352 8523999
Telephone	+44 (0) 2037695998 (UK) +34 91 060 22 67 (ES) +39 02 87368364 (IT)
Address	Bruchtannenstr. 28, 63801 Kleinostheim, Germany
Website	www.eft-systems.de

1.2. General Steps

If there is any problem of the battery system, please follow the steps for an initial check.

No.	Inspection items	Inspection steps
1	Settings	Check if the settings are correct. Refer to the latest “Battery-Max Lite Operating Manual” or “Battery-Max Lite Quick Start Guide”, available at: https://bydbatterybox.com and www.bydenenergy.com . Make sure the inverter is configured correctly.
2	External connections	1) Please check if the wrong port is plugged in; 2) Check whether the cable is loose; 3) Check the cable itself for any problems.
3	Latest Firmware	Check if the firmware is the latest, if not, please use the BYD Max Lite Plus to update it.
4	Restart	Note: It is important that the battery system is switched on before the inverter! Otherwise, the PDU might not start and not show any reaction (e.g., no Wi-Fi). (mind the sequence) 1) Switch off the inverter; 2) Switch off the air switch on the PDU 3) Press the LED button on the PDU for 5 seconds 4) Rotate the handle switch 90° counterclockwise; 5) Wait at least 3 minutes; 6) Rotate the handle switch 90° clockwise; 7) Press the LED button on the PDU for 3 seconds 8) Switch on the air switch on the PDU 9) Switch on the inverter.
5	Check if the system operates properly	The system runs properly if : - Inverter displays battery SOC correctly; - System charges/discharges. Note: If you cannot complete the commissioning, then turn off the battery before you leave the site. If it is not possible, remove the PDU and then close the cabinet. After that, contact the service team.
6	Black start	1) If you are not sure if the fault is from the battery system or external circuits, you can try a black start by disconnecting all external cables, and restart the system, after the battery is on, press the button again for 3 seconds.

2. Error Analysis

If a fault occurs, the indicator on the cabinet will be red; if the indicator is green, it means the battery is working properly.

2.1. System cannot be turned on/off

- 1) PDU shows no reaction.
 - a. If you are commissioning the battery, but Wi-Fi is not detected and the indicator on the cabinet does not turn on, please try to restart the system in the correct sequence (refer to Step 4 in **1.2**).
 - b. If the problem persists, please refer to **4.3** to check the voltage. If the voltage is normal, try another PDU if available.
 - c. If the voltage is abnormal, please refer to the events on BYD Max Lite Plus to identify the faulty module.
- 2) The relay trips immediately after battery is powered on.

No.	Inspection items	Inspection steps
1	Wiring	1) Try to black start.. 2) If it works, check if the inverter is short-circuited; If the problem persists, proceed to the next step.
2	Voltage	Refer to 4.3 for the voltage check: 1) If the voltage is abnormal, identify the faulty module referring to the events on BYD Max Lite Plus. 2) If the voltage is normal, try another PDU if available.

- 3) The system can not be turned off.

If you cannot turn off the system. The indicator will become solid red and green at the same time to show the system cannot be switched off. Please try another PDU if available.

2.2. Indicator is red or off after a period of operation

Restart the system in the correct sequence:

- 1) If successful:
 - a. If events appear on the BYD Max Lite Plus, please refer to Appendix 1 for more details.
 - b. If not, please download the logs and send them to BYD service team. Repair under the guidance of the service team.

(Sporadic alarms can be difficult to detect because they only occur occasionally. Therefore, it is very important to download and provide all historical battery log files available to find the root cause.)

- 2) If failed: Refer to **2.1**.

3. Frequently Asked Questions

3.1. WiFi Issues

Common WiFi failures: no Wi-Fi signal / unstable WiFi / unable to connect to WiFi.

When these failures occur, follow the steps below:

1) Disconnect LAN cable

Remove the LAN cable when your device is connecting to the Wi-Fi. After that you can connect it again to the Internet.

2) Try other mobile devices

Sometimes the problem comes from the mobile device itself, try to see if other mobile devices can connect to the Wi-Fi.

3) Reset the WiFi

Press the LED button three times (each time around one second) within six seconds could reset the Wi-Fi.

4) Restart the system

Restart the system in the correct sequence (refer to Step 4 in **1.2**).

5) Replace the WiFi unit

If none of the steps above work, please replace the WiFi unit on PDU.

3.2. Firmware Update Issue

1) Fix WiFi

If it is caused by unstable WiFi, please refer to 3.1.

2) Restart

Restart the system in the correct sequence.

3) Try again with other laptop or mobile phones.

Sometimes the problem comes from the laptop computer or the mobile device itself, try to see if other devices can finish the update.

4) Replace the PDU

If none of the above steps work, please try another PDU if available.

3.3. Changes in SOC

1) SOC jumps

The SOC of a battery cannot be measured. It is an estimated value. In general, the state of charge (SOC) of a battery is estimated using the voltage, but other factors such as temperature, current flow and charging behavior also play a role. The calculation of the SOC is generally more precise if the battery regularly sees full cycles. It is normal to have a SOC correction/calibration once in a while, e.g. every month.

2) SOC at commissioning

New modules have 30% SOC upon delivery. A new PDU might show a different SOC at the beginning (mostly 30%). However, this is only to be understood as a placeholder value, as a new PDU cannot measure the SOC of modules. As soon as the system starts to run (charge/discharge), the SOC is corrected gradually. The SOC calibration is completed after the latest full cycle.

4. Tools and Methods

4.1. BYD Max Lite Plus (For Battery-Max Lite)


With the BYD Max Lite Plus you can:

- 1) read the battery information;
- 2) update firmware;
- 3) export / download battery logs.

The BYD Max Lite Plus is constantly being improved and updated. Make sure to use the latest version of the program.

For the service analysis, please download and provide the data / logs as described in the program instructions.

Note: You need a Windows computer that can connect to the battery WiFi.

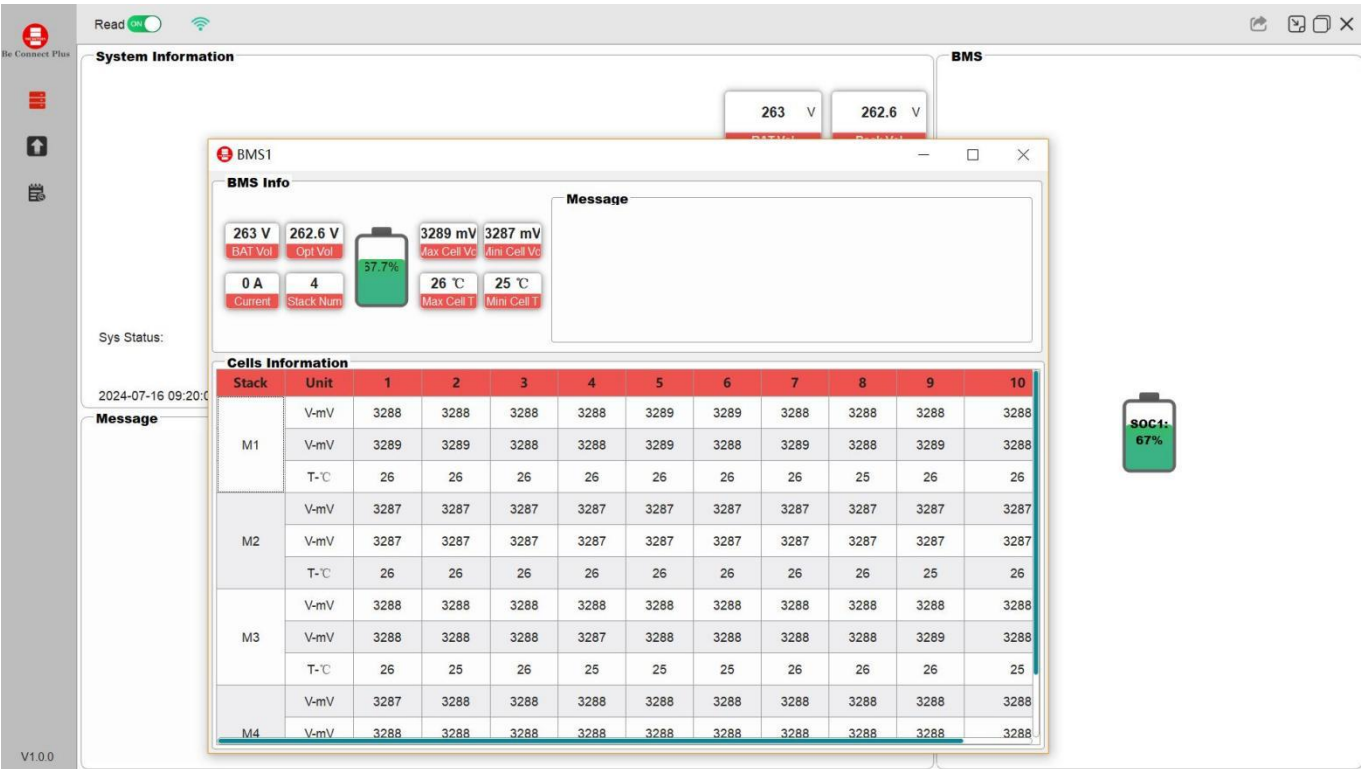

4.2. Faulty module identification

4.2.1. Single Module Failure

When a module failure occurs, you can view the number of the failed module through BYD Max Lite Plus.

4.2.2. Communication failure between modules

When the BYD Max Lite Plus indicates that a communication failure has occurred between modules, there may be a communication failure in this module or in the module below it.

Try removing both modules separately to determine the which is fault. If the BYD Max Lite Plus shows that module 1 has a communication failure, it may be caused by PDU or module 1. You can remove module 1 and restart the system to check whether the system can operate normally, if not, please try another PDU.

4.2.3. Voltage Measurement

ATTENTION: High voltage!

You can see the max./min. cell voltage in the BYD Max Lite Plus. You can also get the detailed voltage of the modules and cells in the BYD Max Lite Plus or measure it manually according to the below description:

Measurement of Tower Voltage

Disconnect the PDU and measure the tower voltage between the B+ and B- for the entire cabinet.



B+ and B- of tower voltage



Measurement of tower voltage

Measurement of Module Voltage

Note: The nominal voltage for per module is 64.8V~88.8V



Individual module measurement



Multiple Module Measurement

If the measured voltage of the tower deviates from the nominal value, please check the voltage of the individual modules

4.2.4. Under-voltage

A module in which one of the cells has a voltage of <1.5 V is in undercharged (check with BYD Max Lite Plus if possible).

A LITE module with >64.8 V should be fine and you can continue to check other points according to the service manual. Always make sure the version of firmware is the latest! If the module voltage is <64.8 but the single cell voltage is >1.5 V, the battery needs to be charged as soon as possible.

If only one module is in under-voltage: remove that module and try to start the system without it (if the number of the remaining modules still meets the requirement of minimum number of modules). Otherwise, make sure to avoid further discharge (e.g., remove PDU)

If more than one, or all modules are in under-voltage: Contact the service team and make sure to avoid any further discharge of the battery (e.g remove PDU from the system)

When contacting the service team, make sure to fill the service checklist completely and add the following information:

- 1) Serial Numbers of the PDU and all (affected) modules;
- 2) Tower voltage and individual module voltages of all modules (with respect to the Serial Number)
- 3) Detailed description of how and why the system reached under-voltage if known. Information of when the system was installed and commissioned and in which circumstance and when the under-voltage occurred. If the battery was never running before: Why did it never work before, and what was the status of the battery when the battery was left (on / off / Display).
- 4) If possible: Logs from the battery using BYD Max Lite Plus showing the cell voltages and Initial Firmware Version of the Battery when under-voltage occurs.

Appendix 1 Event and Operation

Events	Possible Cause	Operation
Incorrect module number	Different number of modules in a parallel-connected system	Make sure that the number of modules in a parallel-connected system are the same
Cabinet door not closed	Battery cabinet door is open	Check whether the cabinet doors are completely closed. If not, close the doors completely.
No.# Module Failures	Failure within the modules	The number in front of ‘#’ represents the number of the faulty module, please replace the faulty module corresponding to the number.
No.# Fan Failure		1) Check if the cables of the fans are normal. If no, replace the cables. If yes, proceed to the next step
	1) Fan Failure of Module	
	2) Fan communication failure	2) Check if the fans are faulty. If yes, replace the fans. If no, proceed to the next step.
	3) Abnormal power supply from PDU to fan	3) If all the fans do not turn on, please check if the AC switch is on.
Internal communication failure	1) Internal CAN communication fault.	1) Check if the terminal resistor is in place
	2) BMU and BMS communication failure	2) For multiple tower systems, check whether the communication cable between towers is faulty. If cables are normal, exchange the PDUs of the master and slave towers and check if the PDUs are faulty.
	3) Communication interface failure	
	4) Address assignment failure	3) For a single tower system, try another PDU if available.

Events	Possible Cause	Operation
Communication failure between modules	one or more modules are not recognized	Please refer to 4.2.2
Communication failure with the inverter	1) The match test with the Inverter has not started or completed	1) Check if the external connections (Communication cables/Ground cables) are normal. 2) Restart in correct order.
	2) Communication cable failure between battery and inverter Wrong type of battery/inverter is set in the BYD Max Lite Plus	3) Re-upgrade the firmware. 4) Measure the CAN output of the PDU with a multimeter, if the output voltage is normal, then troubleshoot the inverter; if the output is 0, then replace the PDU.
Insulation failure	1) Ground cable not connected	1) Check the ground cable (ground cable of battery and inverter should be connected separately)
	2) Ground cable fault	
	3) Module Leakage	2) Restart, if the problem persists, contact BYD service
	4) PDU leakage	
Pre-charge failure	The output voltage of the battery differs from the tower voltage by more than 5V.	1) Check whether the power cable connection is correct (if correct, proceed to the next step; if incorrect, then connect the power cable correctly).
	1) DC connection faults	2) Restart, if the problem persists, try another PDU if available.
	2) Inverter DC side short circuit	
	3) PDU main circuit failure	

Events	Possible Cause	Operation
Pre-charge not completed	1) Inverter failure that prevents the battery from pre-charging it.	1) Restart
	2) PDU fault	2) If the problem persists, turn off the battery and disconnect all the power cables from the inverter, black start the battery. a) If the problem persists, replace the PDU; b) If the problem disappears, check the connection of power cables between the battery and the inverter.
Pack V-sensor alarm	Difference between tower voltage and output voltage is more than 5V.	1) Disconnect external electrical connections and restart. 2) If the problem disappears, please check the electrical connections. If problem persists, check if the fuse in the PDU is blown. 3) If the fuse is blown, replace the fuse. If it's normal, try another PDU if available.
Over current occurs in charging/discharging	1) The charging/discharging power is too high and the inverter fails to limit the charging/discharging current in time. 2) Unknown reasons	Check whether there is a high-power load starts when this fault occurs. If yes, check whether the load power is within the power range of the inverter: If yes, reduce the loads to ensure that the power is within the range. If not, please contact the service team of the inverter
Over/under temperature in charging/discharging	Unknown reasons	Please contact BYD Service

Events	Possible Cause	Operation
Parameter Abnormal	Data loss when loading parameters	Restart, If problem persists, upload battery logs and contact BYD service
Current sensor alarm	1) When the SOC is 0% or 100%, there is still discharge/charge current in the system. 2) Current value exceeds system limit.	Upload battery logs and contact BYD service
DC switch abnormal	Handle switch is off	Restart, if the problem persists, try another PDU if available.
Relay abnormal	Positive or negative relay disconnected	Restart, if the problem persists, try another PDU if available.
Memory Abnormal	Memory chip fault	Restart, if the problem persists, try another PDU if available.
Chip Function Alarm	Chip running lagging	Restart, if the problem persists, try another PDU if available.

Events	Possible Cause	Operation
Fire Alarm	1) Smoke or overheating is detected in the battery cabinet 2) A fire has been detected in the battery cabinet. 3) System misstatement	For Cause 1
		1) Send trained personnel to the site and observe the system for 30 minutes from a safe distance. If there is smoke or fire, remotely power off the system from AC, evacuate the onsite personnel as soon as possible, and contact the fire extinguishing department.
		2) If no exception is found during observation, manually clear the alarm by restarting the system. If the alarm persists, contact BYD Service.
		For Cause 2
Air Conditioner Alarm	1) Communication cable of the Air Conditioner fails. 2) Air conditioner failure.	Do not open the cabinet doors. Evacuate the onsite personnel, and contact BYD Service.
		For Cause 3
		Restart the system, if the fault persists, then contact BYD Service
Air Conditioner Alarm	1) Communication cable of the Air Conditioner fails. 2) Air conditioner failure.	Restart, if the problem persists, try another communication cable.
		If the problem still persists, please refer to the Air Conditioner Troubleshooting Method (Scan the QR code on the air conditioner to get)

Events	Possible Cause	Operation
Air conditioning sensor malfunction	1) Loose sensor or wiring 2) Faulty sensor	1) Check whether each temperature sensor is connected loosely and whether the position is correct. If the re-plugging does not work, the sensor is considered damaged and needs to be replaced. 2) If it is not solved, contact BYD service.
Air conditioner voltage abnormal	1) Unstable voltage 2) Cable failure 3) Abnormal power supply detection	1. Confirm that the power cable of the air conditioner is connected correctly. 2. Turn off , measure whether the input voltage exceeds the specified range, if the voltage exceeds the specified range, you need to adjust the voltage; if the voltage is normal, then the next step. 3. Replace the control board, restart to confirm if problem persists. 4. If the problem is not resolved with the above steps, contact BYD Service.
Air conditioning temperature abnormal	1) Temperature sensor failure 2) Condenser blocked	1) Check if there are other faults on the display of the Air Conditioner, if so, proceed with other faults first. 2) Check the value of the temperature sensor in the cabinet (after being stationary for ten minutes) on the display screen of the Air Conditioner to see if it is consistent with the ambient temperature. If it is consistent, the sensor is not faulty. If the temperature deviation is large, check whether the condenser is blocked. If it is blocked, clean the condenser. 3) If the fault is not resolved, contact BYD Service.

Events	Possible Cause	Operation
Air conditioning system abnormal		1. Clean the condenser
	1. Condenser is blocked	2. Clean the air inlet
	2. Air inlet is blocked	3. If the ambient temperature is too high, add a sunshade
	3. Ambient temperature is too high	4. Replace the blower
	4. Blower is abnormal	5. If the problem is not resolved with the above steps, contact BYD Service
Evaporator abnormal		1. Clean the air inlet/outlet
	1. The air inlet/outlet is blocked	2. Replace the blower
	2. The blower is abnormal	3. If the problem is not resolved with the above steps, contact BYD Service.
Blower abnormal		1. Check whether the cable of the internal/external blower is normal
	1. The cable of internal/external blower is loose	2. If the cable is normal, replace the internal/external blower
	2. Internal/external blower is damaged	3. If the problem is not resolved with the above steps, contact BYD Service.
Compressor abnormal		1. Check the cable of compressor
	1. The cable of compressor is loose	2. Clean the condenser
	2. The condenser is blocked	3. If the problem is not resolved with the above steps, contact BYD Service.