



Mircom MIX-M500MAPA Monitor Module Instruction Manual

[Home](#) » [Mircom](#) » Mircom MIX-M500MAPA Monitor Module Instruction Manual 

Mircom MIX-M500MAPA Monitor Module



Contents

- 1 Specifications
- 2 Before Installing
- 3 General Description
- 4 Compatibility Requirements
- 5 Controls and Indicators
- 6 Mounting
- 7 Wiring
- 8 Typical 2-wire initiating circuit configuration, NFPA Style B
- 9 Typical 4-wire fault tolerant initiating circuit configuration, NFPA Style D
- 10 Customer Support
- 11 Documents / Resources
 - 11.1 References
- 12 Related Posts

Specifications

- **Normal Operating Voltage:** 15 to 32 VDC
- **Maximum Alarm Current (LED on):** 5.0mA (LED on)
- **Average Operating Current:** 400 μ A, 1 communication every 5 seconds, 47k EOL
- **EOL Resistance:** 47K Ohms

- **Maximum IDC wiring resistance:** 40 Ohms
- **Maximum IDC Voltage:** 11 Volts
- **Maximum IDC Current:** 400 μ A
- **Temperature Range:** 32°F to 120°F (0°C to 49°C)
- **Humidity:** 10% to 93% Non-condensing
- **Dimensions:** 4 1/2" H x 4" W x 1 1/4" D (Mounts to a 4" square by 2 1/8" deep box.)
- **Accessories:** SMB500 Electrical Box

Before Installing

This information is included as a quick reference installation guide. Refer to the control panel installation manual for detailed system information. If the modules will be installed in an existing operational system, inform the operator and local authority that the system will be temporarily out of service. Disconnect power to the control panel before installing the modules.

NOTICE: This manual should be left with the owner/user of this equipment.


General Description

The MIX-M500MAPA Monitor Module is intended for use in intelligent, two wire systems, where the individual address of each module is selected using the built-in rotary decade switches. It provides either a 2-wire or 4-wire fault tolerant initiating circuit for normally open contact fire alarm, supervisory, or security devices. The module has a panel controlled LED indicator.

Compatibility Requirements

To ensure proper operation, these modules shall be connected to listed compatible system control panels only.


Controls and Indicators

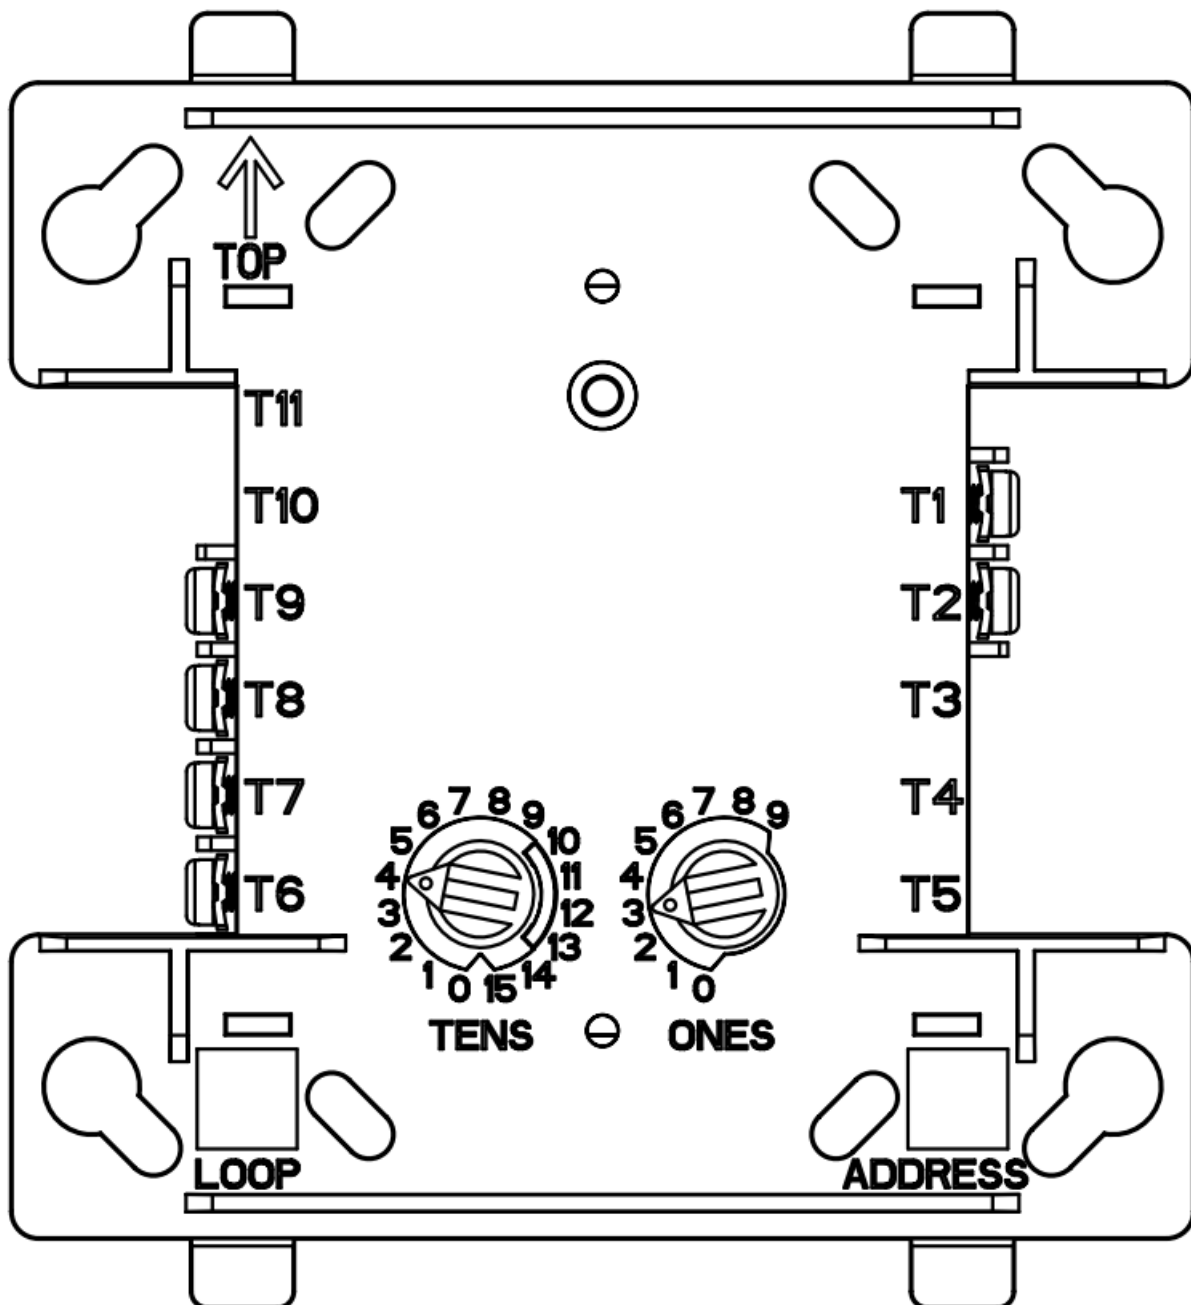

Mounting

The MIX-M500MAPA mounts directly to 4-inch square electrical boxes (see Figure 2). The box must have a minimum depth of $2\frac{1}{8}$ inches. Surface mounted electrical boxes (SMB500) are available from Mircom.

- Module mounting

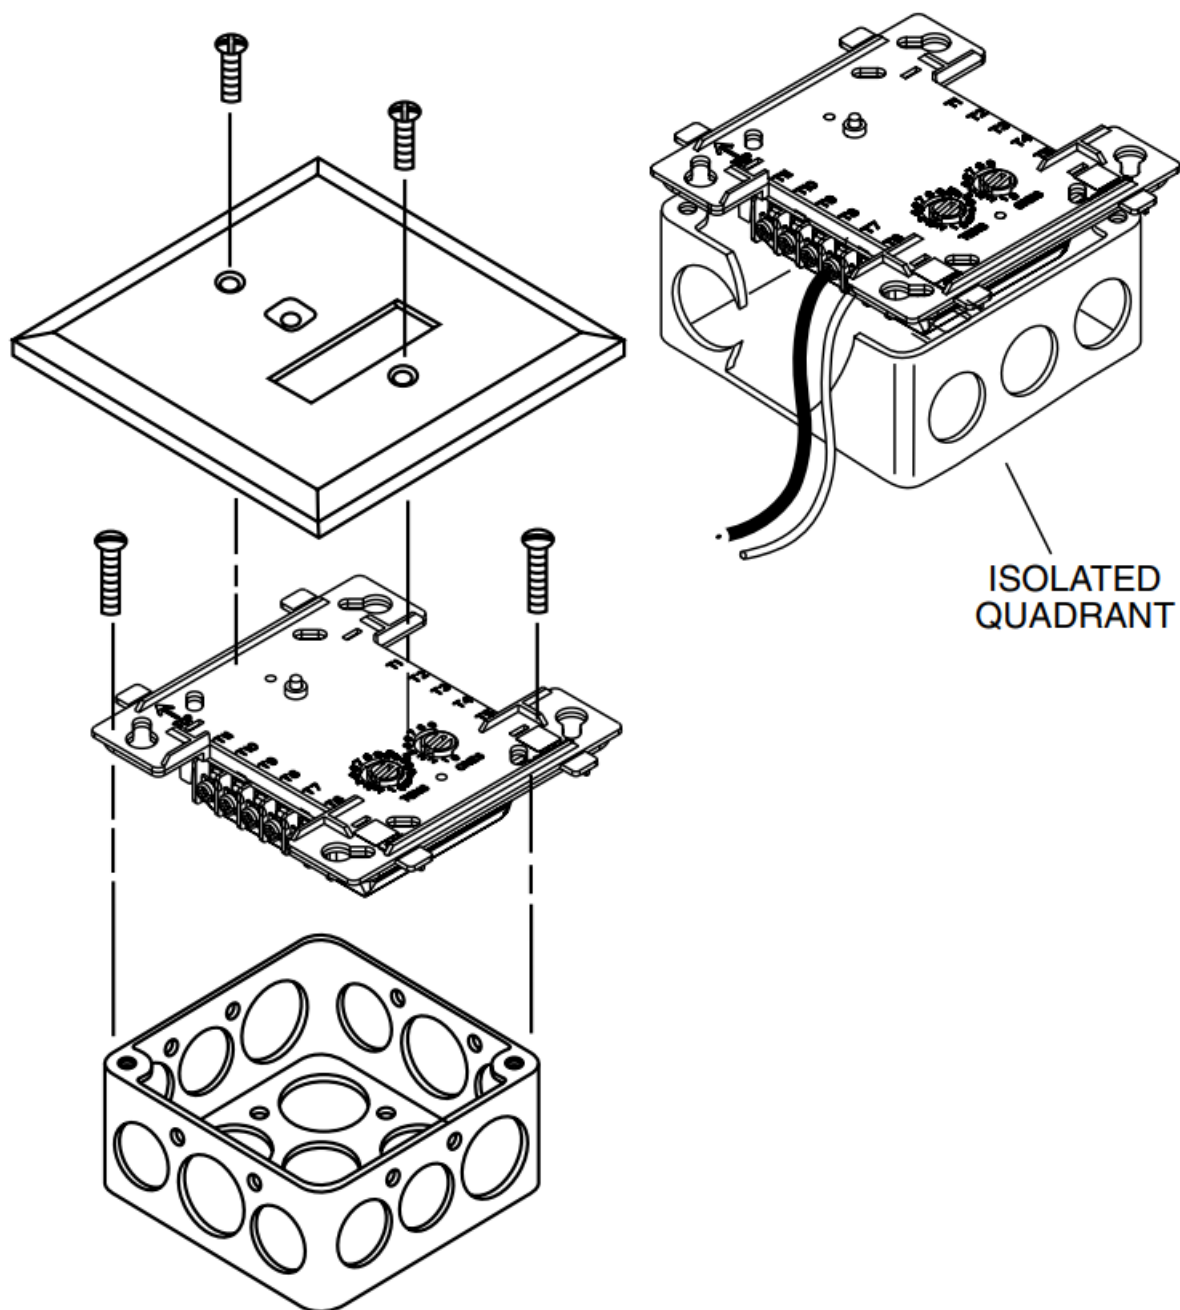


Wiring


NOTE: All wiring must conform to applicable local codes, ordinances, and regulations. This module is intended for power limited wiring only.

1. Install module wiring in accordance with the job drawings and appropriate wiring diagrams.
2. Set the address on the module per job drawings.
3. Secure module to electrical box (supplied by installer), as shown in Figure 2.

Typical 2-wire initiating circuit configuration, NFPA Style B

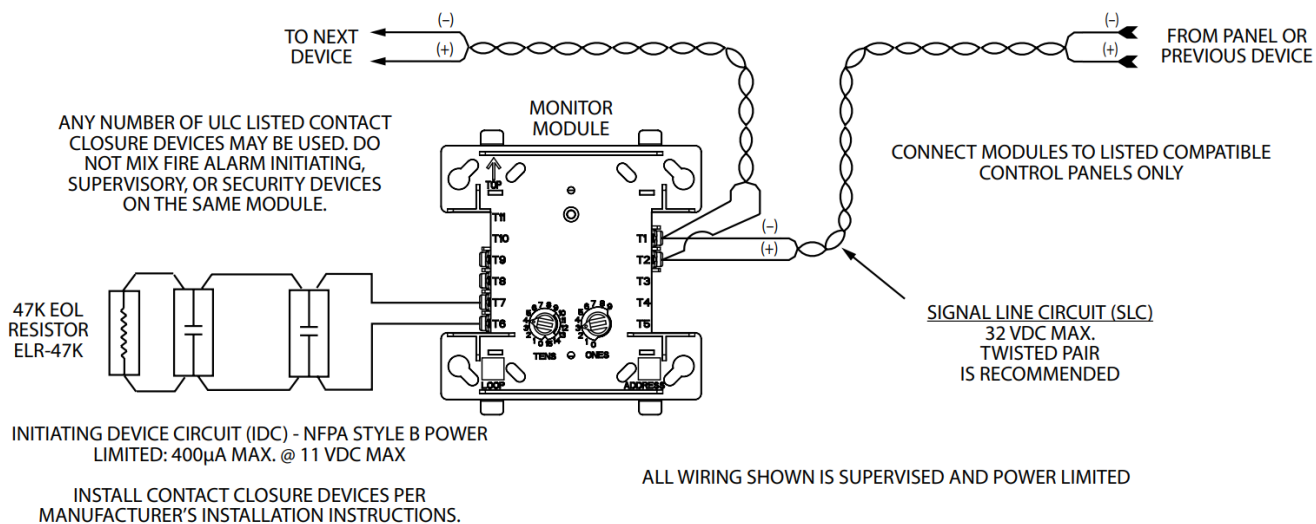

Typical 4-wire fault tolerant initiating circuit configuration, NFPA Style D

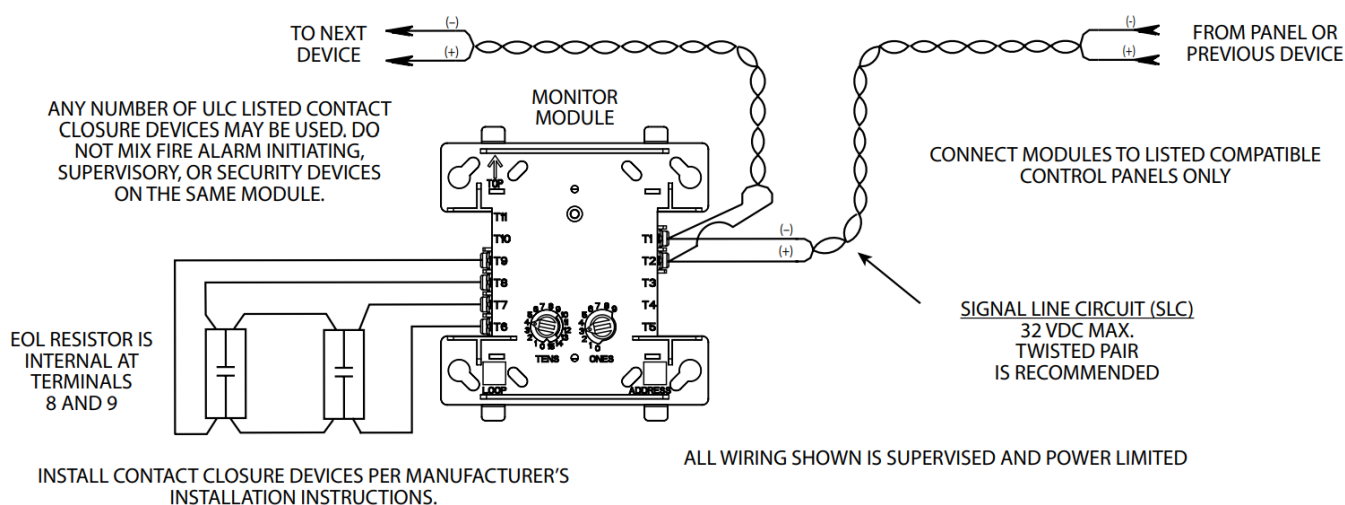

Customer Support

firealarmresources.com



Documents / Resources

	<p>Mircom MIX-M500MAPA Monitor Module [pdf] Instruction Manual MIX-M500MAPA, Monitor Module, MIX-M500MAPA Monitor Module, Module</p>
--	--

References

-  [Fire Alarm Resources | Download fire alarm documents](#)

Manuals+.