



Moray

ME201WZ Wireless level sensor
Manual V2.0



Contents


- [1 Definition](#)
- [2 Connection](#)
- [3 Setting](#)
- [4 APP Interface](#)
- [5 Installation](#)
- [6 Multi-Tank Monitoring](#)
- [7 Documents / Resources](#)
 - [7.1 References](#)

Definition



*** Gateway self prepared**

Wifi: Between sensor and router(max 50m no obstacle)

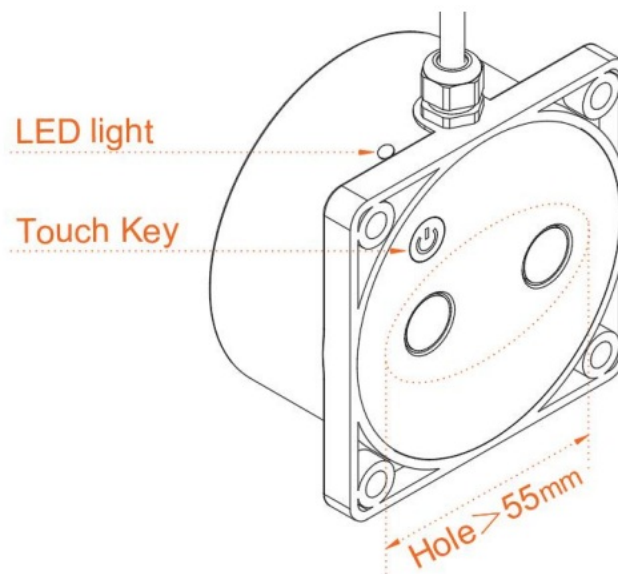

Touch Key (⏻): Press 5 seconds for WiFi connection

LED: Zigbee status

Zigbee Config: Led light flashes

Zigbee Connected: Led light on

Zigbee Not Connected: Led light off

Adaptor: AC 110V~240V

Sensor power supply: $\leq 100\text{mA} @ 5\text{V DC}$

Network mode: Zigbee 3.0

Level Range: 0.1m 4m

Accuracy: $\pm 0.02\text{m}$

Operation Temperature: $-20^{\circ}\text{C} \sim 70^{\circ}\text{C}$

Protection: IP65

Connection

1. Power on the AC/DC ADAPTOR first, and then power on the sensor.
2. Scan code to download “TUYA Smart APP” or “Smart Life APP” on mobile device.




<https://smartapp.tuya.com/tuyasmart>


7. Network Reset

Press and hold the button for 5s, the led light flashes rapidly, then release the button, the network reset, the device connect to the network automatically.

8. Connecting Sensors to APP.

Turn on the WiFi and Bluetooth of your phone, enter the app and add device.

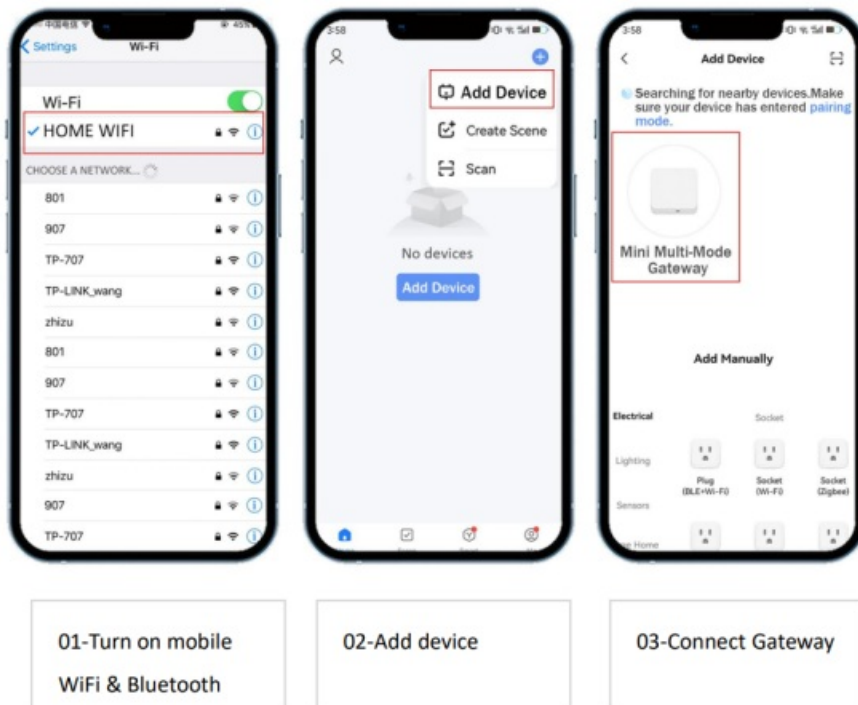

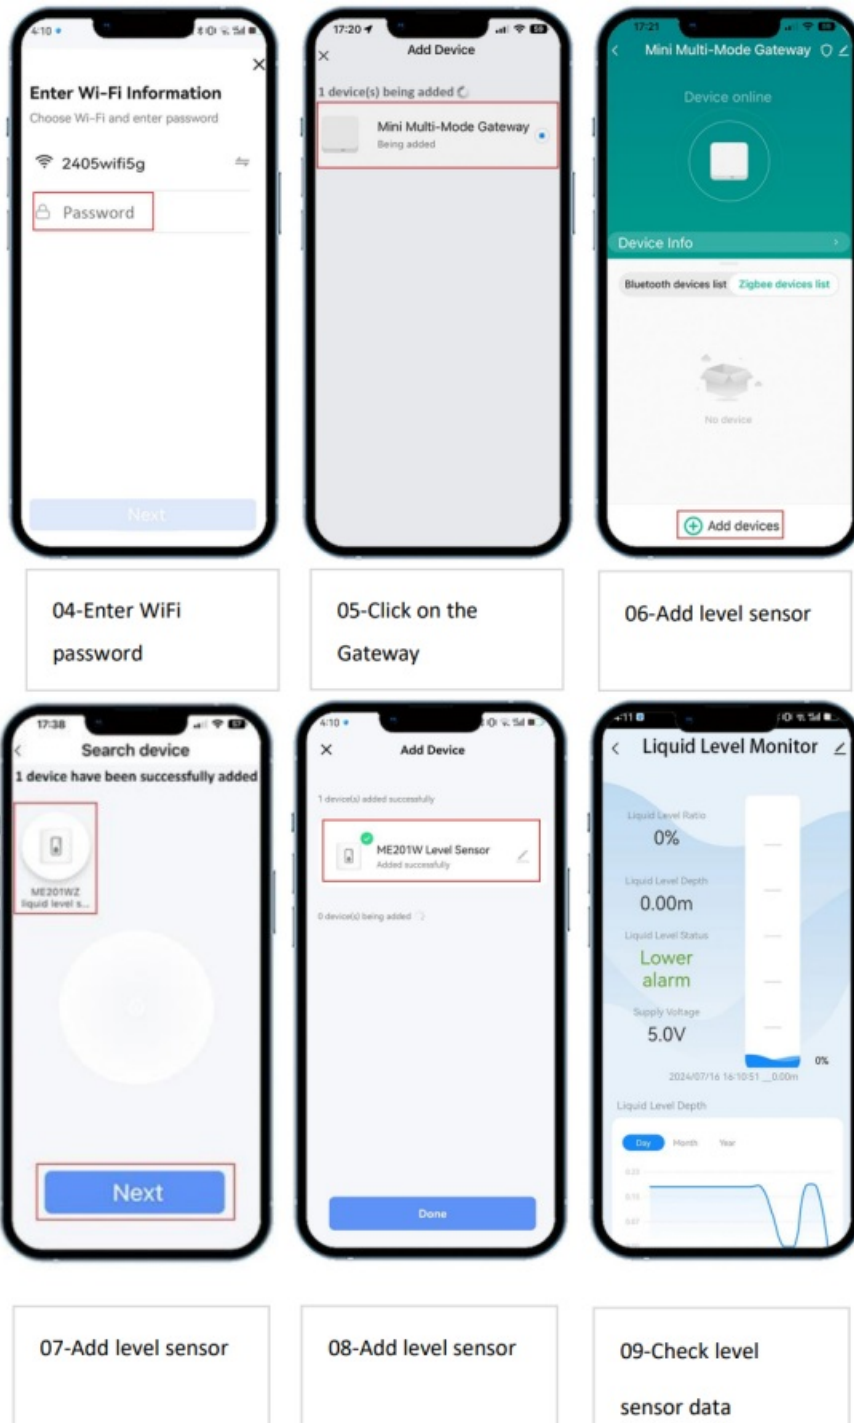


***Note:**

1. Zigbee 3.0 can only be Tuya Gateway;
2. When adding a device, make sure that the sensor and the phone are connected to the same WiFi. After the setting is complete, the indicator must work under steady light. If the phone cannot find the device or fails to connect to the device, hold down the button for 5s until the indicator flashes to add the device again.


Setting

1. Installation height: Set the distance from sensor to tank bottom (A)
2. Liquid maximum depth: Maximum height of liquid in tank (B);
3. Set Max: Set Max for high level alarm (Actual liquid level value C);
4. Set Min: Set Min for low level alarm;

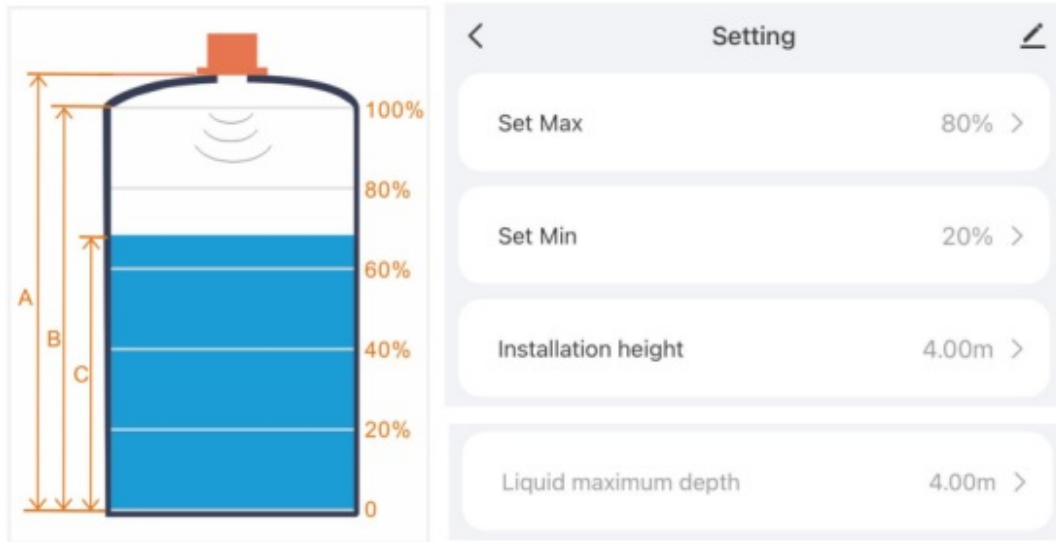

e.g.
Installation height, A=4m;
Liquid maximum depth, B=3m;
Actual liquid level value, C=2m;
Set Max=60%, Set Min=20%,
Level Status: Full alarm ($C/B \times 100\% = 2/3 \times 100\% = 67\%$)

APP Interface

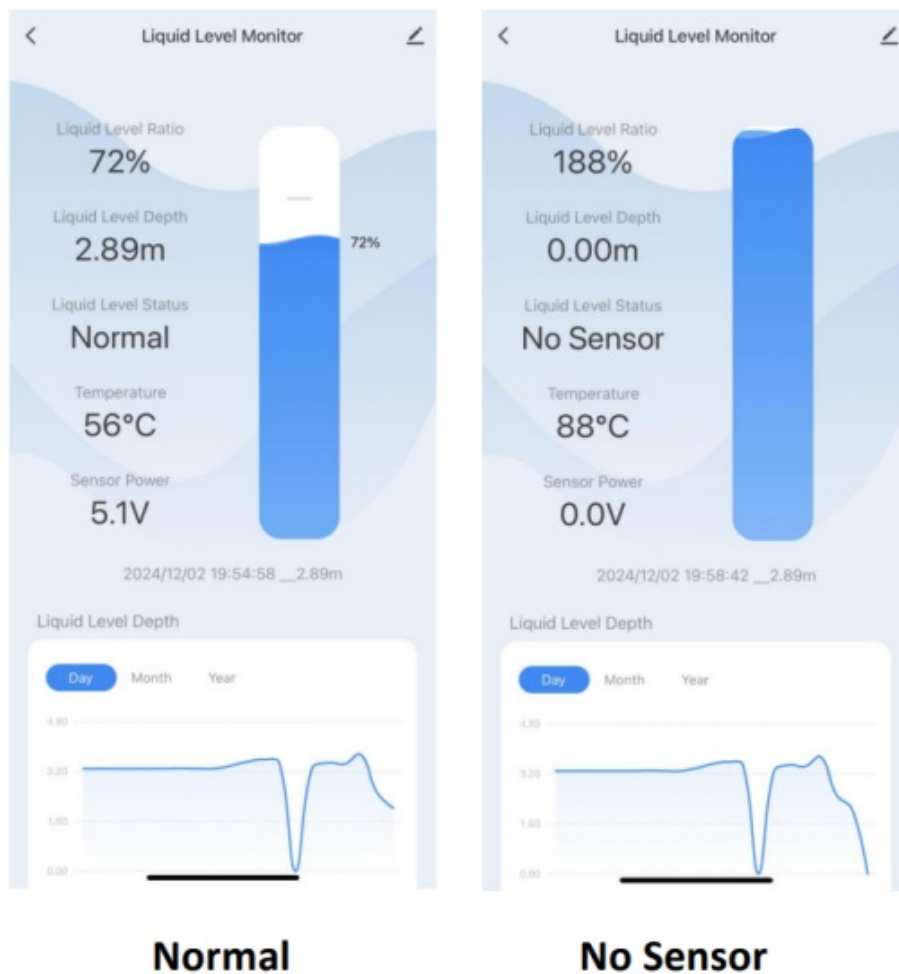



Full Alarm




Low Alarm


Installation

1. Remove the release paper from the gasket, and attach the gasket to the center of the tank where the hole will be drilled.
2. Drill a hole right in the middle of the tank with a diameter of >55mm;
3. Place the sensor over the gasket, Keeping it aligned with the screw holes. unobstructed;
4. Fasten the sensor with a self-tapping screw.


*Note: If the mounting surface is curved, it is sufficient to fix the sensor with screws just, prevent the sensor from being stressed; when the data is abnormal, the screws must be loosened.

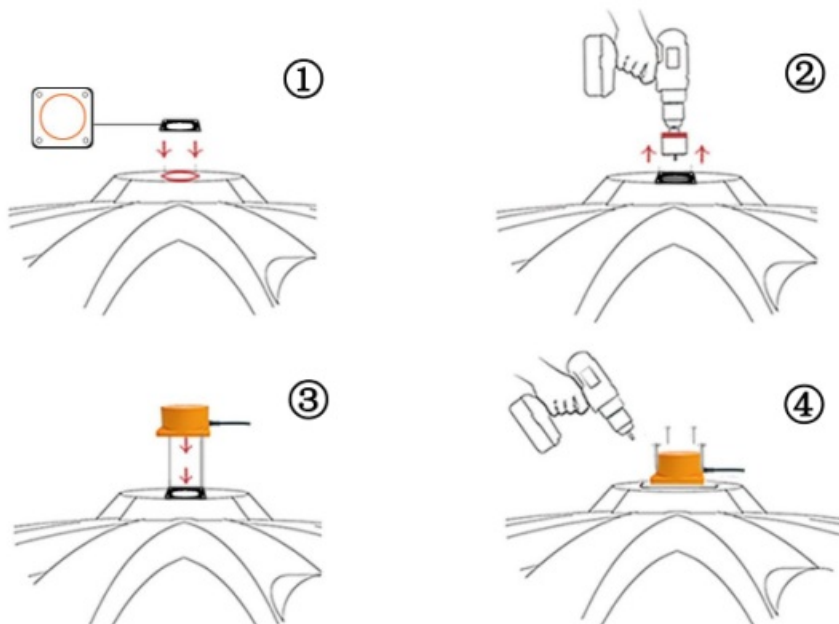


- ☒ Hold the sensor perpendicular to the liquid

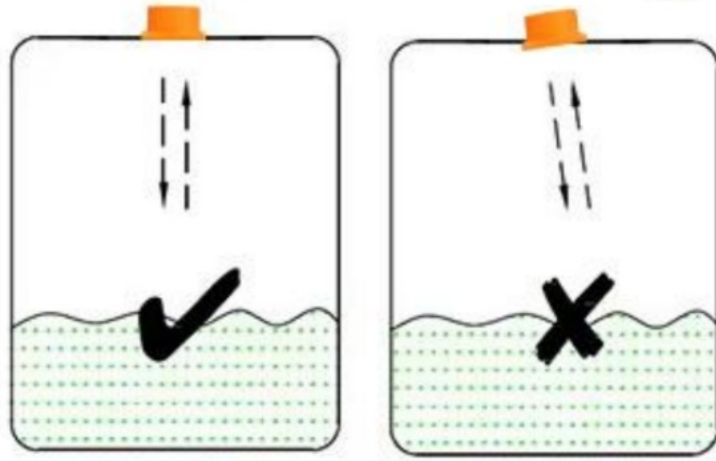


- ☒ Install the sensor away from the water inlet to avoid pseudo-echo

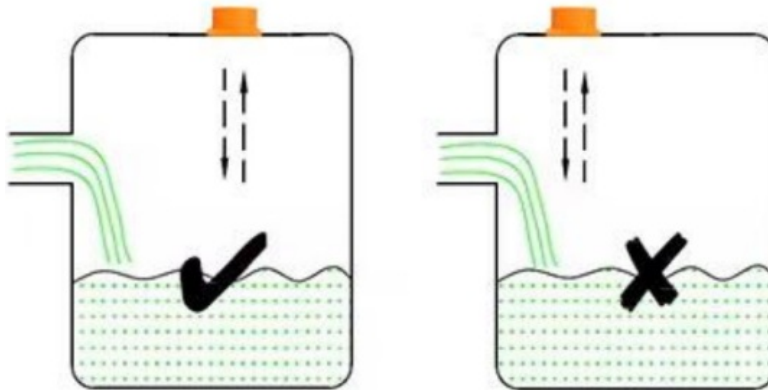

- ☒ The sensor installation cannot be close to the bulkhead, otherwise it will cause a strong pseudo-echo

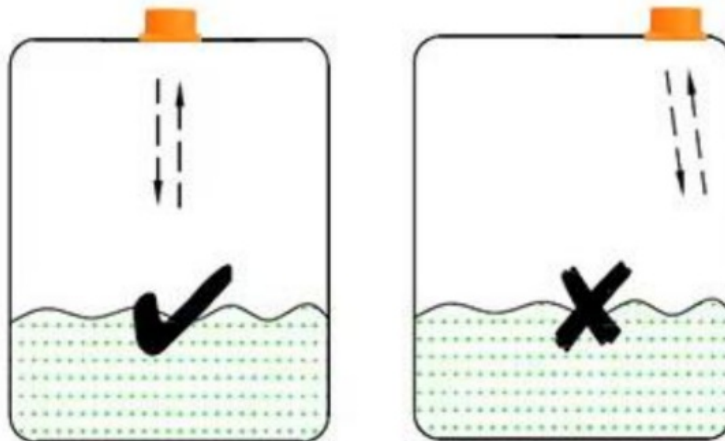

Multi-Tank Monitoring

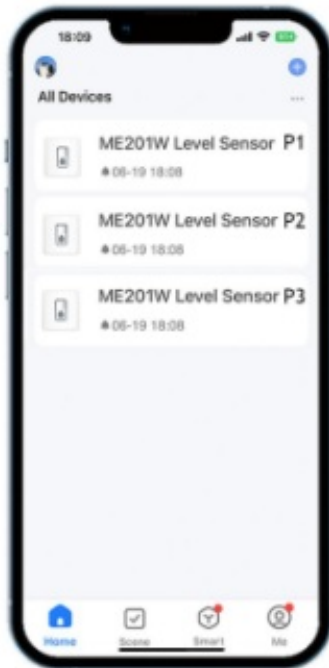

Moray

Documents / Resources



[Moray ME201WZ Wireless Level Sensor \[pdf\] User Manual](#)

ME201WZ, ME201WZ Wireless Level Sensor, ME201WZ, Wireless Level Sensor, Level Sensor , Sensor

References

- [User Manual](#)

[Manuals+](#), [Privacy Policy](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.