

neo•PURE™

SS-10 Anti-Scale System with Hydroblend Stick



neo pure SS-10 Anti Scale System with Hydroblend Stick Installation Guide

[Home](#) » [neo PRe](#) » neo pure SS-10 Anti Scale System with Hydroblend Stick Installation Guide 

Contents

- [1 neo pure SS-10 Anti Scale System with Hydroblend Stick](#)
- [2 Specifications](#)
- [3 FAQs](#)
- [4 installation and User Guide](#)
- [5 Features](#)
- [6 Operation Recommendations.](#)
- [7 Kit Includes](#)
- [8 Installation Precautions](#)
- [9 Replacement Cycle:](#)
- [10 Documents / Resources](#)
 - [10.1 References](#)

neo•PURE™

neo pure SS-10 Anti Scale System with Hydroblend Stick



Specifications

- Product Name: ScaleStick SS-10 with HydroBlend Cartridge
- Application: Prevents limescale build-up and provides corrosion protection for various water-fed equipment
- Compatibility: Coffee and espresso machines, dishwashers, tankless water heaters, ice machines, reverse osmosis systems, distillers, misting systems, instant hot water dispensers
- Fit: Standard 10 Housings
- Certification: NSF Certified to meet NSF/ANSI Standard 42 for material requirements

FAQs

How often should I replace the ScaleStick SS-10 cartridge?

The replacement frequency depends on water usage. Monitor the media level and replace it when it is nearly depleted.

Is deliming equipment necessary before installing the ScaleStick SS-10?

Deliming equipment is recommended but not required. It is advised to remove any loose scale before installation.

Installation and User Guide

The ScaleStick SS-10 w/ HydroBlend Cartridge prevents limescale build-up while providing corrosion protection for water-fed equipment including coffee and espresso machines, dishwashers, tankless water heaters, ice machines, reverse osmosis systems, distillers, misting systems, instant hot water dispensers. Fits in a Standard 10" Housings.

Features

HydroBlend The SS-10 features the Hydroblend compound, which is a unique blend that inhibits mineral scale deposits and provides corrosion protection in water-fed equipment. HydroBlend is unaffected by high temperatures, unlike standard scale control additives like polyphosphates. The SS-10's patented design dispenses a controlled amount of HydroBlend for long-term protection and greater effectiveness than other standard treatments.

Operation Recommendations.

It is possible for the pre-existing scale in your equipment to come loose and clog downstream equipment. Please remove any loose scale before installing the ScaleStick SS-10. Deliming your equipment prior to use is recommended, but it is not required. It is best practice to inspect the ScaleStick cartridge every 6 months. The SS-10 should be replaced before the HydroBlend is completely dissolved.

NSF Certified

This filter has been certified by NSF International to meet NSF/ANSI Standard 42 for material requirements only.


Kit Includes

Number	Description	Qty
1	Scale Stick 10	1
2	NP 10" Standard Housing w/PR 3/4 FPT Blk / Clear	1
3	Mounting Bracket for STD housings	1
4	Male adapters 3/4 CTS x 3/4 NPT	2
5	Housing Wrench	1
6	Screws to mount cap on the bracket	4
7	Teflon Tape	1



Installation Precautions


- Install on cold water line only. The maximum temperature for the housing and ScaleStick is 100 F
- Do not install where the unit could freeze
- Maximum pressure is 90 psi
- Scale Stick is good for flow rates up to 6 gpm

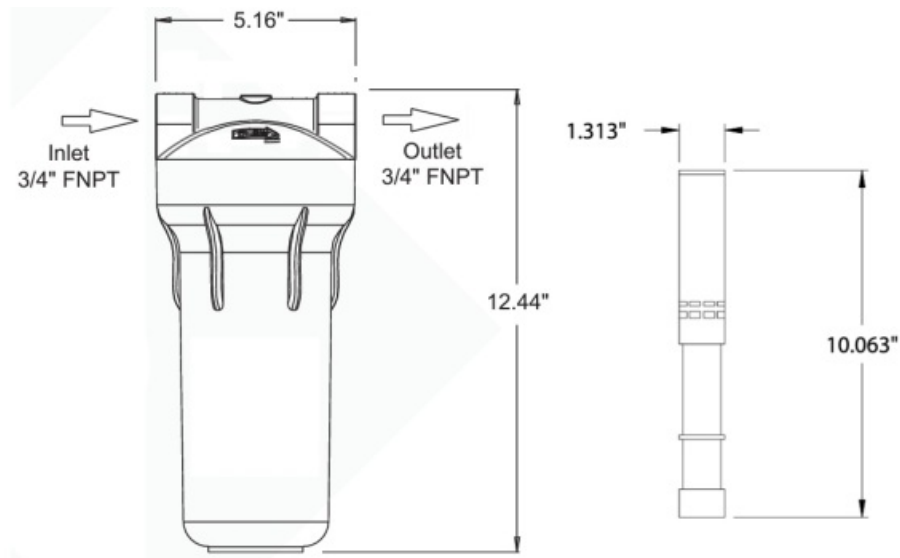

Installation Steps


1. Locate a spot where the filter housing will be accessible and replacing the cartridge will be easily accomplished. Make sure you will have 6-10" of vertical clearance below the housing cap.
2. Assemble the mounting bracket to the housing cap so the flow direction of the cap matches how your plumbing flows.
3. Mount the bracket with the cap now attached to a flat wall surface so that the housing will screw onto the cap vertically from below.
4. Install the male adapters into the inlet and outlet ports of the cap using a few wraps of Teflon tape on the threads. Be careful to not over-tighten.


5. Turn the water off and make plumbing connections. Included adapters will work with Pex, CPVC or Copper. If threading copper directly to cap, be sure and solder parts before threading into the plastic cap.
6. Install the ScaleStick by inserting the top of the stick in the cap
7. Screw the housing sump up on the cap. The housing sump only needs to be hand tight, do not use the wrench to tighten.
8. Slowly turn the water back on and check for leaks.
9. The ScaleStick does not need to be flushed

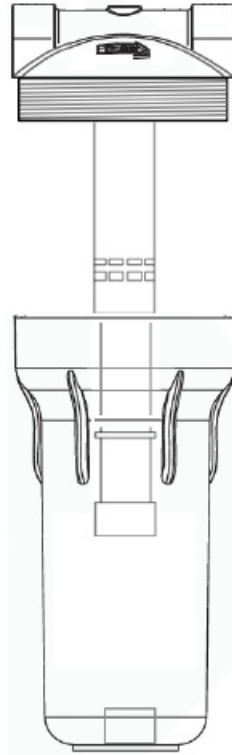

Replacement Cycle:

The frequency of replacement will vary based on water usage. The media in the ScaleStick will slowly dissolve as water flows through the housing. Watch the level of media and replace it when it is almost depleted.

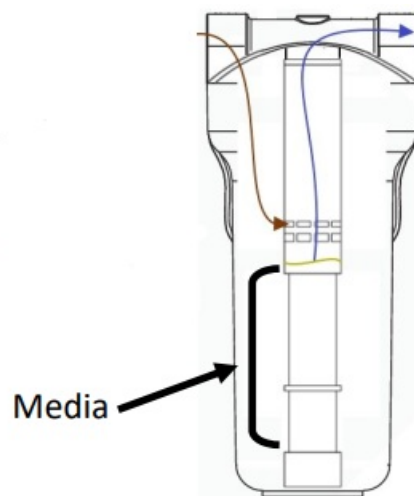

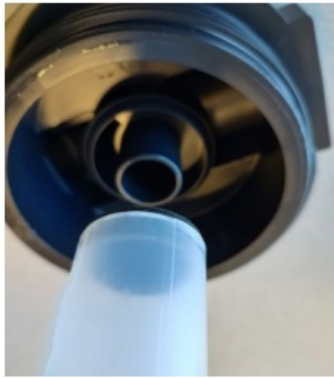


Push the ScaleStick's
o-ring end onto the
center port in the
cap



Push it on until it
contacts the cap

Documents / Resources

	neo pure SS-10 Anti Scale System with Hydroblend Stick [pdf] Installation Guide SS-10, SS-10 Anti Scale System with Hydroblend Stick, Anti Scale System with Hydroblend Stick, Scale System with Hydroblend Stick, Hydroblend Stick, Stick
--	---

References

- [User Manual](#)

[Manuals+](#), [Privacy Policy](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.