



NOTIFIER PN43294 Module Insulating Pad Instruction Manual

[Home](#) » [NOTIFIER](#) » NOTIFIER PN43294 Module Insulating Pad Instruction Manual 



PN43294 Module Insulating Pad Instruction Manual



World Headquarters

12 Clintonville Rd., Northford, CT 06472-1653

USA 203-484-7161

Fax 203-484-7118

www.notifier.com

Contents

- [1 PN43294 Module Insulating Pad](#)
- [2 Overview](#)
- [3 Installing an Insulating Pad](#)
- [4 Mounting a Module with an Insulating Pad](#)
- [5 Documents / Resources](#)
 - [5.1 References](#)
- [6 Related Posts](#)

PN43294 Module Insulating Pad

Insulating Pad

Product Installation Drawing

P/N 50389 Rev B ECN 01-435 08/09/01


Overview

Installing an Insulating Pad (PN 43294) on a module prevents short circuits in voice messaging systems that use 16-point or 32-point annunciators (ACM-16AT, ACM-32A, and their expanders). Install an Insulating Pad on one of these annunciators installed in front of an audio amplifier (AA-30) mounted on a Dress Panel Single Well (DPSW-1/1B). The following instructions show how to install an Insulating Pad on a module and where to mount the module on the DPSW-1/1B (PN 18352).

Installing an Insulating Pad


Install an Insulating Pad on the back of a 16-point or 32-point annunciator as follows:

1. Remove the three mounting screws on the back of the module.
2. Place the Insulating Pad on the back of the module.
3. Insert the mounting screws and tighten until secure.

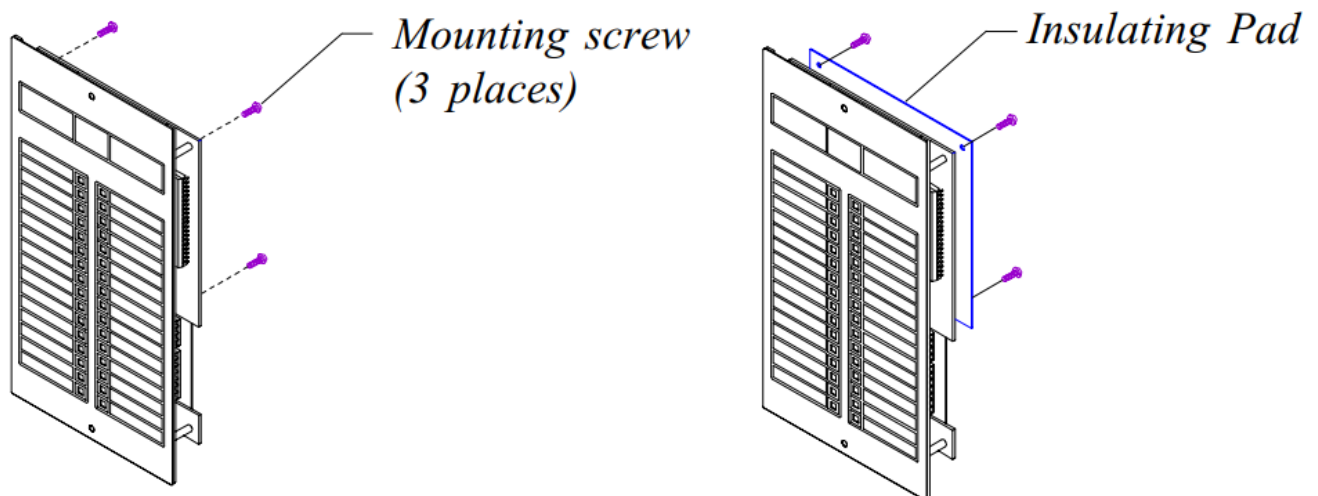

Mounting a Module with an Insulating Pad

Mount a 16-point or 32-point annunciator with an Insulating Pad onto the DPSW-1/1B in the outside position as shown in the following illustration. Modules mounted in the other position do not need an insulating pad.

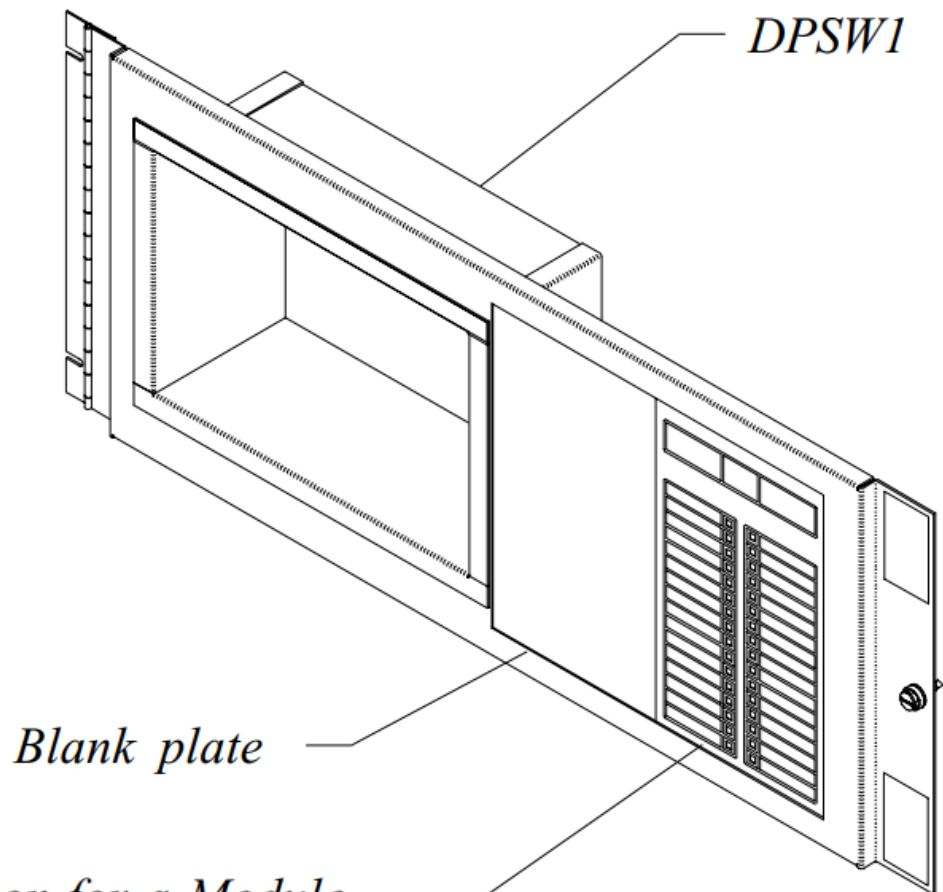

*Mounting position for a Module
with an Insulating Pad*




Mounting a Module with an Insulating Pad

firealarmresources.com

www.PDF-Zoo.com

Documents / Resources

	NOTIFIER PN43294 Module Insulating Pad [pdf] Instruction Manual PN43294, PN43294 Module Insulating Pad, Module Insulating Pad, Insulating Pad
---	--

References

- [Fire Alarm Resources | Download fire alarm documents](#)