


Contents [[hide](#)]

- 1 OMRON DX Series Event Triggered Video Logging Package
- 2 Introduction
- 3 Features and System Configuration
- 4 Operating Procedure
- 5 FAQ
- 6 Documents / Resources
 - 6.1 References



OMRON DX Series Event Triggered Video Logging Package

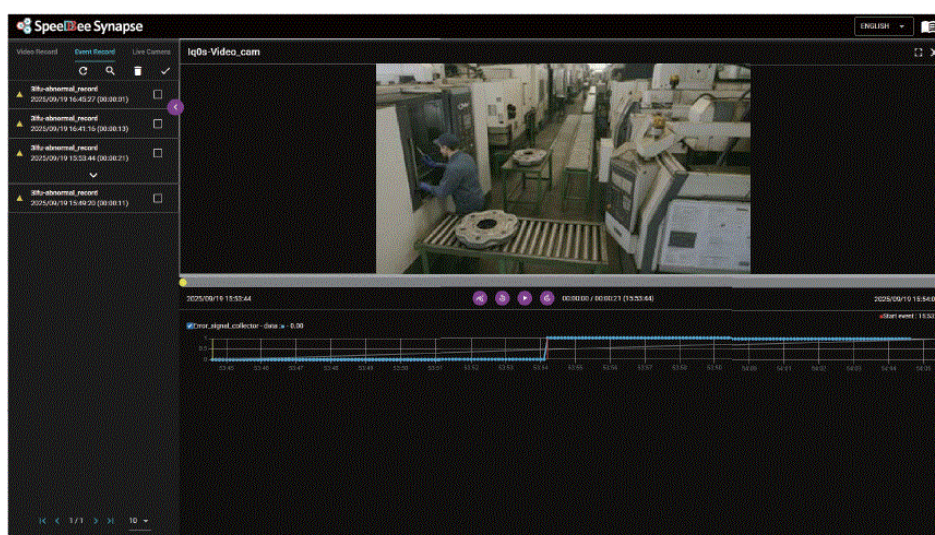

Introduction

- Thank you for purchasing our DX-series Data Flow Controller.
- This manual provides information about the Event-triggered Video Logging Package included with the DX Series Data Flow Controller.

- Please read this manual and make sure that you understand the functionality and performance of the product before you attempt to use it in a control system.

Intended Audience

This manual is intended for the following personnel, who must also have knowledge of electrical sys-tems (electrical engineers or the equivalent).


- Personnel in charge of designing and operating data utilization systems on a production site.
- Personnel in charge of designing and operating maintenance systems on a production site.

Guidance for Reading This Manual

For information on Terms and Conditions Agreement, Precautions for Safe Use, Precautions for Correct Use, and Related Manuals, refer to the DX Series Data Flow Controller User’s Manual (V241-E1).

Revision History

A manual revision code appears as a suffix to the catalog number on the front and back covers of the manual.

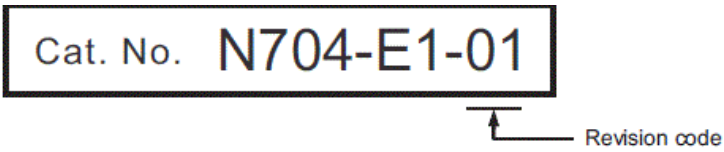

Revisio n code	Date	Revised content
01	October 2025	Original production

Features and System Configuration


Capabilities of the Event-triggered Video Logging Package

Event-triggered Video Logging Package


- This package enables video recording of equipment behavior during abnormal events

by retrofitting IP cameras and sensors. Traditionally, when equipment abnormalities occurred, maintenance personnel had to visit the site and visually inspect the equipment's condition and operation. This process required significant time and effort for root cause analysis and recovery.

- With this package, sensors are installed to capture abnormal status signals output from devices such as PLCs, along with IP cameras. When an abnormal status signal is detected, the system records and stores video footage from before and after the event.
- By reviewing the recorded video, users can visually confirm the equipment's condition surrounding the abnormal event, allowing them to understand the situation before arriving on-site.
- This enables faster identification of root causes and reduces recovery time.

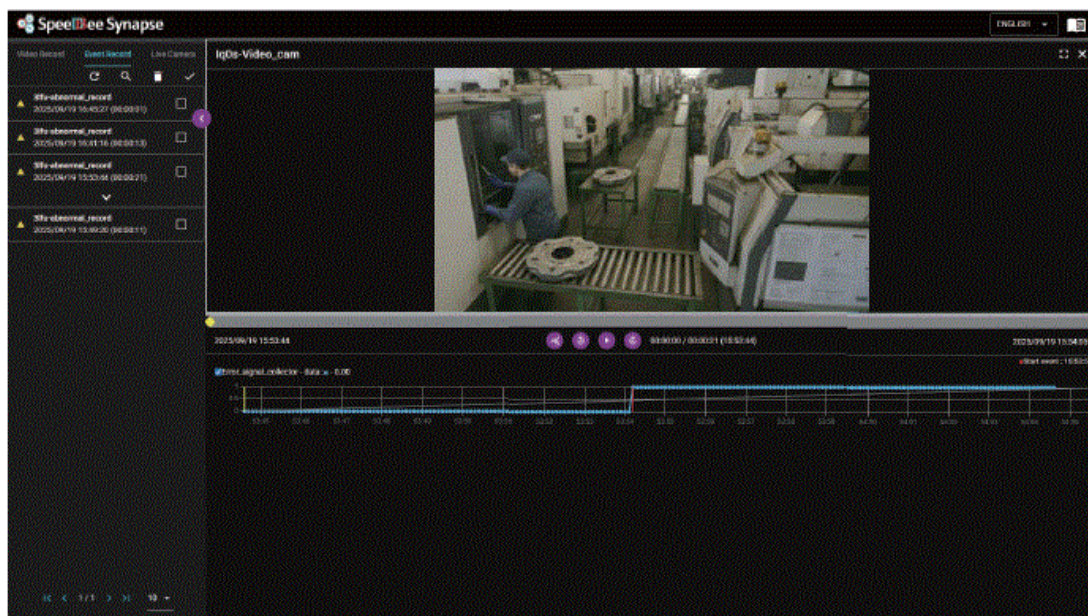

Example System Configurations

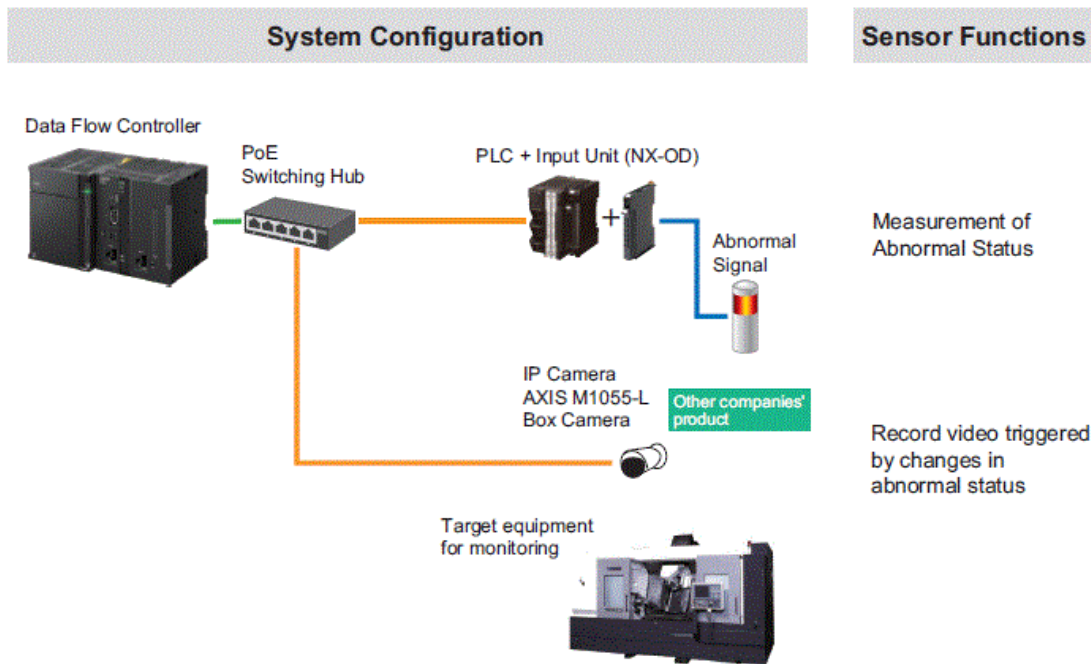


Operating Procedure

This section describes the operating procedure for the Event-triggered Video Logging Package.

Overall Workflow


- The following is the overall workflow for using the Event-triggered Video Logging Package.
- Refer to the manuals or instruction manuals of each device for wiring, installation, configuration, and software startup procedures.

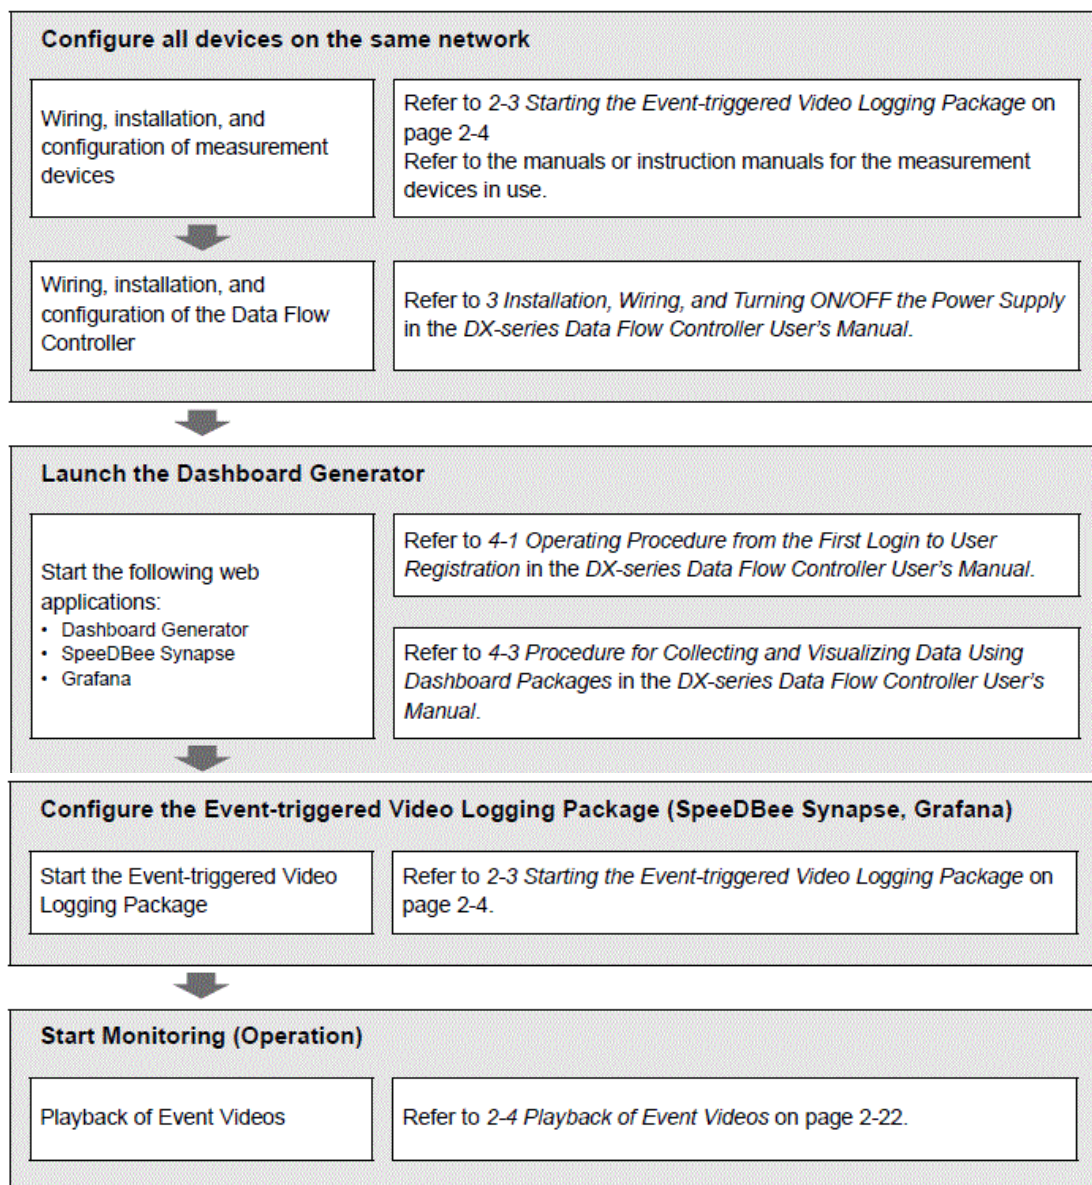

Configuration of IP Camera

- This section describes the configuration procedures for IP cameras required for the Event-triggered Video Logging Package.
- It assumes that the system connections described in 1-2 Example System Configurations have already been completed.

IP Camera Configuration

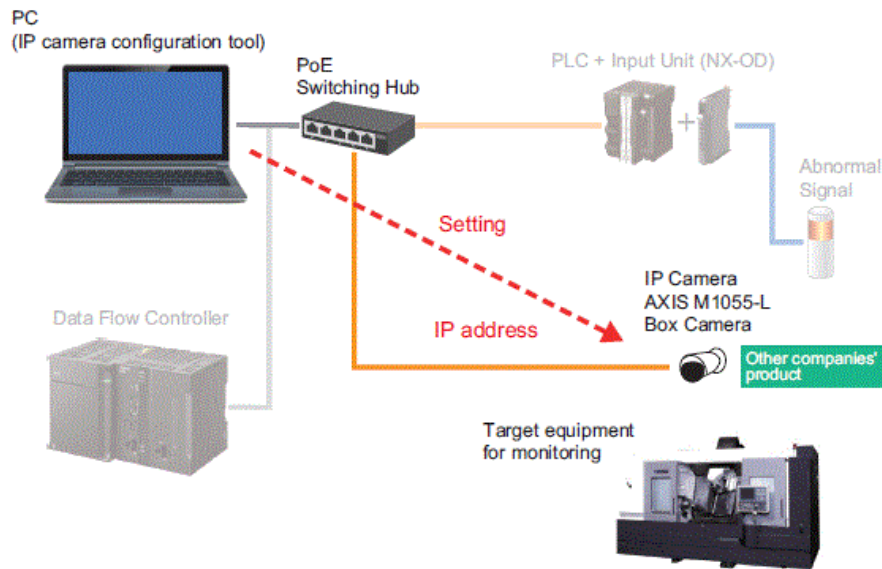

1. Power on the PoE switching hub and IP camera, then connect the PC to the IP camera
2. Use the IP camera configuration tool on the PC to set the IP address of the IP camera.

Refer to the IP camera manual and configure the settings as follows:

IP Address: 192.168.250.xxx (Set xxx to any value that does not conflict with other devices)


Username: root

Password: admin

3. Adjust the installation position and angle of the camera to ensure the required video can be captured.

Starting the Event-triggered Video Logging Package

- For procedures from logging into the Dashboard Generator to applying settings to SpeedBee Synapse and Grafana, refer to Section 2-2 “Using the Dashboard Generator” in the DX Series Dashboard Generator User’s Manual.
- It explains how to register and configure the IP addresses of devices connected to the Data Flow Controller.

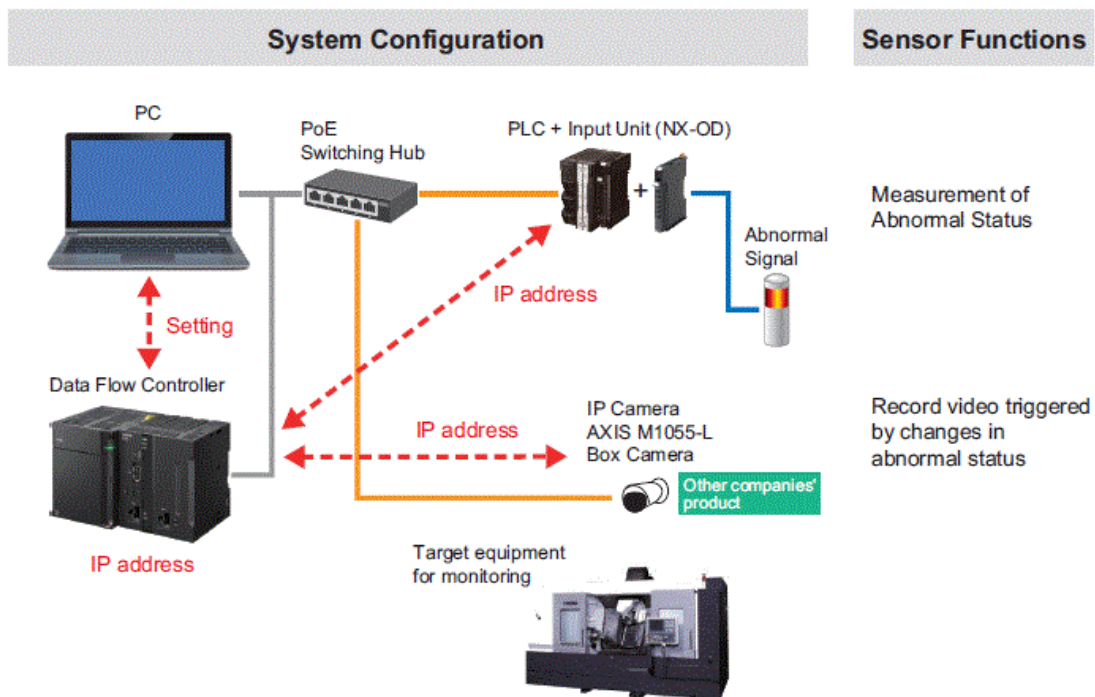

Configuration Procedure

- Follow the steps below.
- This procedure assumes that the Dashboard Generator, Synapse, and Grafana are already integrated.


Configuration Steps	Details
NX-OD (Output Unit) Configuration	This section explains the setup based on a system where abnormal status signals are output from the control PLC to an alarm device. In this example, the NX-OD is used as the output unit of the control PLC. Define the NX-OD variables as global variables in Sysmac Studio, and publish them to the network. This is necessary to link the abnormal status signals to the Data Flow Controller.
Device List Screen Configuration	Perform a device scan to retrieve information about devices connected via the Event-triggered Video Logging Package.
Package List Screen Configuration *	Select the Event-triggered Video Logging Package and specify the equipment identification information and the device to be used for dashboard registration. Register the dashboard based on the specified settings.
Dashboard List Screen Configuration * (Synapse / Grafana)	Launch Synapse and start the Error Manager. • Configure the event occurrence period. • Start the Error Manager Launch the Grafana dashboard (graph).

NX-OD (Output Unit) Configuration

- Basic configuration of the NX Series Machine Automation Controller is omitted in this explanation. This section describes how to add variables in the I/O Map settings for NX-OD.
- If the variable name for the abnormal status used to control the alarm device in an existing PLC is already known, and the variable is configured as a global variable with network exposure enabled, the following steps are not required.


1. In Sysmac Studio, display the I/O Map of the NX-OD that outputs the abnormal status signal. Switch to offline mode to edit.
2. Confirm the Variable Name and Edit Type for the abnormal status output.

In this example, it is assumed that the abnormal status signal is output to output contact 00. The variable name is set to Ch1Output, and the variable type is set to Global Variable.


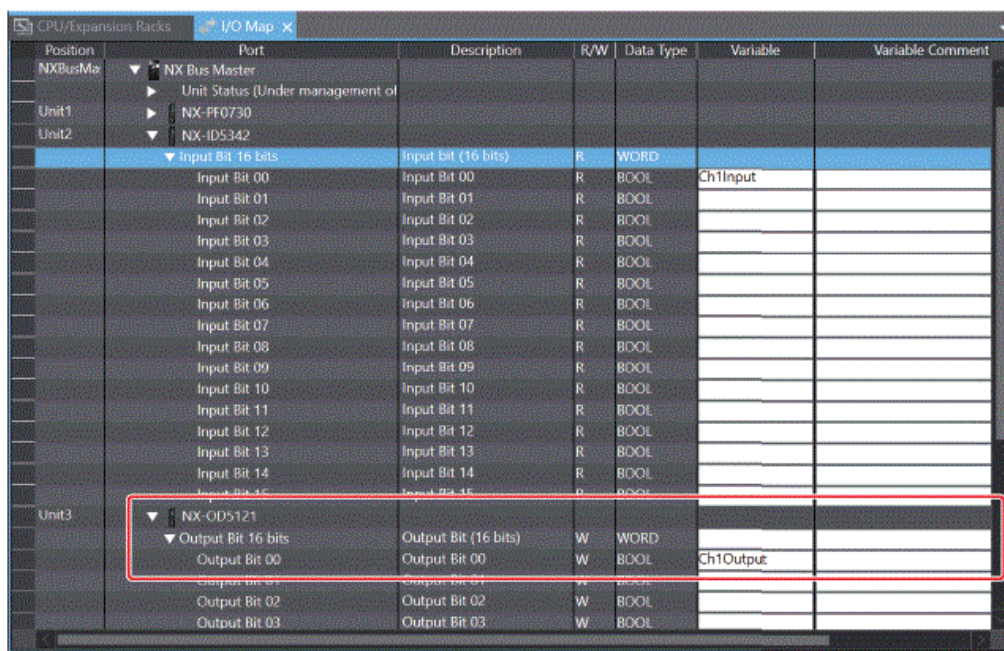


3. Set the network exposure of the abnormal status output variable Ch1Output to Publish Only.

Open the settings screen from the left tab: Programming → Data → Global Variables.


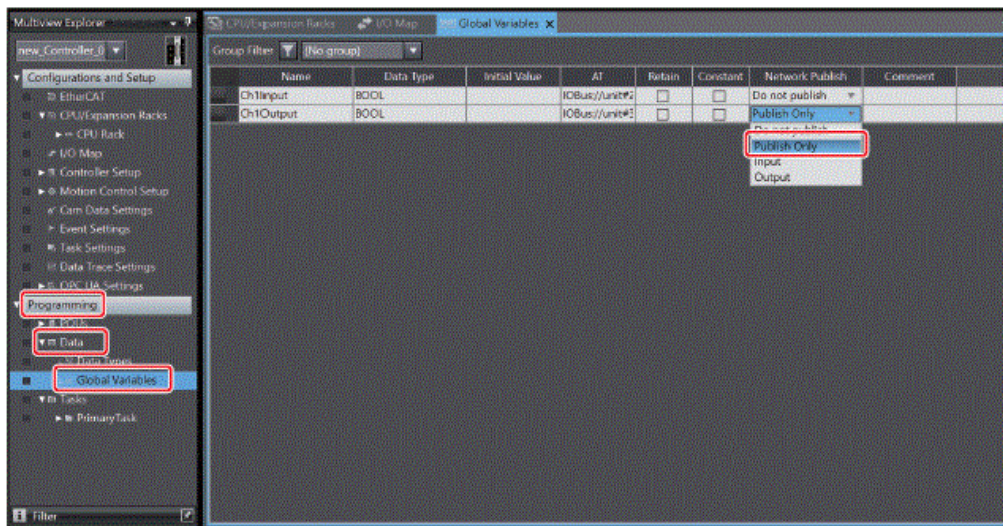


4. Switch to online mode and synchronize.

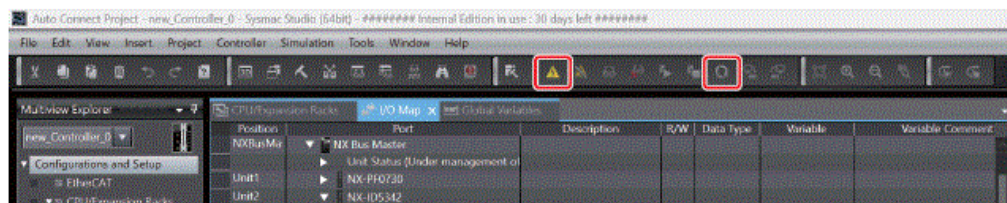

5. Click the Transfer to Controller Button.

The program will be transferred.

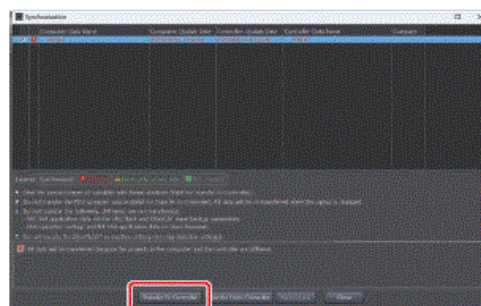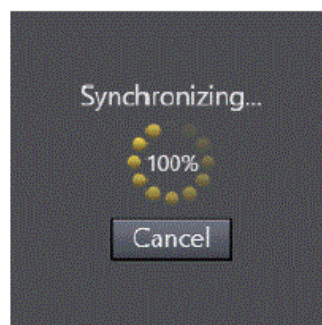


6. When prompted to switch to run mode, click the Yes Button.


Device List Screen – Device Scan

1. Click the Device Scan Button at the top right of the Device List Screen.


The Device Scan Screen will appear.

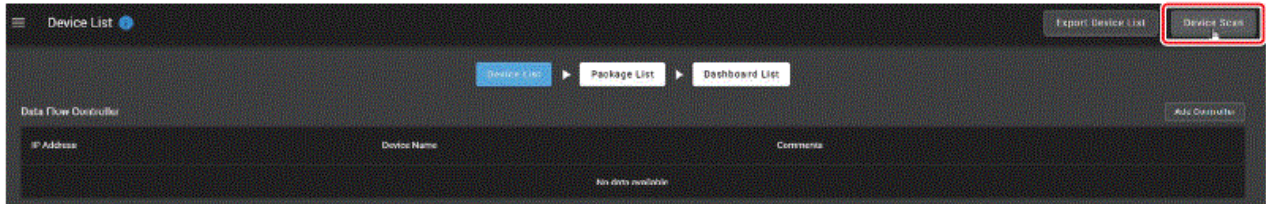

2. Select the interface from the dropdown menu.
3. When the Scan Button becomes active, click it.

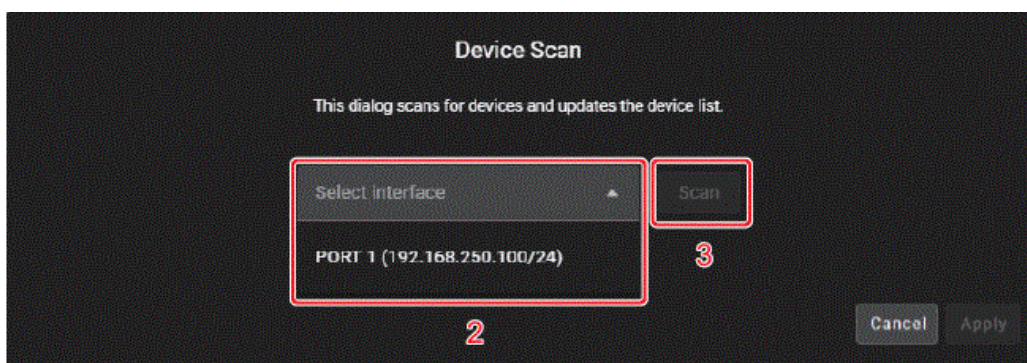

4. The scanned devices will be displayed. Click the Apply Button.

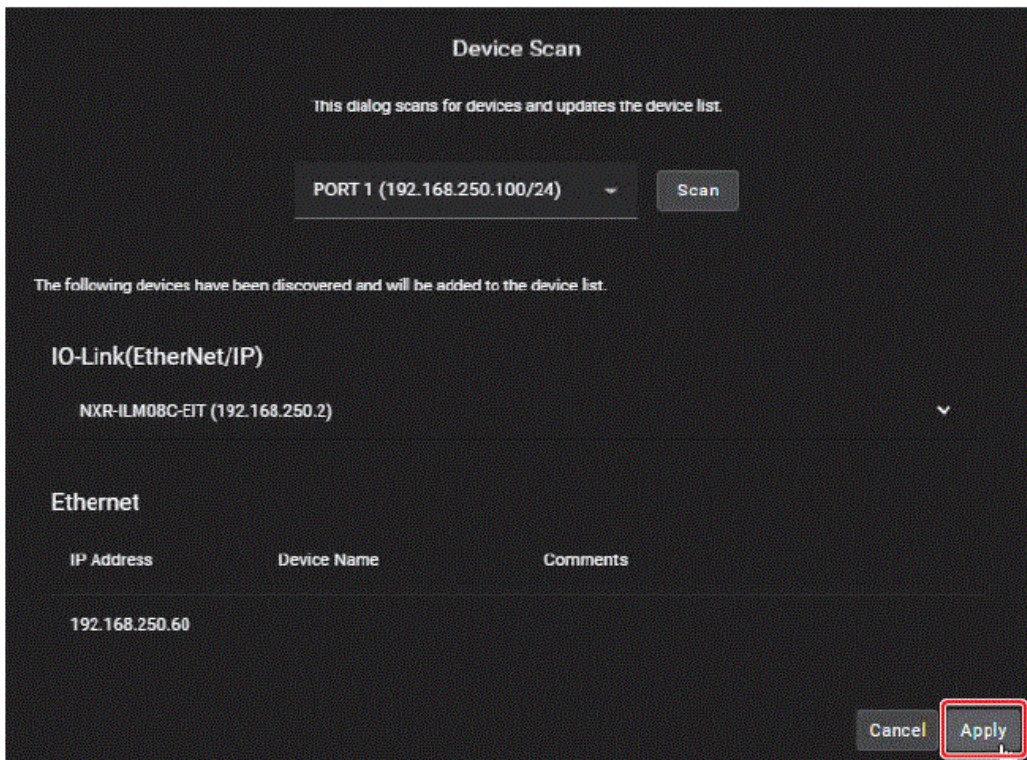


You will return to the Device List Screen. Confirm that the devices have been updated.

In the example, NX102-9000 is added to Ethernet/IP.

The scanned IP address of the IP camera will be displayed at the bottom under Ethernet.


- Click the Edit Button on the row at the bottom of the Ethernet list where the scanned IP address of the IP camera is displayed.

In the example, the IP address is 192.168.250.66.

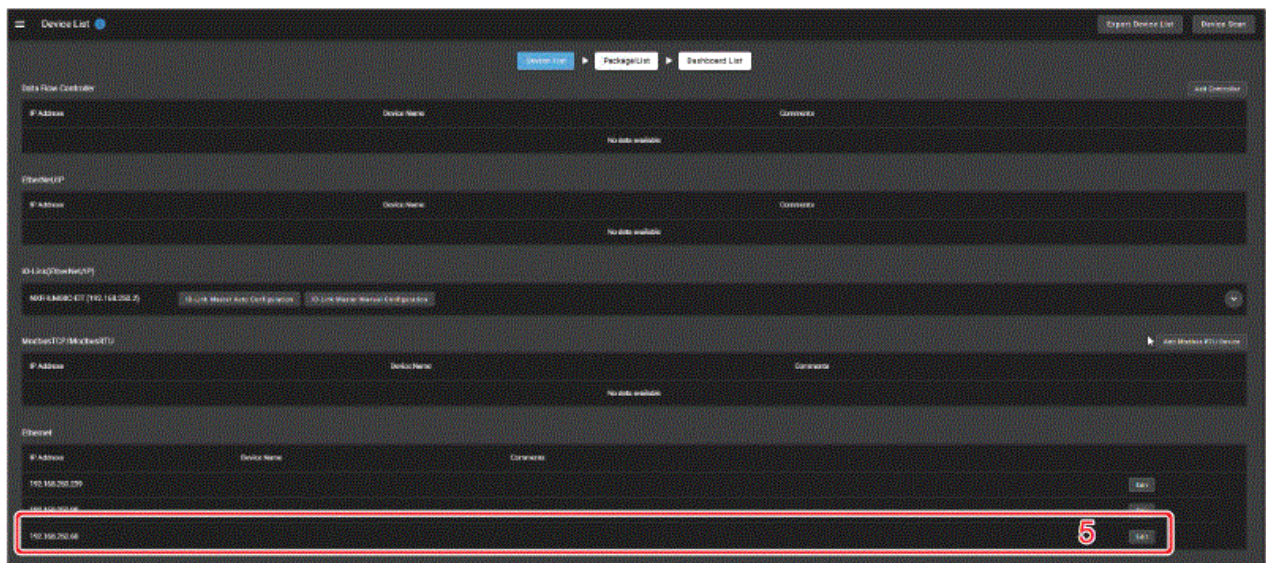


- From the Device Type dropdown menu, select Ethernet.
- Enter a desired name in the Device Name field. Example: IP Camera
- Click the Save Button.

You will return to the Device List Screen.

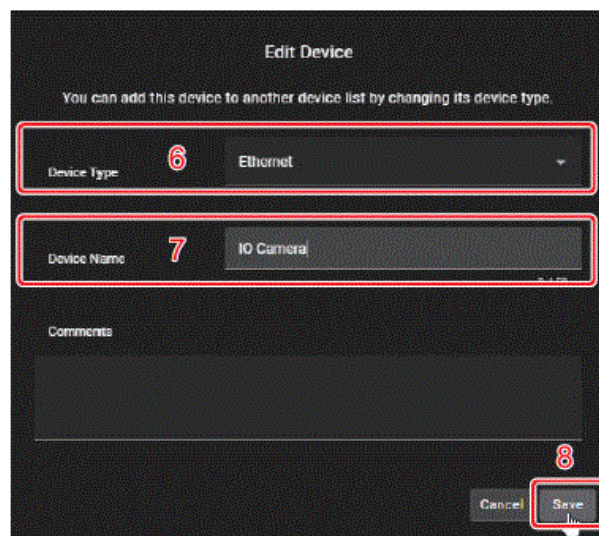

Package List Screen – Dashboard Registration

- Click the Register Dashboard Button at the top right of the Package List Screen. The Register Dashboard Screen will appear.

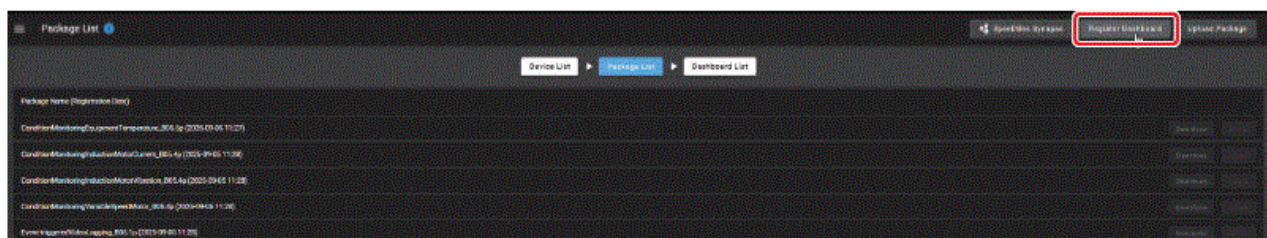

- 2.
3. Configure the information on the Register Dashboard Screen.

Register Dashboard

Dashboard Name: TEST

Package: Event-triggered Video Logging_R05.5p

Equipment Identification:

Factory: A

Line: B

Process: C

Equipment: D

Select Devices / Set Parameters

Cancel Register


Setting Item	Description
Dashboard Name	Enter a desired name. It will be displayed in Synapse and Grafana. Example: <i>TEST</i>
Package	Select Event-triggered Video Logging Package .
Equipment Identification	Optional input fields. Includes factory name, line name, process name, and equipment name.

Click the Register Button.

The Confirm Dashboard Registration Screen will appear.

4. Click the Register Button.
- Dashboard registration takes approximately 30 seconds.

Once registration is complete, the system will transition to the Dashboard List Screen.

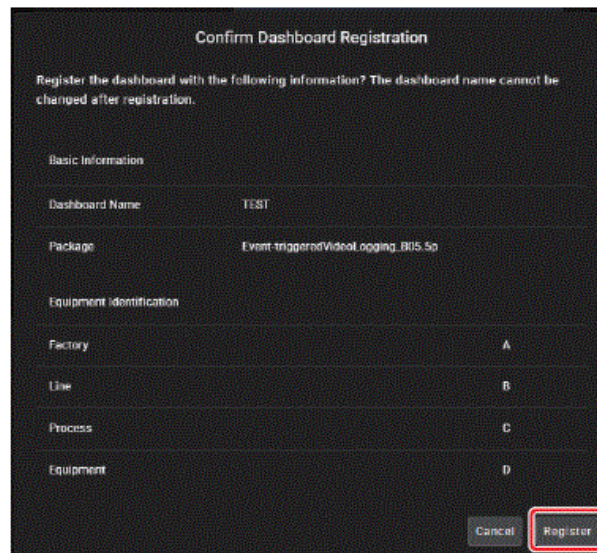

Confirm Dashboard Registration

Register the dashboard with the following information? The dashboard name cannot be changed after registration.

Basic Information

Dashboard Name	TEST
Package	Event-triggeredVideo logging_B05.5p


Equipment Identification

Factory	A
Line	B
Process	C
Equipment	D


Cancel Register

Dashboard List Screen – Launching Synapse


1. Click the SpeedBee Synapse Button at the top right of the Dashboard List Screen.
The SpeedBee Synapse Screen will appear.

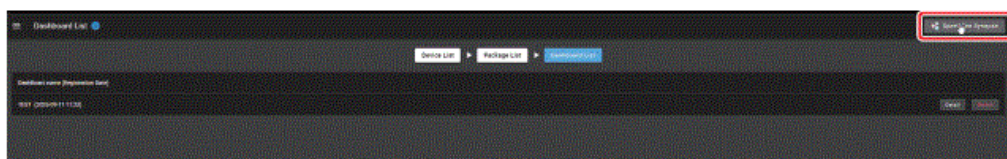


2. A panel has been added with a custom dashboard name (e.g., TEST).
Click DETAIL on the corresponding panel.
The screen will transition to the Synapse Connection Screen.

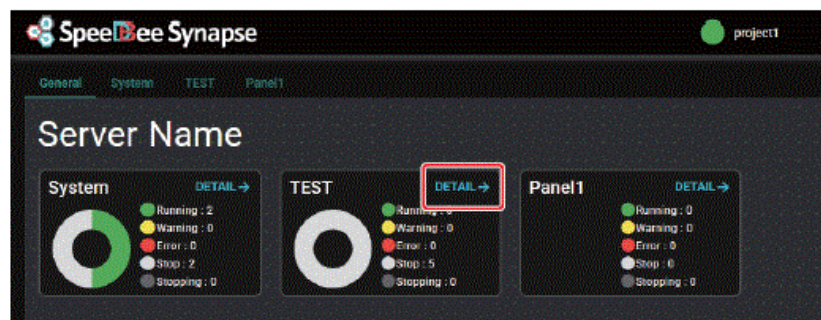

3. Change Run to Edit.
4. Delete the EtherNet/IP Collector Component and the NXR_dr_trigger Component.

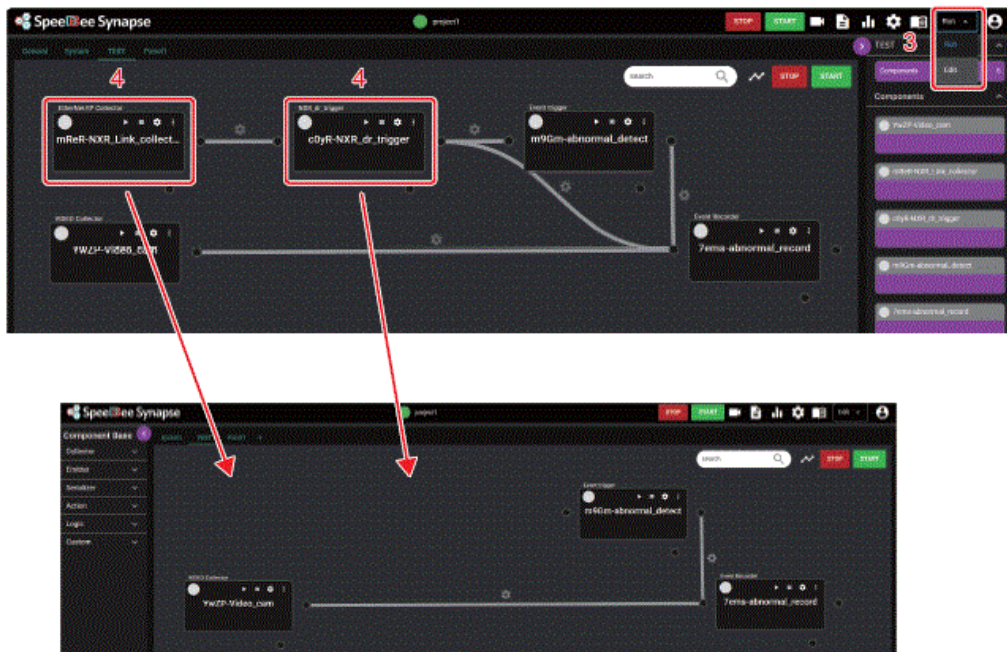


5. From the tab on the left, select EtherNet/IP Collector and place it.

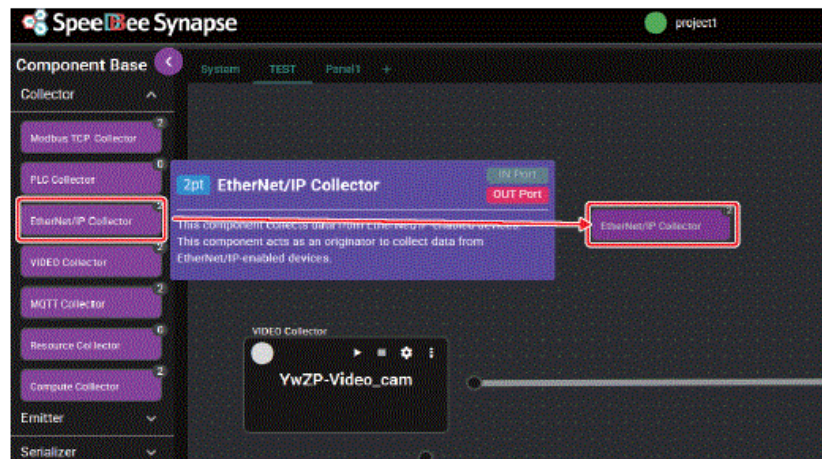

6. Configure the placed EtherNet/IP Collector.

Item	Description
Name	The name of the component. Example: Error_signal_collector
Host	The IP address of the host. Set the IP address of the NX102-9000. Example: 192.168.250.1
Get Interval	The data acquisition interval. Set to 100 ms.

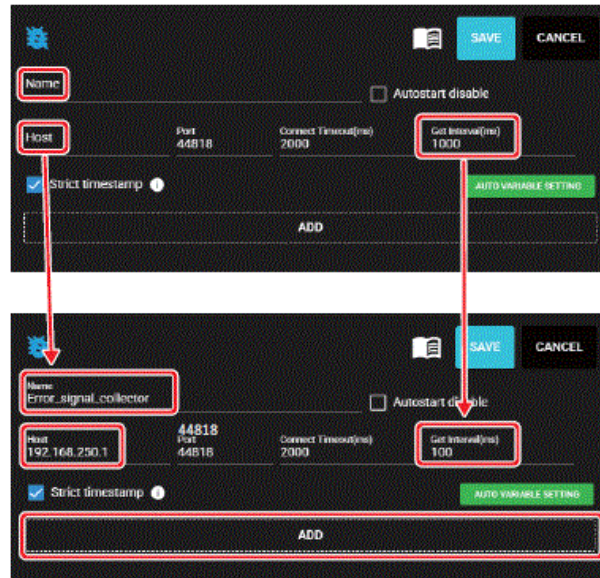

7. Click the ADD Button to continue configuration.
8. After configuration, click the SAVE Button.


Item	Description
Variable Name	Set the NX-OD variable. Example: Ch1Output
Column Name	The name of the acquisition column. Example: data
Data Type/ Array Size	Set the data type of the variable Ch1Output. Example: BOOL, 1




- 8 Connect the output port on the right side of the created component to the input port on the left side of the Event trigger.



9 Connect the output port on the right side of the created component to the input port on the left side of the Event Recorder.

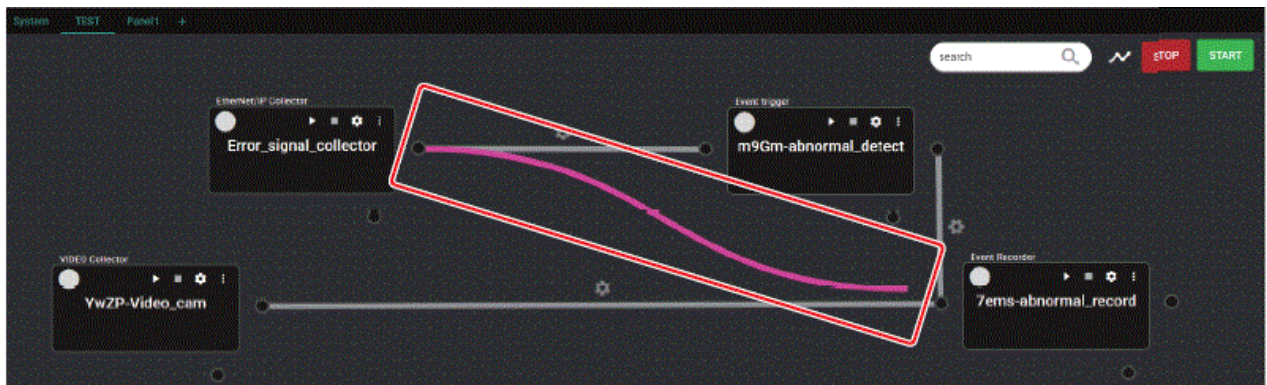

9. Click the  Button on the VIDEO Collector Component.

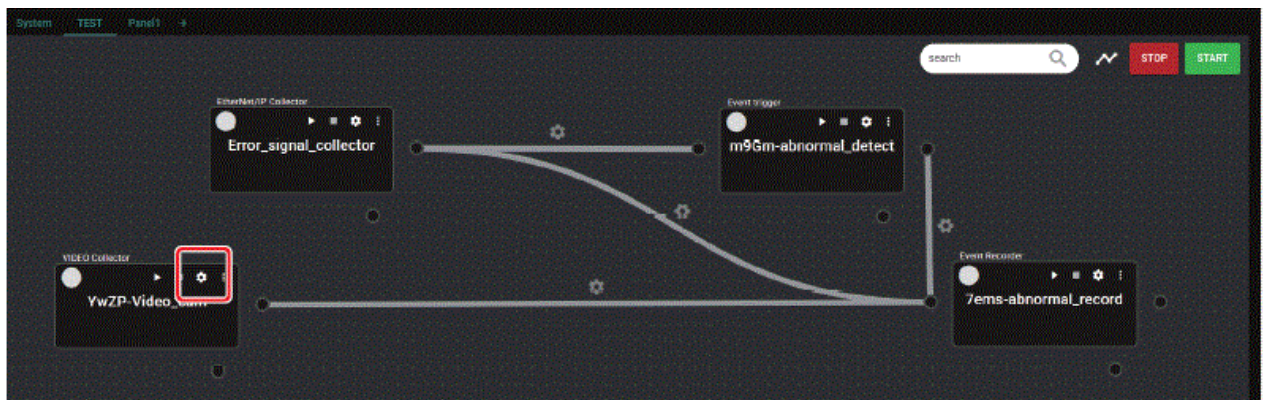

10. Modify the contents of RTSP URL to match the IP address of the IP camera.

In the example below, the following change is made:

rtsp://root:admin@192.168.250.67/axis-media/media.amp ↓

rtsp://root:admin@192.168.250.60/axis-media/media.amp

SAVE DELETE TEST CANCEL

Name
YwZP-Video_cam ☐ Autostart disable

Save Location
Project: /opt/speedbeesynapse-data/... data/video/camera1

Store Hour
1 Time out(ms)
10000


Protocol
TCP RTSP URL
rtsp://root:admin@192.168.250.67/axis-media/media.amp

☐ Output MP4


Unit Duration(sec)
30

RTSP URL
rtsp://root:admin@192.168.250.60/axis-media/media.amp


11. Click the TEST Button.
12. The camera will start.
13. Click the CLOSE Button. Return to the previous screen.

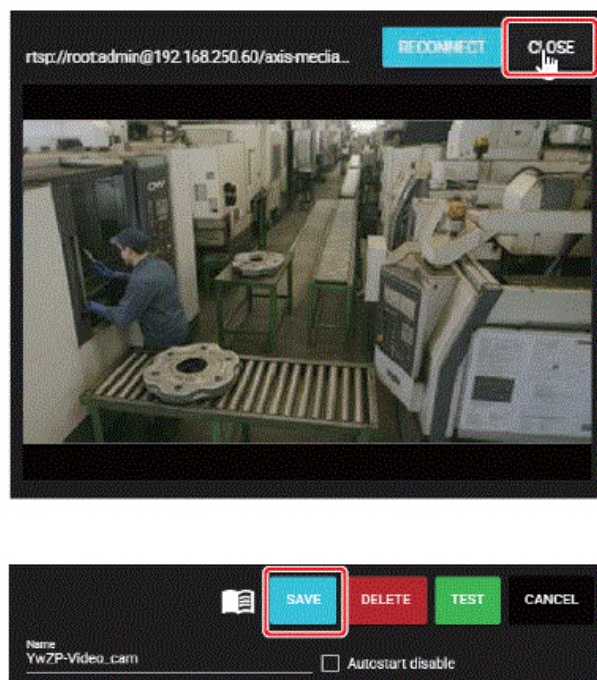

14. Click the SAVE Button.
15. Click  the Button on the VIDEO Collector Component.

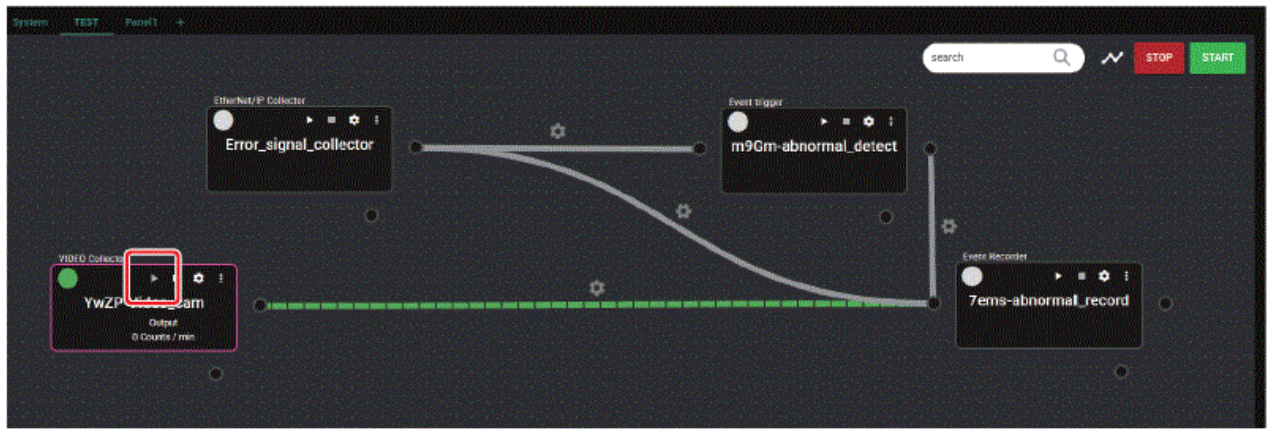


After a short wait, the flow link will change from yellow to green.

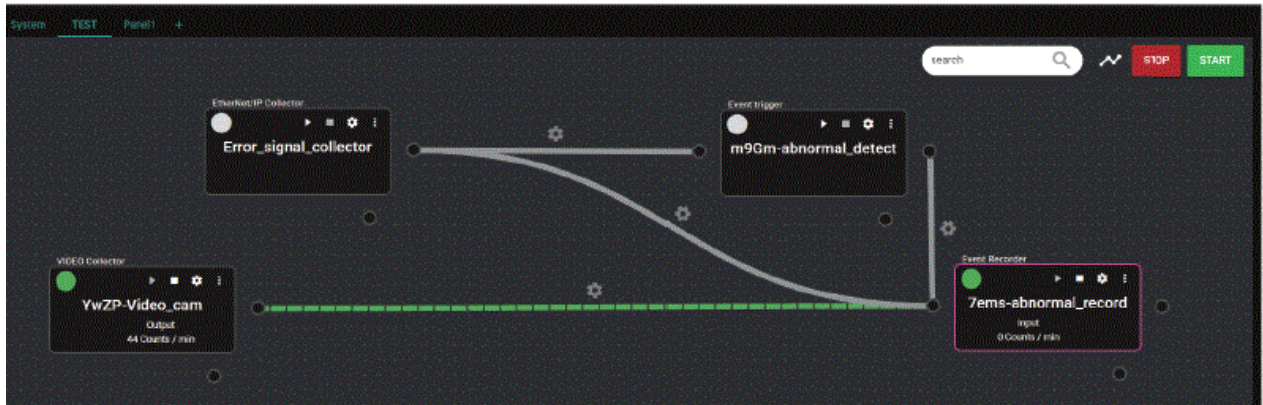

16. Click the  on the following two components:
EtherNet/IP Collector and Event trigger




17. Click the  Button on the Event trigger Component.

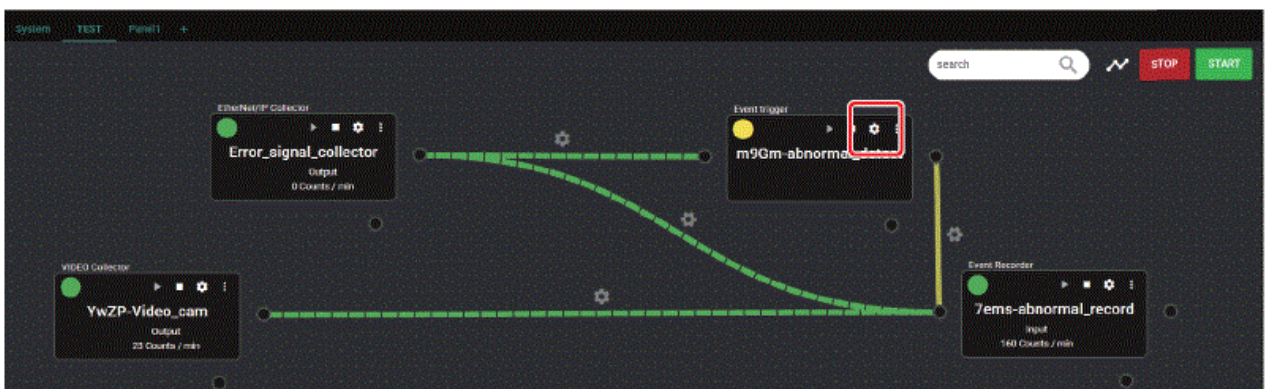


18. In the component settings, configure the name assigned to the Ethernet/IP Collector.
After configuration, click the SAVE Button.


In this example, the component name Error_signal_collector set in step 5 is used.

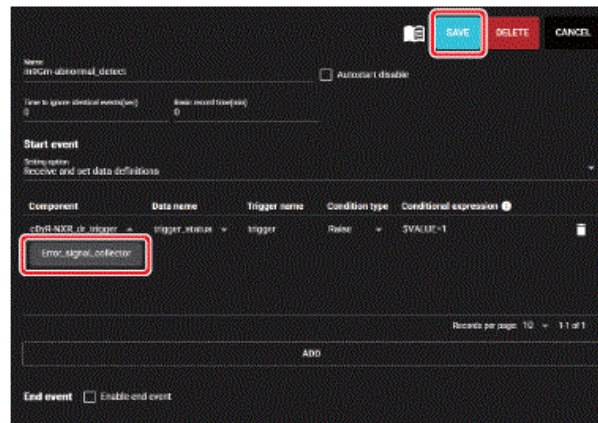

19. Click the STOP Button, then click the START Button to restart.

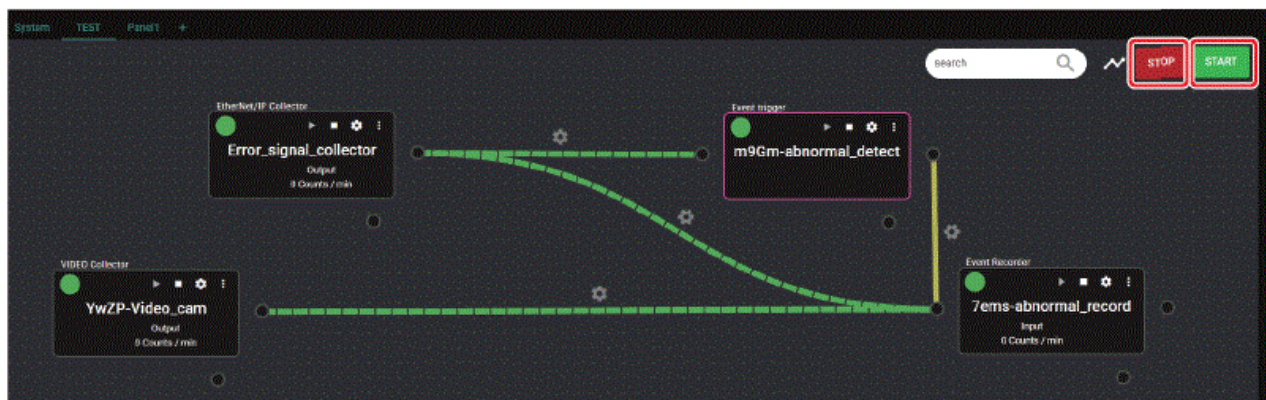

20. Right-click the input port of the Event Recorder Component.

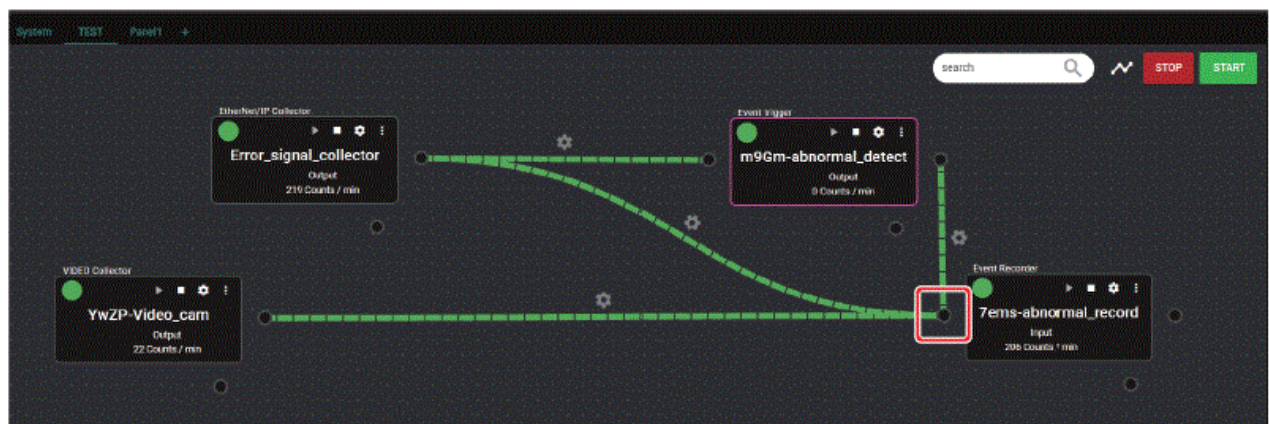

21. Configure In port setting:


Use event

- Acquisition range pre event occurrence(sec): Modify as needed (e.g., 10 seconds)
- Acquisition range post event occurrence(sec): Modify as needed (e.g., 10 seconds)

Since there is a time lag between event detection and recording, set a longer duration before the start event. Specifically, add approximately 3 seconds to the actual recording time.

Once configuration is complete, click the SAVE Button.

22. Click the  on the Event Recorder Component.

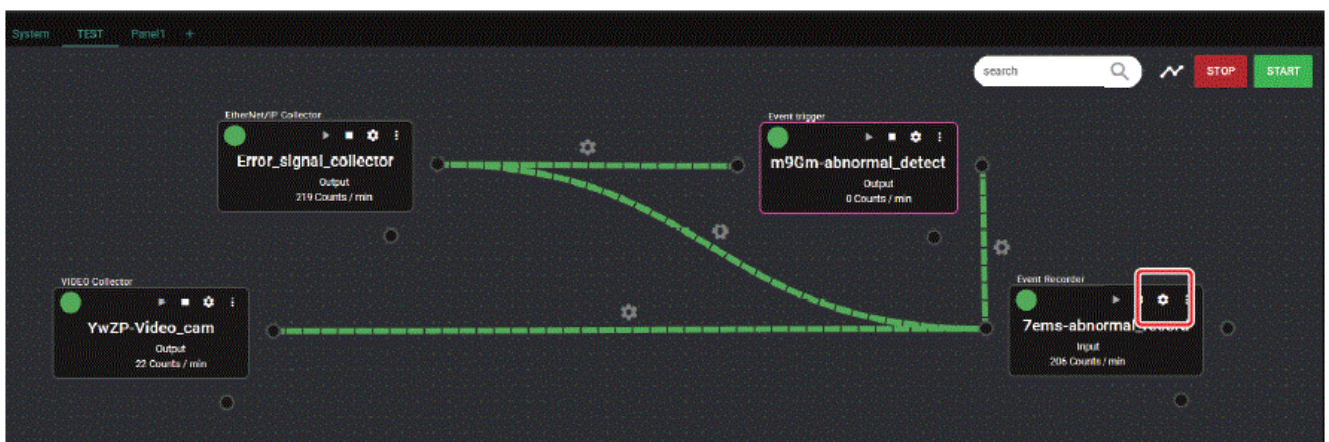

The default retention time is 168 hours (one week). Modify as needed, then click the SAVE Button.

Precautions for Correct Use


Data Storage Location

Always use an external USB memory device with a capacity of 2GB or more.


The internal memory of the Data Flow Controller does not have sufficient capacity, and event videos cannot be saved.

Refer to section 2-5 Changing the Data Storage Location in the DX Series Dashboard Generator User's Manual for configuration steps.


23. Click the on  the Event Recorder Component.

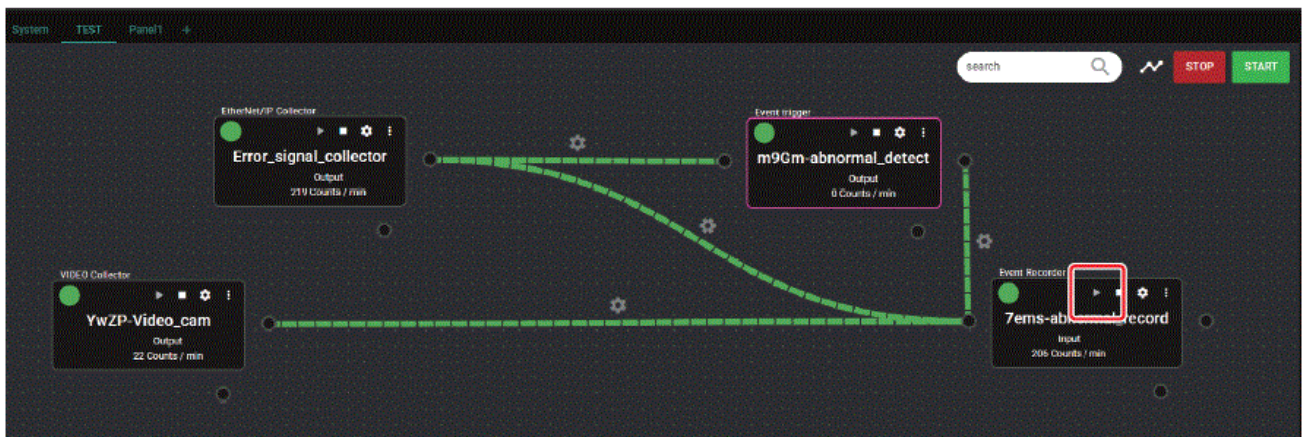


24. Click the START Button.

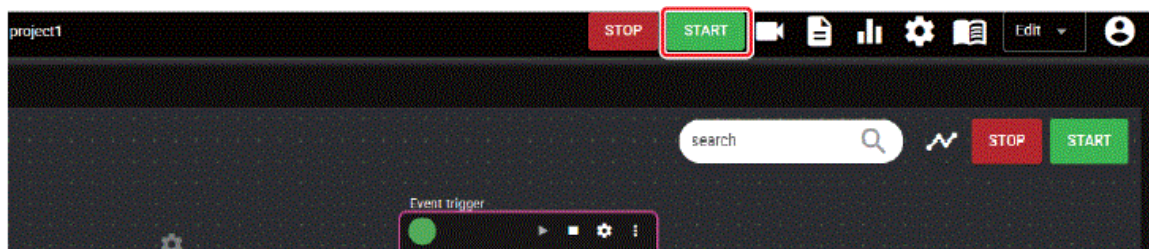


25. Click the System Tab at the top left (for Error Manager configuration). The System Panel will appear.

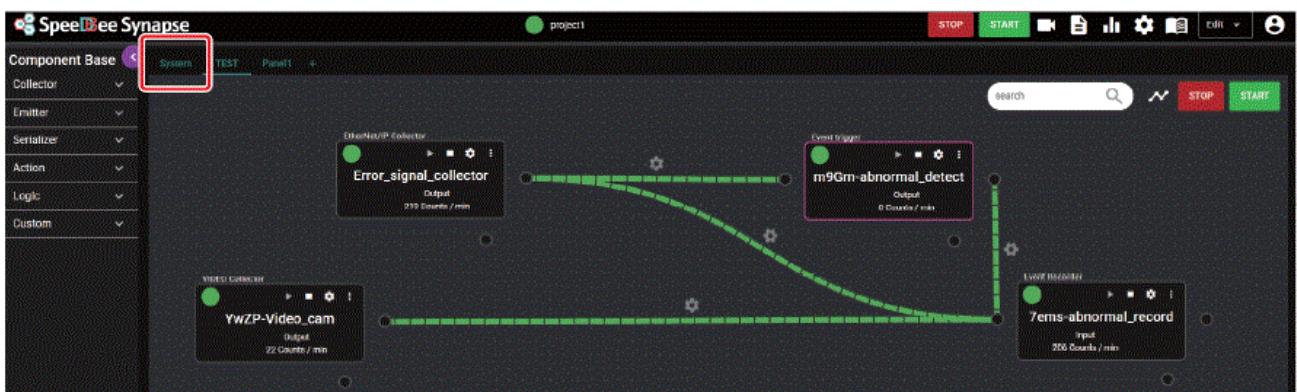

26. Click the  (Launch) Button on the Error Manager Component.

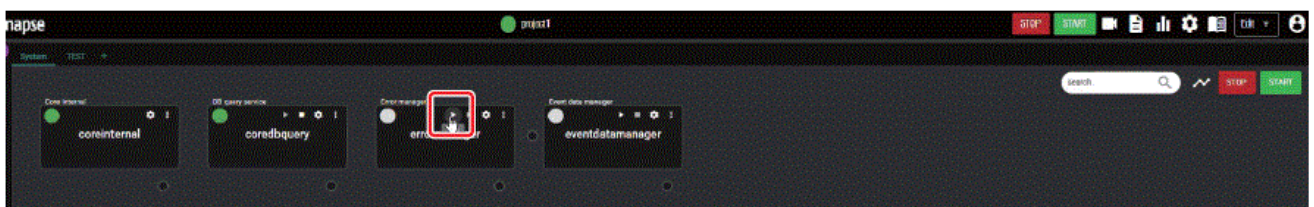


The Error Manager will start.

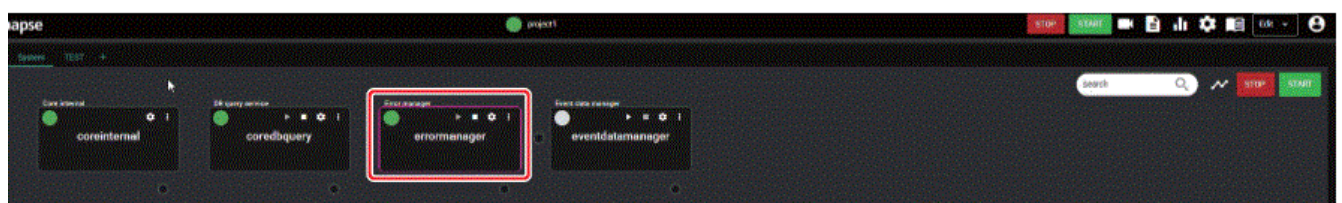


Note: Error Manager is required for Grafana to retrieve data from Synapse.

Dashboard List Screen – Launching Grafana


1. Click the graph icon in the upper-right corner of the Synapse Screen. The Grafana Screen will appear.

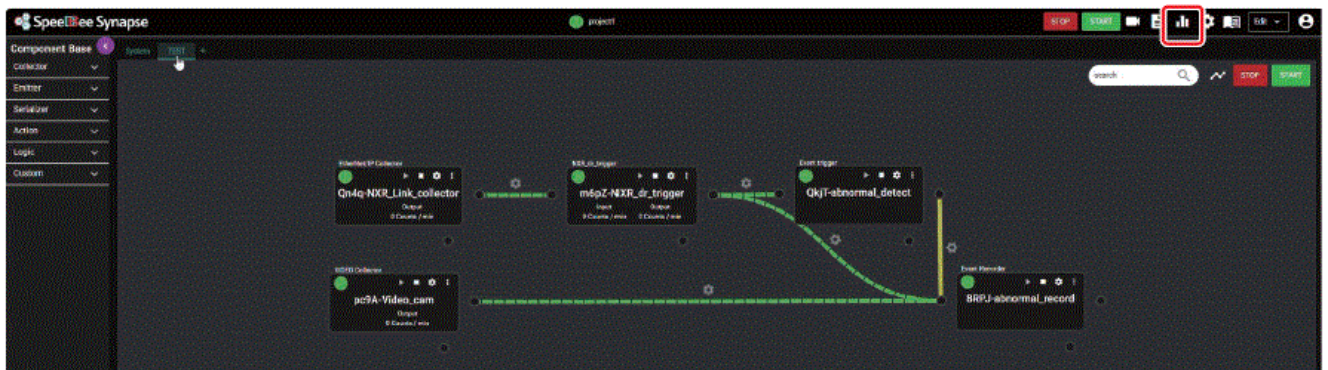


2. Click Dashboards. The screen switches.

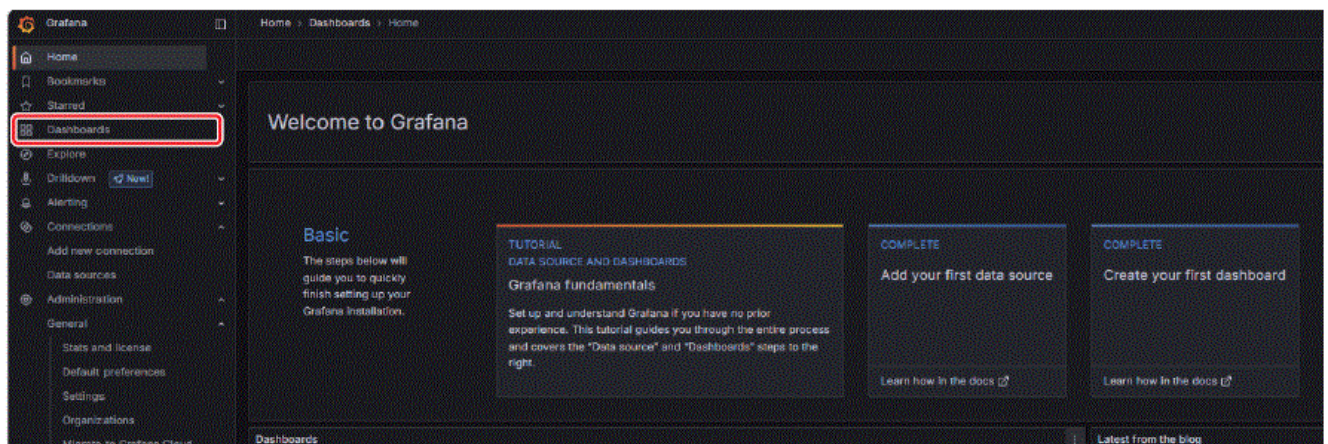


3. Click any dashboard name that has been added. **Example:** TEST

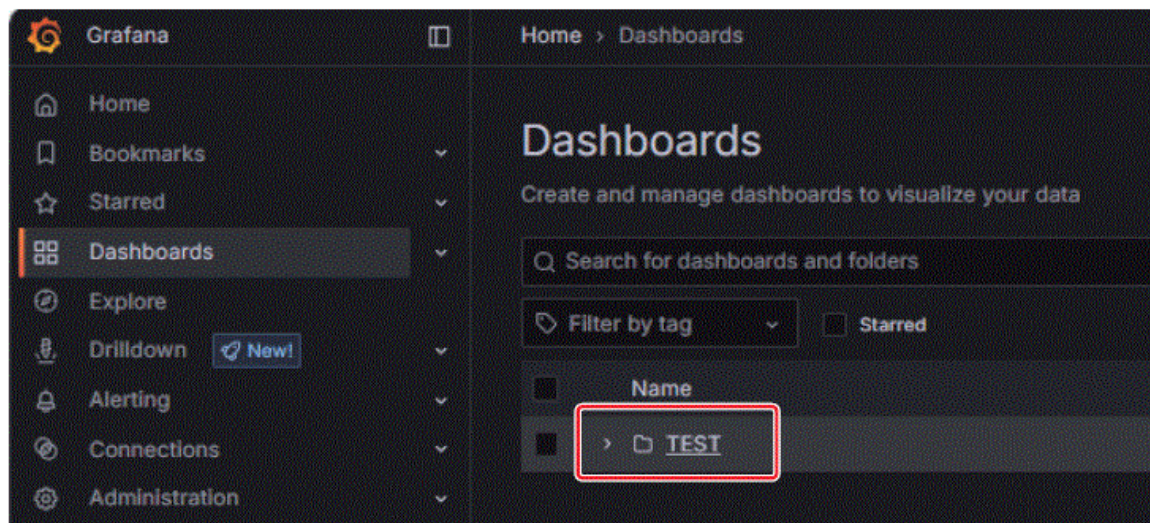


4. Click Event-triggered Video Logging Package. The screen switches.

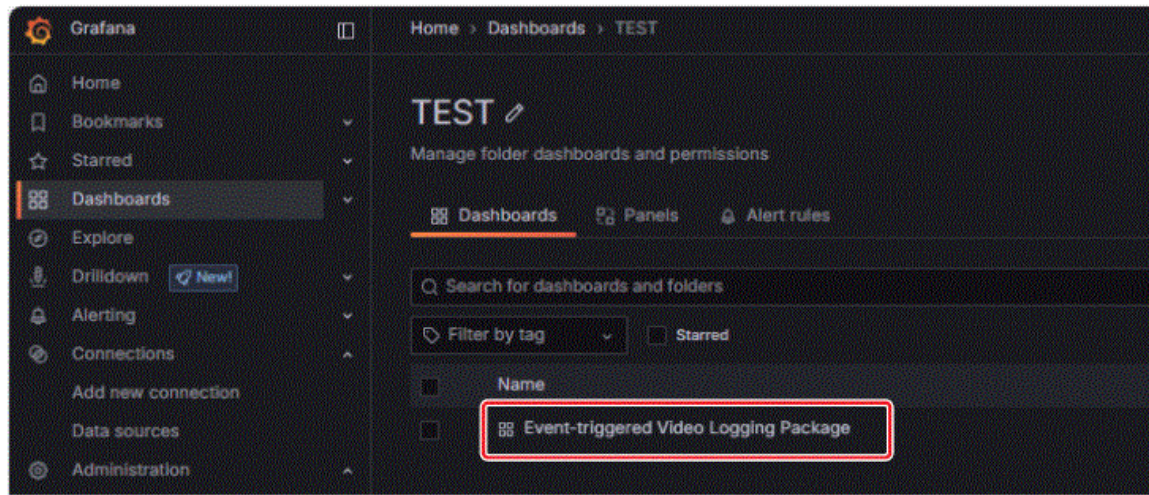


5. The KPI is displayed as a graph. To change the time range on the horizontal axis, use the dropdown menu labeled Last 1 hour JST.

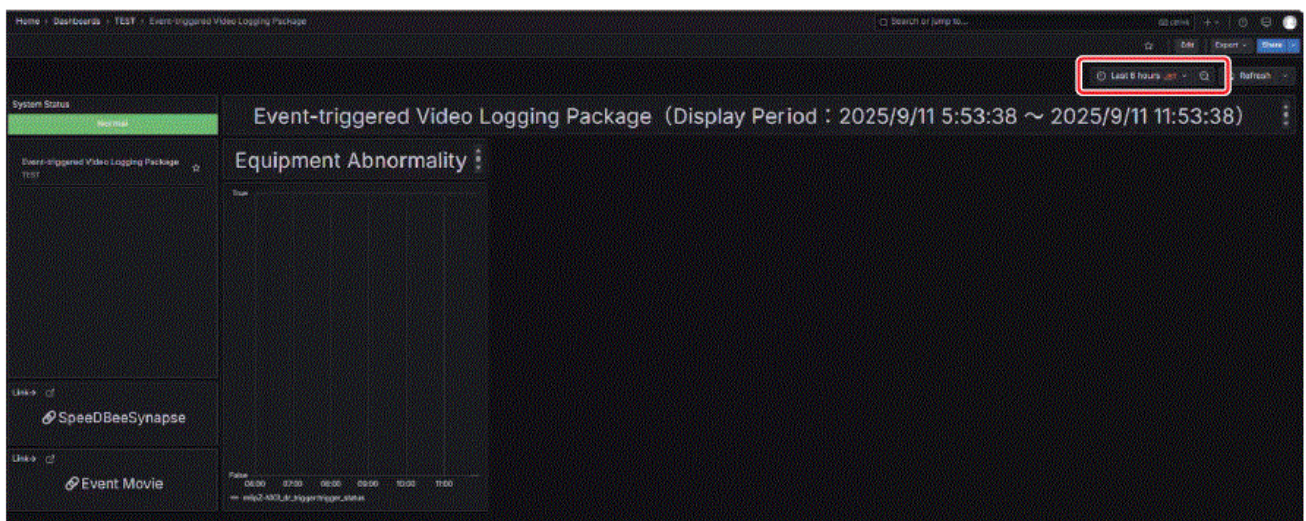

In this example, Last 5 minutes is selected. **Note:** The vertical axis (values) of the graph automatically adjusts its scale based on the range of acquired data.

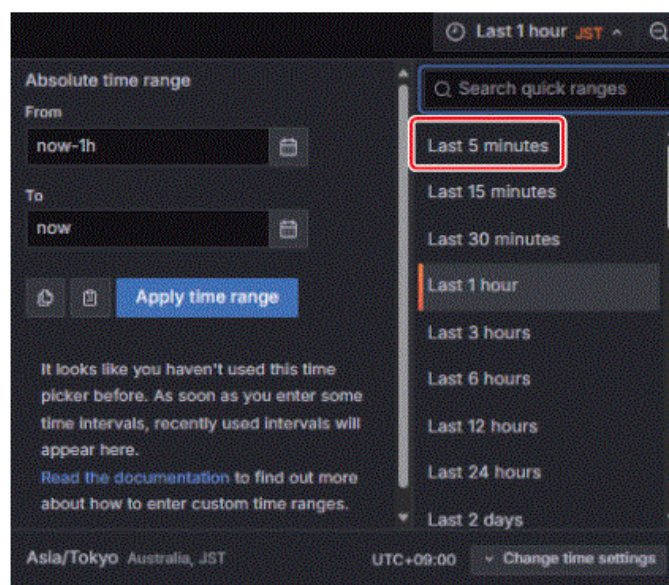


6. A graph with the updated time range on the horizontal axis will be displayed. To adjust the data refresh frequency, click Refresh Button at the top right. Select the desired interval from the dropdown menu.

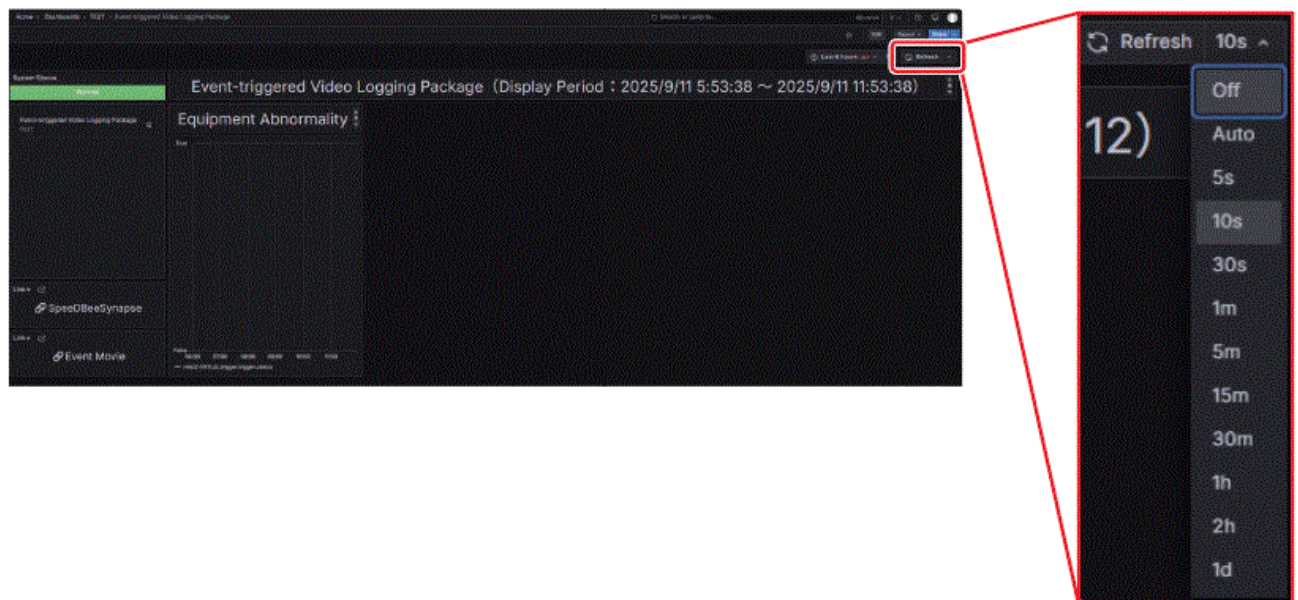


Playback of Event Videos

This section describes the procedure for playing back event videos.


1. Click the viewer icon at the top right of the SpeedBee Synapse Panel.

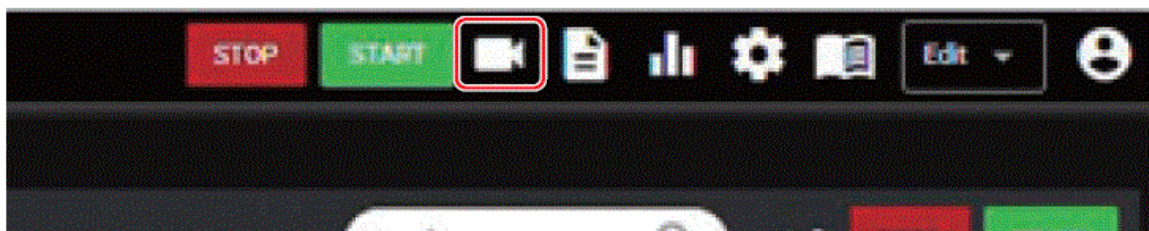

2. Click Event Record.

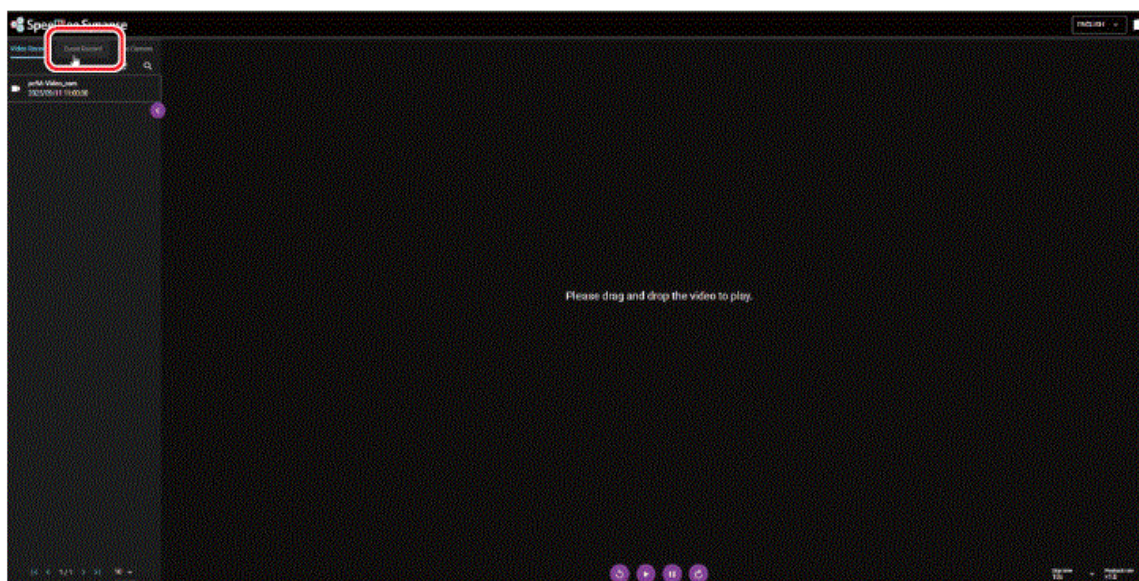

3. Click on the desired recorded data from the list. Click ► to start playback.

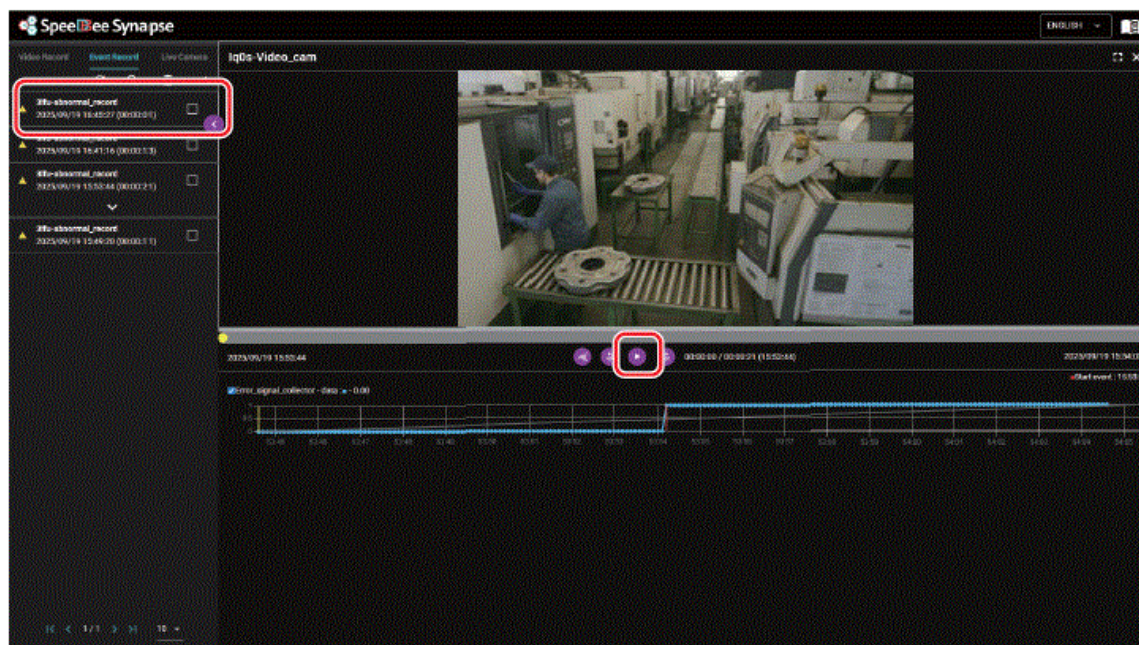

- For details on the video playback feature, refer to the i-Trigger Operation Guide for SpeedBee Synapse: <https://www.saltyster.com/ss-docs/speedbeesynapse/i-trigger/viewer.html>
 - OMRON Corporation Industrial Automation Company
 - Kyoto, JAPAN
 - Contact : www.ia.omron.com
 - Contact for inquiries for this product (only for DX-series)
 - DataPF-contactdesk-OC@omron.com
- Operation Hours: 9:00 to 17:00 (except Saturdays, Sundays, and Dec. 31 to Jan. 3), JST
- Tutorial Video <https://www.fa.omron.co.jp/dx1/video-manual/en/>



NOTE

1. All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted, in any form, or by any means, mechanical, electronic, photocopying, recording, or otherwise, without the prior written permission of OMRON.
2. No patent liability is assumed with respect to the use of the information contained herein.

Moreover, because OMRON is constantly striving to improve its high-quality products,

the information contained in this manual is subject to change without notice.

3. Every precaution has been taken in the preparation of this manual. Nevertheless, OMRON assumes no responsibility for errors or omissions.

Neither is any liability assumed for damages resulting from the use of the information contained in this publication.

Trademarks

- ODVA, CIP, CompoNet, DeviceNet, and EtherNet/IP are trademarks of ODVA.
- The SD and SDHC logos are trademarks of SD-3C, LLC.
- SpeedBee Synapse is a trademark of SALTYSTER Co., Ltd.
- Grafana is a trademark of Grafana Labs.

Copyrights

This product incorporates certain third party software. The license and copyright information associated with this software is available at

https://www.fa.omron.co.jp/product/tool/dx-info/index_en.html

FAQ

Can I use the Event-triggered Video Logging Package with other controllers?

The Event-triggered Video Logging Package is specifically designed for use with the DX Series Data Flow Controller and may not be compatible with other controllers.

How do I update the firmware of the DX Series Data Flow Controller?

Firmware update instructions can be found in the DX Series Data Flow Controller User's Manual. Follow the provided guidelines to update the firmware safely.

Documents / Resources

	OMRON DX Series Event Triggered Video Logging Package [pdf] User Manual N704-E1-01, 1025, DX Series Event Triggered Video Logging Package, DX Series, Event Triggered Video Logging Package, Triggered Video Logging Package, Video Logging Package, Logging Package
--	--

References

- [User Manual](#)

Omron

1025, DX Series, DX Series Event Triggered Video Logging Package, Event Triggered Video Logging Package, Logging Package, N704-E1-01, Omron, Triggered Video Logging Package, Video Logging Package

Leave a comment

Your email address will not be published. Required fields are marked *

Comment *

Name

Email

Website

☐ Save my name, email, and website in this browser for the next time I comment.

Post Comment

Search:

e.g. whirlpool wrf535swhz

Search

[Manuals+](#) | [Upload](#) | [Deep Search](#) | [Privacy Policy](#) | [@manuals.plus](#) | [YouTube](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.