

[Home](#) » [Orion Instruments](#) » Orion INSTRUMENTS KA231020 FC and FE Low Range Pressure Difference Switches Owner's Manual




Contents

- 1 KA231020 FC and FE Low Range Pressure Difference Switches
- 2 INSTALLATION DRAWING
- 3 Documents / Resources
 - 3.1 References

KA231020 FC and FE Low Range Pressure Difference Switches

PRESSURE CAPSULE DETAILS

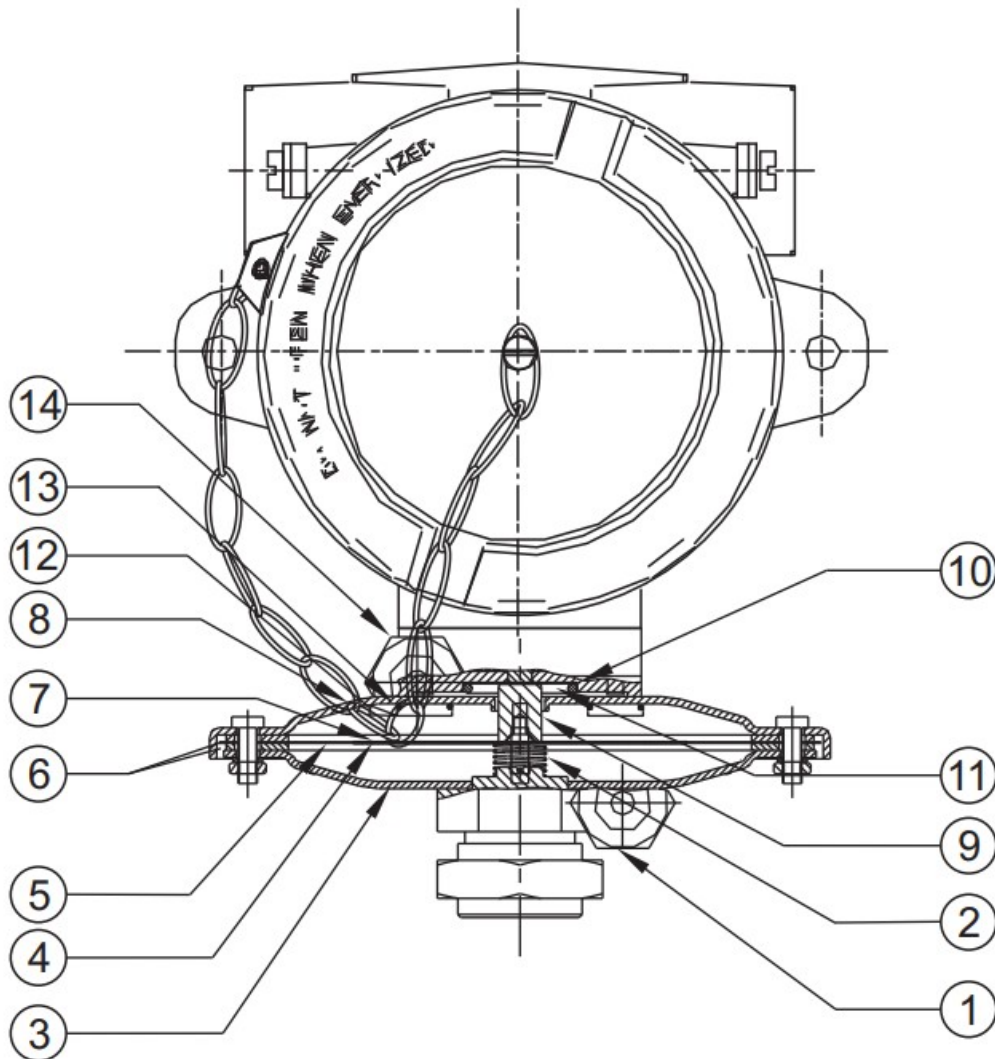


Note : wetted parts are mentioned in italics.

No.	Description
1	High pressure port (S.S.)*
2	Support spring (S.S.)
3	Bottom flange (S.S.)
4	Support plate (Aluminium)
5	Diaphragm (Neoprene)
6	Gasket (Nitrile)
7	Top plate (Aluminium)
8	Top flange (M.S.)*
9	Transfer pin (Aluminium)
10	'O' ring (Nitrile)
11	Sealing diaphragm (Nitrile)
12	Top flange screw (S.S.)
13	Sealing 'O' ring (Nitrile)
14	Low pressure port (S.S.)*

* Pressure ports are welded with flange

INSTALLATION DRAWING

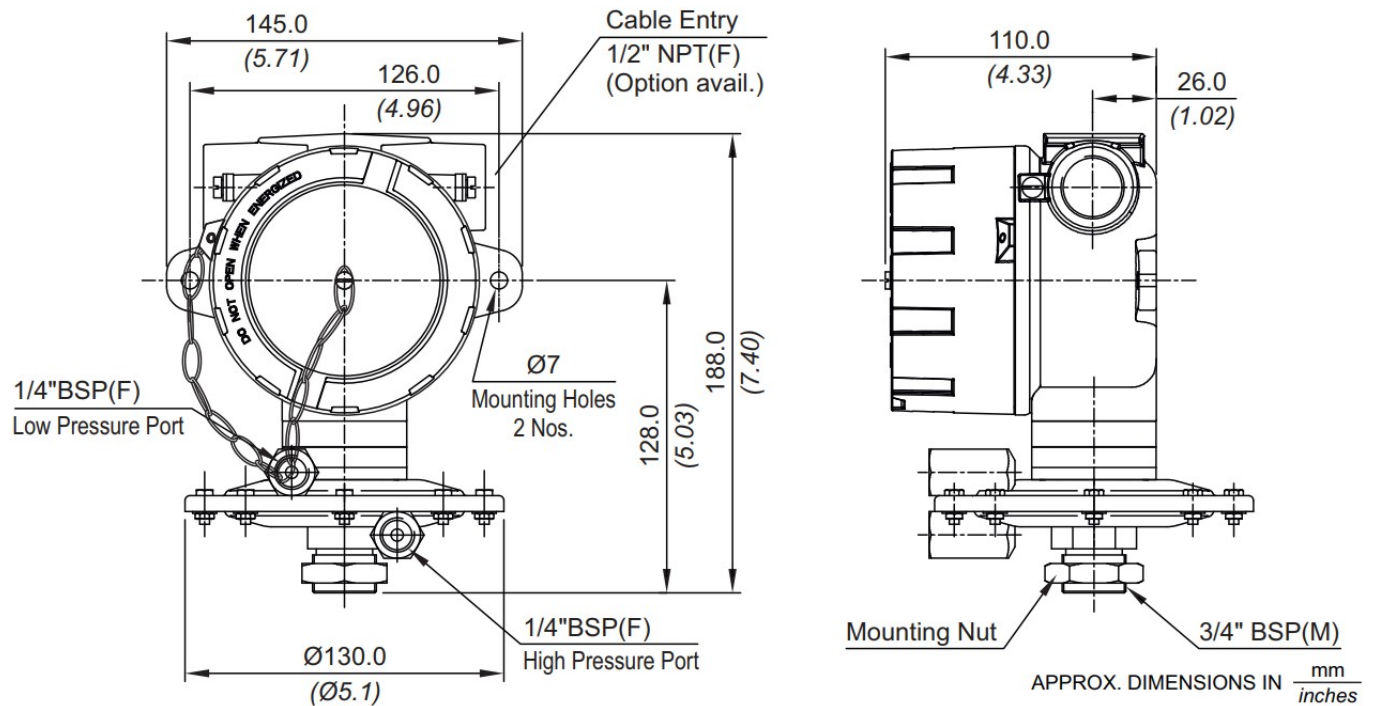

RANGE SELECTION TABLE

Range Code	Range mbar ("wc)	Differential* mbar ("wc)	Maximum Working Pressure bar (psi)
		Approximate Maximum for "A1" microswitch	
L02	1.5 to 15 (0.60 to 6.030)	3.0 (1.205)	2.0 (29.00)
L03	5 to 25 (2.009 to 10.047)	5.0 (2.009)	2.0 (29.00)
L05	10 to 50 (4.018 to 20.093)	5.0 (2.009)	2.0 (29.00)
L10	10 to 100 (4.018 to 40.180)	5.0 (2.009)	2.0 (29.00)
L15	10 to 150 (4.015 to 60.280)	10.0 (4.018)	2.0 (29.00)
L25	20 to 250 (8.037 to 100.466)	10.0 (4.018)	2.0 (29.00)
L35	50 to 350 (20.093 to 140.650)	35.0 (14.065)	2.0 (29.00)

Note:

1. The minimum differential increases with the setpoint. The differential values mentioned in the above table are approximate maximum for FSR. The differential value will vary according to the pressure range selected and microswitch type. For actual values of differential please contact sales office.
2. When using 2SPDT switching arrangement, both microswitches may not actuate and/or deactuate at the same point.

A small stage gap, normally upto +/- 5% FSR (depending on range code) may be observed. The On-Off differential (hysteresis) typically tends to be atleast double of those published for 1SPDT pressure switches.

If actuation and/or deactuation at same point is critical part of operation, then it can be achieved by using a separate DPDT relay. This relay will need a separate power supply for it's coil.

HOW TO ORDER FLAMEPROOF LOW RANGE PRESSURE DIFFERENCE SWITCHES

Group 1	Group 2	Group 3	Group 4	Group 5	Group 6	Group 7	Group 8
Non standard allocation	Model	Cable Entry Size	Switch Type	Range Code (values in mbar)	Microswitch Type	Pressure Port Material / Size	Diaphragm

<div><input type="checkbox"/> A prefix "N" is used in the model code in case of any non standard options / accessories that are provided with the switches. Will be given by manufacturer, only after agreement of supply details with customer. Bulletin No. K A231020 The prefix is subject to change as per specific requirement.</div>	<div>FC = IP66 Flameproof pressure switch, ATEEx, IECEEx & PESO approved FE = IP66 Flameproof pressure switch, PESO approved</div>	<div>1 = Al. head 1/2" NPT threads 2 = Al. head 3/4" NPT threads 3 = Al. head M20 x 1.5 threads *4 = Grey CI head 1/2" NPT threads *5 = Grey CI head 3/4" NPT threads *6 = Grey CI head M20 x 1.5 threads 7 = SS head 1/2" NPT threads 8 = SS head 3/4" NPT threads 9 = SS head M20 x 1.5 threads *Not available in FE models</div>	<div>D1 = pressure difference switch, fixed differential without scale D2 = pressure difference switch, fixed differential with scale in mbar D3 = pressure difference switch, fixed differential with scale in "wc F or adjustable differential please select microswitches A6 or C6 in group 6</div>	<div>L02 = (1.5 – 15) L03 = (5 – 25) L05 = (10 – 50) L10 = (10 – 100) L15 = (10 – 150) L25 = (20 – 250) L35 = (50 – 350)</div>	<div>A1 = General purpose microswitch rated at 15 A; 250 VAC *A6 = elements with adjustable deadband *A7 = 2SPDT switching elements A8 = General purpose microswitch rated at 5 A, 250 VAC; 5 A, 28 VDC *B7 = 2SPDT Switching Elements C6 = 1SPDT Adjustable Differential Please refer to page nos. 120 & 121 for options and specifications of microswitches * Please contact sales office for additional information</div>	<div>S1 = SS316 / 1/4" BSP(F) S2 = SS316 / 1/4" NPT(F)</div>	<div>0 = Neoprene 1 = PTFE</div>												
<div>Approx. switch weight in Kgs</div> <table><tr><td>Enclosure</td><td>FC</td><td>FE</td></tr><tr><td>Aluminium</td><td>2.250</td><td>1.750</td></tr><tr><td>Grey CI</td><td>4.650</td><td>4.150</td></tr><tr><td>SS</td><td>4.730</td><td>4.250</td></tr></table>			Enclosure	FC	FE	Aluminium	2.250	1.750	Grey CI	4.650	4.150	SS	4.730	4.250	<div>For additional wetted parts please contact Sales Office</div>				
Enclosure	FC	FE																	
Aluminium	2.250	1.750																	
Grey CI	4.650	4.150																	
SS	4.730	4.250																	


eg. A flameproof switch for gas group IIC, with 1/2" NPT cable entry in aluminium housing as 1SPDT pressure switch, having 0.1 bar to 1 bar pressure range, with 15 Amp. microswitch, SS316 pressure housing with 1/4" BSP port size & neoprene diaphragm shall be specified by

Group 1	Group 2	Group 3	Group 4	Group 5	Group 6	Group 7	Group 8
<input type="checkbox"/>	FC	1	D1	L03	A1	S1	0

Please specify full model number to avoid ambiguity. If only the first two groups are specified while ordering, uncalibrated switches with standard wetted parts and enclosures will be supplied.



Documents / Resources

	<p>Orion INSTRUMENTS KA231020 FC and FE Low Range Pressure Difference Switches [pdf]</p> <p>] Owner's Manual</p> <p>KA231020, KA231020 FC and FE Low Range Pressure Difference Switches, FC and FE Low Range Pressure Difference Switches, FE Low Range Pressure Difference Switches, Low Range Pressure Difference Switches, Pressure Difference Switches, Difference Switches, Switches</p>
---	---

References

- [User Manual](#)

Manuals+, Privacy Policy

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.