



# Ornicom FF767 Intrinsically Safe Flame Detector Installation Guide

[Home](#) » [Ornicom](#) » Ornicom FF767 Intrinsically Safe Flame Detector Installation Guide 

## Contents

- 1 Ornicom FF767 Intrinsically Safe Flame Detector
- 2 Product Information
- 3 Product Usage Instructions
- 4 General
- 5 Introduction to Intrinsic Safety
- 6 Classification of Hazardous Areas
- 7 Equipment Markings
- 8 CENELEC / IEC
- 9 Intrinsically Safe Products
- 10 System Design
- 11 Types of Safety Barrier
- 12 Approved Safety Barriers
- 13 Cable Parameters
- 14 Maximum Cable Lengths
- 15 Special Conditions of Use
- 16 IS System Drawing
- 17 EC Declaration of Conformity
- 18 Documents / Resources
  - 18.1 References

# ORNICOM

**Ornicom FF767 Intrinsically Safe Flame Detector**



## Product Information

### Specifications:

- **Equipment Categories:** Group II
- **Type of Explosive Atmosphere:** Gas, vapour, mist
- **Protection Level:** Intrinsic safety (ia)
- **Temperature Class:** T4
- **Gas Group:** IIC

## Product Usage Instructions

### Introduction to Intrinsic Safety

Flame detectors designed for hazardous areas in petroleum and chemical engineering plants ensure safety by being intrinsically safe. They operate at low power levels and are incapable of causing ignition under normal conditions or in the presence of faults.

### Equipment Markings

Look for the CE Marking and ATEX symbol to ensure compliance with EU Directive 94/9/EC. The equipment is categorized under Group II for gas, vapour, mist atmospheres with high levels of protection.

### Equipment Protection Level (EPL)

These Flame Detectors are approved under the protection code is (Intrinsic safety) for use in potentially explosive atmospheres where gases, vapours, or mists may be present.


### FAQ:

- Q: Are the flame detectors suitable for explosive dust atmospheres?

A: No, the detectors are not certified for explosive dust atmospheres. They are specifically designed for gas, vapour, and mist atmospheres.

## General

This Installation Guide gives information on the intrinsically safe (I.S.) version of the flame detectors that have been approved by BASEEFA (British Approvals Service for Electrical Equipment in Flammable Atmospheres). The requirements of the European Community Directive 94/9/EC, the Atmosphere Explosives ATEX Directive have been met. The approval has been assessed to European Standards EN 60079-0, EN 60079-11 and EN 60079-26.

The detectors are certified  II 1G Ex ia IIC T4 Ga and can be used with all listed gases. The range comprises single infra-red (IR), dual infrared (IR<sup>2</sup>) and triple infra-red (IR<sup>3</sup>) flame detectors. The detector housings are available in zinc metal alloy or stainless steel and also stainless steel (antistatic) glass-filled polycarbonate. The guide also provides information on intrinsic safety, the application, maintenance, installation and adjustments of the detectors. Reference to other individual detector publications can be made for more information on intrinsic safety issues. These publications are available on request.

Information in this guide is given in good faith, but the manufacturer cannot be held responsible for any omissions or errors. The company reserves the right to change the specifications of products at any time and without prior notice.

## Introduction to Intrinsic Safety

There are many places where an explosive mixture of air and gas or vapour is or may be present continuously, intermittently or as a result of an accident. These are defined as hazardous areas by EN 60079-0, Electrical apparatus for potentially explosive atmospheres – General requirements.

Hazardous areas are common in petroleum and chemical engineering plants and in factories processing and storing gases, solvents, paints and other volatile substances.

Electrical equipment for use in these areas needs to be designed so that it cannot ignite an explosive mixture, not only in normal operation but also in fault conditions. There are several methods available to achieve this – oil immersion, pressurised apparatus and powder filling, for example, but the two most commonly used are flameproof enclosures and intrinsic safety. Flameproof equipment is contained in a box so strong that an internal explosion will neither damage the box nor be transmitted outside the box. The surface must remain cool enough not to ignite the explosive mixture. When flameproof equipment is interconnected, flameproof wiring must be used. This method is most valuable when high power levels are unavoidable but it is not acceptable for areas in which an explosive gas/air mixture may be continuously present or present for long periods.

For this reason, these flame detectors are made intrinsically safe rather than flameproof. Intrinsically safe equipment operates at such low power and with such small amounts of stored energy that it is incapable of causing ignition:

- In normal conditions
- With a single fault (for ib type of protection code)
- With any combination of two faults (for ia type of protection code)

In any of these conditions, every component must remain cool enough not to ignite gases for which it is approved. See Table 2


## Classification of Hazardous Areas

EN 60079-0 states that electrical apparatus for potentially explosive atmospheres is divided into:

- **Group I:** Electrical apparatus for mines susceptible to fire dampness;
- **Group II:** Electrical apparatus for places with a potentially explosive atmosphere, other than mines susceptible to firedamp.

These flame detectors are designed to meet the requirements of Group II apparatus. For the type of protection “i” intrinsically safe, Group II is subdivided into Equipment Categories, Type of Explosive Atmosphere (Table 1), Type of Protection Code (Table 2), Temperature Class (Table 3) and Gas Group (Table 4).

### Equipment Markings

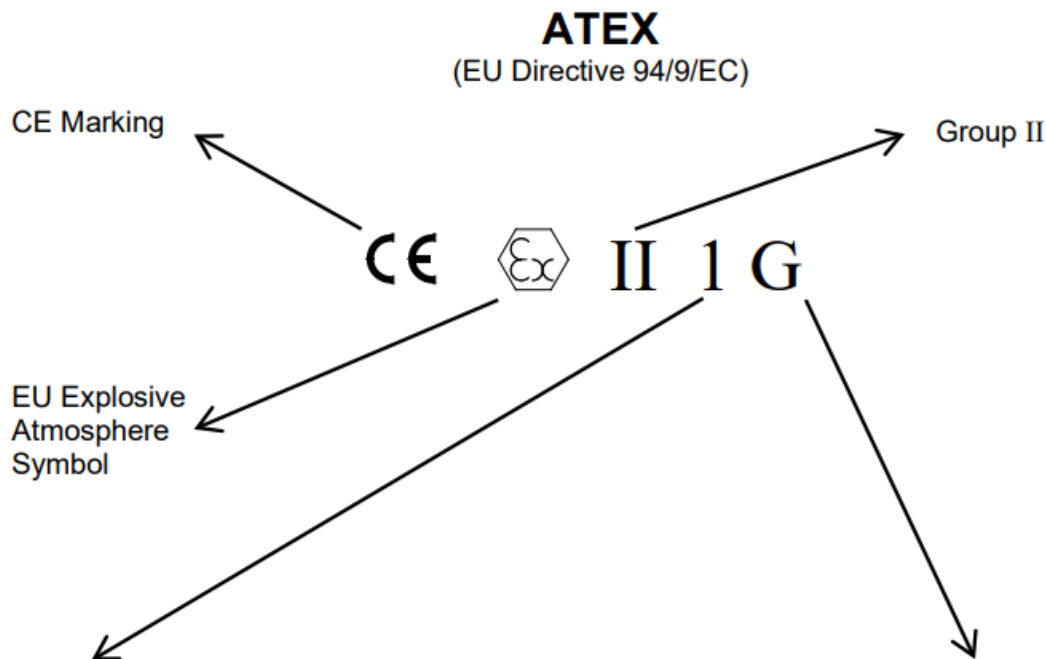

| Equipment  | Definition   | Type of Explosive Atmosphere Group II |
|--|--|---------------------------------------|
| Category   |  | G gas vapour mist                     |
|  |  | Zone                                  |
| 1  | – very high level of protection in which explosive atmosphere mixtures of air gases, vapours or mist are present continuously, for long periods                                    | 0                                     |
| 2  | – high level of protection in which explosive atmosphere mixture of air and gases, vapours or mist are likely to occur   | 1                                     |
| 3  | – normal level of protection in which explosive atmosphere mixtures of air and gases, vapours or mist are unlikely to occur and if it occurs it will exist only for a short period | 2                                     |
| <p>These Flame Detectors are suitable for all the above equipment categories.</p> <p>Note: The detectors are not certified for explosive dust atmospheres.</p> |  |                                       |

Table 1 Equipment Categories and Type of Explosive Atmosphere (Group II)

Equipment  
Protection  
Level (EPL)  
[See EN60079-26]

# Ga Ex ia IIC T4

Explosion Protection  
symbol

| Code                                   | Type of Protection Code | Equipment Category |
|--|-------------------------|--------------------|
| ia                                     | Intrinsic safety        | 1                  |
| ib                                     | Intrinsic safety        | 2                  |
| d                                      | Flameproof              | 2                  |
| These Flame Detectors are approved ia. |                         |                    |

Table 2 Type of Protection Codes

| Temperature Class<br>Referred to<br>ambient of<br>-20°C to +40°C | Maximum<br>Surface<br>Temperature |
|--|-----------------------------------|
| T6   | 85°C                              |
| T5   | 100°C                             |
| T4   | 135°C                             |
| T3   | 200°C                             |
| T2   | 300°C                             |
| T1   | 450°C                             |
| Detectors approved to T4 at 40°C                                 |                                   |


Table 3 Temperature Classification

| Gas Group  | Representative Gas | Other Gases, Liquids, Vapours                 |
|--|--------------------|---|
| IIC  | Hydrogen           | Acetylene, Carbon Disulphide                  |
| IIB  | Ethylene           | Diethyl ether, Tetrafluoroethylene            |
| IIA  | Methane            | Butane, Methanol, Petroleum, Propane, Styrene |
| These Flame Detectors are approved IIC for listed gases in EN 60079-0. |                    |   |

Table 4 Subdivisions of Group II Gases

## Intrinsically Safe Products

- Polycarbonate Housing

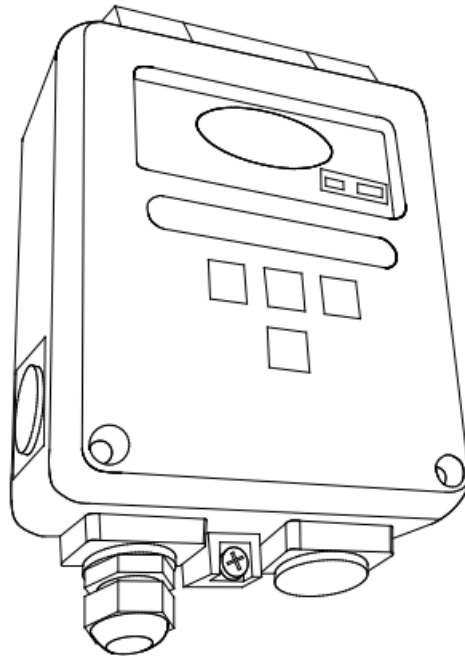

**Intrinsically Safe Flame Detector  
(Polycarbonate Housing)  
Fig. 1**

The flame detectors respond to light emitted from flames during combustion. The detectors discriminate between flames and other light sources by responding only to low frequency flickering produced by flames (typically 1 to 15Hz). The detectors ignore fixed light sources and rapidly flickering illumination predominantly produced by lighting. The flame flicker techniques have the advantage of still allowing the detection of flames through a thin layer of oil, water vapour, ice or dust. This makes these detectors particularly useful in industrial applications.

Full details of the principles of operation, electrical description, and other detailed technical data are published in the products individual data sheet.

- **Technical Data**

- **Mechanical**

|                                      |  |
|--------------------------------------|--|
| Housing Material: See figure 1       | Stainless Steel & Glass Reinforced Polycarbonate |
| Housing Colour:                      | Blue (typical)                                   |
| Housing Dimension: (Excluding Mount) | Height = 148mm Width = 110mm Depth = 63mm        |
| Cable Gland Entries:                 | 4 X 20mm   |


- **Electrical**

|                                  |                         |
|----------------------------------|-------------------------|
| Supply In:                       | Terminals 1(+) & 2(-)   |
| Voltage                          | 14 to 30Vdc             |
| Current                          | 2 to 30mA See data      |
| Polarity sensitive               | sheet for detail        |
| Optional Input:                  | Terminals 3(+) & 4(-)   |
| Voltage                          | 14 to 30Vdc             |
| Current                          | 40µA typ. @ 24V IN      |
| Polarity sensitive               |                         |
| Optional Output:                 | Terminals 3(+) & 4(-)   |
| Voltage                          | 0V to Supply In (O/C)   |
| Internally Limited Current       | 2.4mA typ.              |
| Optional Relays Contact Ratings: | Terminals 3 to 8        |
| Resistive Voltage                | 30Vdc. Max. 1 Amp. Max. |
| Loads Only Current               |                         |

• **Environmental**

|                                     |                    |
|-------------------------------------|--------------------|
| Operating Ambient Temperature:      |                    |
| Check detector limits               | -20°C to +40°C(T4) |
| <b>ATEX</b> Approval Category       | II 1 G             |
| <b>CENELEC</b> / <b>IEC</b> Marking | Ex ia IIC T4 Ga    |
| Apparatus Certificate Number        | BAS02ATEX1001      |
| System Certificate Number           | Baseefa08Y0078     |

• **Alloy Housing**

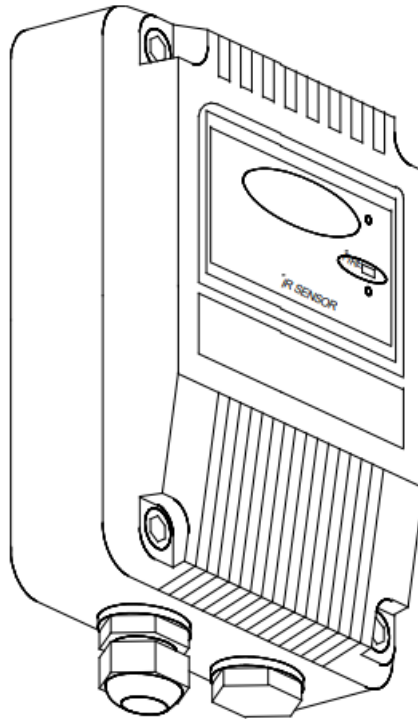

**Intrinsically Safe Flame Detector  
(Alloy Housing)  
Fig. 2**

The flame detectors respond to light emitted from flames during combustion. The detectors discriminate between flames and other light sources by responding only to low frequency flickering produced by flames (typically 1 to 15Hz). The detectors ignore fixed light sources and rapidly flickering illumination predominantly produced by lighting. The flame flicker techniques have the advantage of still allowing the detection of flames through a thin layer of oil, water vapour, ice or dust. This makes these detectors particularly useful in industrial applications. Full details of the principles of operation, electrical description, and other detailed technical data are published in the products individual data sheet.

- **Technical Data**

- **Mechanical**

|  |   |
|--|---|
| Housing Material:<br><br>See figure 2        | Die Cast Zinc Alloy                       |
| Housing Colour:                              | Blue (typical)                            |
| Housing Dimension:<br><br>(Excluding Mounts) | Height = 142mm Width = 108mm Depth = 82mm |
| Cable Gland Entries:                         | 2 X 20mm                                  |

- **Electrical**



|   |  |
|---|--|
| Supply In:<br><br>Voltage Current<br><br>Polarity sensitive                   | Terminals 1(+) & 2(-)<br><br>14 to 30Vdc<br><br>2 to 30mA See data<br><br>sheet for detail |
| Optional Input:<br><br>Voltage Current<br><br>Polarity sensitive              | Terminals 3(+) & 4(-)<br><br>14 to 30Vdc<br><br>40µA typ. @ 24V IN                         |
| Optional Output:<br><br>Voltage<br><br>Internally Limited Current             | Terminals 3(+) & 4(-)<br><br>0V to Supply In (O/C)<br><br>2.4mA typ.                       |
| Optional Relays Contact Ratings: Resistive<br>Voltage Loads Only      Current | Terminals 3 to 8<br><br>30Vdc. Max. 1 Amp. Max.  |

◦ **Environmental**

|   |                    |
|---|--------------------|
| Operating Ambient Temperature:<br><br>Check detector limits | -20°C to +40°C(T4) |
| <b>ATEX</b><br><br>Approval Category                        | II 1 G             |
| <b>CENELEC / IEC</b><br><br>Marking                         | Ex ia IIC T4 Ga    |
| Apparatus Certificate Number                                | BAS02ATEX1001      |
| System<br><br>Certificate Number                            | Baseefa08Y0078     |

## System Design

Engineers familiar with codes of practice for hazardous area systems should only undertake the design of an intrinsically safe fire detection system. In Europe the standard is EN 60079-0, Electrical apparatus for potentially

explosive atmospheres – General requirements. The fire detector performance is the same as the standard none intrinsically safe counterparts. Performance information given in standard product guides is therefore applicable to the intrinsically safe range. The BASEEFA certification of the intrinsically devices covers their characteristics as components of an intrinsically safe system. This indicates that the flame detectors can be used with a margin of safety in such systems.

In safe area (standard) applications it is sometimes desirable to connect the wiring as a loop, with both ends terminated at the control panel. In the event of an open-circuit fault it is then possible to drive both ends simultaneously. In a hazardous area it is not possible to use a loop configuration because the potential to feed power from each end of the loop would double the available energy in the hazardous area and contravene the energy limitations of the intrinsically safe certification. All circuits must therefore be connected as spurs from the safe area or as radial connections from the control panel.

The 016XXX series of Intrinsically Safe Flame Detectors (Sensors) has been assessed as an Intrinsically Safe System by Baseefa as defined in EN 60079-25 for Category ia, Group IIC and Temperature Class T4. See system certificate number Baseefa08Y0078.

## **Types of Safety Barrier**

The system configuration can for three types of safety barrier, each of which has its own advantages and disadvantages. A brief outline of the characteristics is given below.

### **28V/300Ω Barrier**

This is the most basic type of barrier and therefore the lowest cost. Being passive devices, they also impose the minimum of restrictions on the operation of the flame detectors. Thus, single-channel barriers are available either as positive or negative polarity where the polarity refers to the polarity of the applied voltage relative to earth. The significance of this is that one side of the barrier must be connected to a high-integrity (safety) earth. Although this connection has no effect on the operation of the flame detector and is not needed for their correct operation, it may not be acceptable to the operation of the control and indicating equipment. This is particularly true if the control equipment incorporates earth-leakage monitoring and even without this feature the earthing of the loop may cause unwanted cross-talk between loops.

If the earth connection is not acceptable then the A.C. or isolating barriers should be used.

### **Star-connected A.C. Barrier**

A.C. barriers are also passive devices and must still be connected to a high-integrity safety earth. However, they are designed to allow either positive or negative voltages concerning earth and under normal conditions provide a connection to earth via a reverse-diode, rather than directly.

The disadvantage of this type of barrier is that the end-to-end resistance is nominally 1200 ohms compared with the 300 ohms of the single channel type. This high resistance results in an extra voltage drop in the circuit. This type of barrier is not recommended for general use.

### **Galvanically Isolated Barrier**


Galvanically isolated barriers (also known as transformer-isolated barriers) differ from conventional shunt zener barriers in that they provide electrical isolation between the input (safe area) and the output (hazardous area). This is achieved by the use of a D.C./D.C. converter on the input side, which is connected to the hazardous area through a voltage and power-limiting resistor/zener combination similar to a conventional barrier.

The galvanic isolation technique means that the circuit does not need a high integrity (safety) earth and that the intrinsically safe circuit is fully floating. Earth leakage problems for control and indicating equipment are therefore eliminated if this type of interface is used. Galvanically isolated barriers are widely used with conventional flame detector systems. If the system is of an addressable type with signal pulses on the supply lines then the response time of most standard barriers will be too slow to allow their use. In these applications, special galvanically isolated barriers are required that can freely transmit the required protocol pulses without introducing severe voltage drops. These interfaces are available as single or dual-channel versions and are recommended for any application in which direct earth connections are not acceptable.

The galvanically isolated barrier is a two-wire device that does not need an external power supply. The current drawn from the detector supply connections by the barrier itself is less than 500µA.

## Approved Safety Barriers

For systems a generic specification for the barriers is as follows. Any non-isolating zener safety barrier is certified and approved to meet the ATEX Directives or CENELEC / IEC standards.

|                         |  |
|-------------------------|--|
| ATEX group and category |  II (1) G |
| CENELEC / IEC marking   | [Ga Ex ia] II C<br>(associated apparatus)  |

Having the following or lower output parameters.

- Max. output volts  $U_o = 28V$
- Max. output current  $I_o = 93mA$
- Max. output power  $P_o = 0.65W$

A number of barriers meet this specification and examples are given below.

| Supplier  | Type           | Channels | Technique           | Certificate   |
|---|----------------|----------|---------------------|---------------|
| Pepperl & Fuchs Ltd. 77 Ripponden Road, Oldham, Lancs. OL2 8PF UK<br><a href="http://www.pepperl-fuchs.com">www.pepperl-fuchs.com</a> | Z728 Z779      | 1        | 300W Barrier        | BAS01ATEX7005 |
|   | KFD0-CS-Ex1.51 | 2        | 300W Barrier        | BAS01ATEX7005 |
|   | KFD0-CS-       | 1        | Isolator            | BAS98ATEX7343 |
|   | Ex2.51         | 2        | Isolator            | BAS98ATEX7343 |
| MTL<br>Power Court, Luton, Bedfordshire LU1 3JJ UK<br><a href="http://www.mtl-inst.com">www.mtl-inst.com</a>                          | MTL7028+       | 1        | 300W Barrier        | BAS99ATEX7285 |
|   | MTL7728+       | 1        | 300W Barrier        | BAS01ATEX7217 |
|   | MTL7779+       | 2        | 300W Barrier Active | BAS01ATEX7217 |
|   | MTL7706+       | 1        | 300W 4-20mA O/P     | BAS01ATEX7217 |

Table 5 Examples of permitted safety barriers/isolators:

The terminal parameters for the isolators and barriers permitted by the system certificate are:

| Type   | $U_o$ | $I_o$ | $P_o$ |
|--|-------|-------|-------|
| Z728 Z779<br><br>KFD0-CS-Ex1.51 KFD0-CS-Ex2.5<br>1 MTL7028+ MTL7728+ MTL7779<br>+ MTL7706+ | 28V   | 93mA  | 650mW |
|  | 28V   | 93mA  | 650mW |
|  | 25.2V | 93mA  | 585mW |
|  | 25.2V | 93mA  | 585mW |
|  | 28V   | 93mA  | 650mW |
|  | 28V   | 93mA  | 650mW |
|  | 28V   | 93mA  | 650mW |
|  | 28V   | 93mA  | 650mW |

Table 6 Permitted isolator and barrier terminal parameters.

The above barriers and isolators are to be supplied from apparatus which is unspecified except that it must not be supplied from nor contain in normal or abnormal conditions a source of potential with respect to earth in excess of 253 volts r.m.s. or 253 volts d.c.

### Safety Earth

Single channel and star-connected A.C. safety barriers must be connected to a high integrity earth by at least one and preferably two copper cables, each of cross-sectional area of 4mm<sup>2</sup> or greater. The connection must be such that the impedance from the connection point to the main power system earth is less than one ohm. Intrinsically safe circuits in the hazardous area should be insulated from earth and must be capable of withstanding a 500V RMS A.C. test voltage for at least one minute.

When using armoured or copper-sheathed cables, the armour or sheath is normally isolated from the safe area busbar.

### Apparatus Located in the Hazardous Area

The following may be located in the hazardous area: –

- One or two 016XXX Flame Detectors to certificate BAS02ATEX1001 and coded Ex ia IIC T4 Ga.
- An optional single resistor that has a surface area of greater than 20mm<sup>2</sup> may be connected in the fault relay circuit.

### Interconnecting Cable Parameters

It is not permitted to connect more than one barrier circuit in the hazardous area to any other circuit. There are four different intrinsically safe circuits shown on the system drawings. The stated cable parameters are based on each Power Supply circuit, Remote Test circuit and Relay Output circuit being isolated from each other with no other apparatus (other than the optional resistor across the Relay Output circuit) being connected. For each set of parameters shown below the cable capacitance and either the cable inductance or the cable inductance to resistance ratio (L/R) must not exceed the values shown in table 7. The reason for this is that energy can be stored in a cable and it is necessary to use cable in which energy stored is insufficient to ignite an explosive atmosphere.

### Cable Parameters

When two Flame Detector Power Supply terminal pairs (terminals 1 & 2) or Remote terminal pairs (terminals 3 & 4) are connected to a single circuit from the barriers or isolators listed in table 5 the permitted cable parameters are as shown in table 7.

| Group       | Capacitance – $\mu\text{F}$                | Inductance – mH | L/R Ratio – $\mu\text{H}/\text{ohm}$ |
|-------------|--|-----------------|--------------------------------------|
| IIC IIB IIA | 0.023 $\mu\text{F}$ (0.053 $\mu\text{F}$ ) | 4.2mH           | 54 $\mu\Omega$                       |
|             | 0.59 $\mu\text{F}$ (0.62 $\mu\text{F}$ )   | 12.6mH          | 217 $\mu\Omega$                      |
|             | 2.09 $\mu\text{F}$ (2.12 $\mu\text{F}$ )   | 33.6mH          | 435 $\mu\Omega$                      |

When only a single Flame Detector Power Supply terminal pair (terminals 1 & 2) or Remote Test terminal pair (terminals 3 & 4) is connected to a single circuit from the barrier or isolator listed in table 5 then the capacitance may be increased to the values shown in brackets. The increase in cable capacitance is not affected by the number of Flame Detectors Fire Relay connect terminal pairs (terminals 5 & 6) or Fault Relay contact terminal pairs (terminals 7 & 8) connected to a single circuit.

The above cable parameters are also valid for any non-isolating zener barriers with terminal parameters not exceeding:-

- $U_o = 28\text{V}$
- $I_o = 93\text{mA}$
- $P_o = 650\text{mW}$

**Note:** The flame detectors have zero equivalent inductance ( $L_i = 0$ ) and a 0.03 $\mu\text{F}$  capacitance ( $C_i = 0.03\mu$ ).

### Cables

The interconnections to any of the four intrinsically safe circuit configurations shown on the system drawings may be achieved by separate cables or by separate circuits within a Type A or Type B multicore cable (clause 8 of EN 60079-25) subject to the following:

- Each circuit is to be individually screened within a Type A multicore cable.
- The peak voltage of any circuit within a Type B multicore cable must not exceed 60V, and the cable must be effectively protected against damage.

Only insulated cables meeting the requirements of clause 8 of EN 60079-25 shall be used.

The installation of the system must be done by EN 60079-14.

### Maximum Cable Lengths

The following cable types are considered to be Type B cables suitable for use in the Flame Detector system. The maximum permitted cable lengths when using these cables is shown below:

| Cable Type                            | Core   | Maximum Cable Length |                |                |
|---------------------------------------|--------|----------------------|----------------|----------------|
|                                       |        | IIC                  | IIB            | IIA            |
| AEI Cables 6193Y (BS6004)             | 3      | 379m (620m)          | 5.00km(5.00km) | 5.00km(5.00km) |
| Prysmian FP200Gold 1.5mm <sup>2</sup> | 2 or 4 | 313m (513m)          | 5.00km(5.00km) | 5.00km(5.00km) |
| (Formally Pirelli)                    |        |                      |                |                |
| AEI Cables M.I. ref 7H1.5             | 7      | 213m (350m)          | 3.45km(3.59km) | 5.00km(5.00km) |
| AEI Cables M.I. ref 2L1.5             | 2      | 146m (240m)          | 2.37km(2.46km) | 5.00km(5.00km) |

When only a single Flame Detector Power Supply terminal pair (terminals 1 & 2) or Remote Test terminal pair (terminals 3 & 4) is connected to a single circuit from the barrier or isolator listed in Table 5 then the capacitance may be increased to the values shown in brackets. The increase in cable capacitance is not affected by the number of Flame Detectors Fire Relay connect terminal pairs (terminals 5 & 6) or Fault Relay contact terminal pairs (terminals 7 & 8) connected to a single circuit.

### **Maximum Loading of IS Circuit**

Because of the finite resistance of the safety barrier, there will be a limit to the current drain which can be tolerated before the voltage on the circuit falls outside the specified limits for the IS detector. The standing current for the detectors can be calculated by the sum of the individual selected detector currents as given in the detector datasheet. This will limit the maximum number of detectors per barrier to two.

### **Installation**

The IS detectors must be installed in such a way that all terminals and connections are protected to at least IP20 with the detector cover fitted. The earth bonding terminals are provided for convenience where continuity of a cable sheath or similar is required.

The installation of the system must be done by EN 60079-14.

### **Special Conditions of Use**


The Intrinsically Safe flame detectors use alloy enclosures and therefore must be protected against impact or abrasion if located in an area classified as Zone 0.

### **Protection Against Lightning**

The installer must perform a risk assessment by clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

### **Marking**

The system shall be marked in a “strategic position”, either on or adjacent to the principal item of electrical apparatus, with the following information:

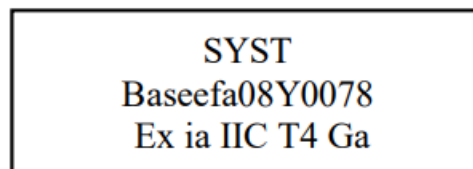


### **Service & Repairs**


Servicing of IS flame detectors may be carried out only by a BASEEFA or equivalent authorised body. In practical terms this means that IS flame detector may be serviced only at the manufactures factory.

Servicing of the fire protection system should be carried out as recommended by the local regulation in force.

### **IS System Drawing**

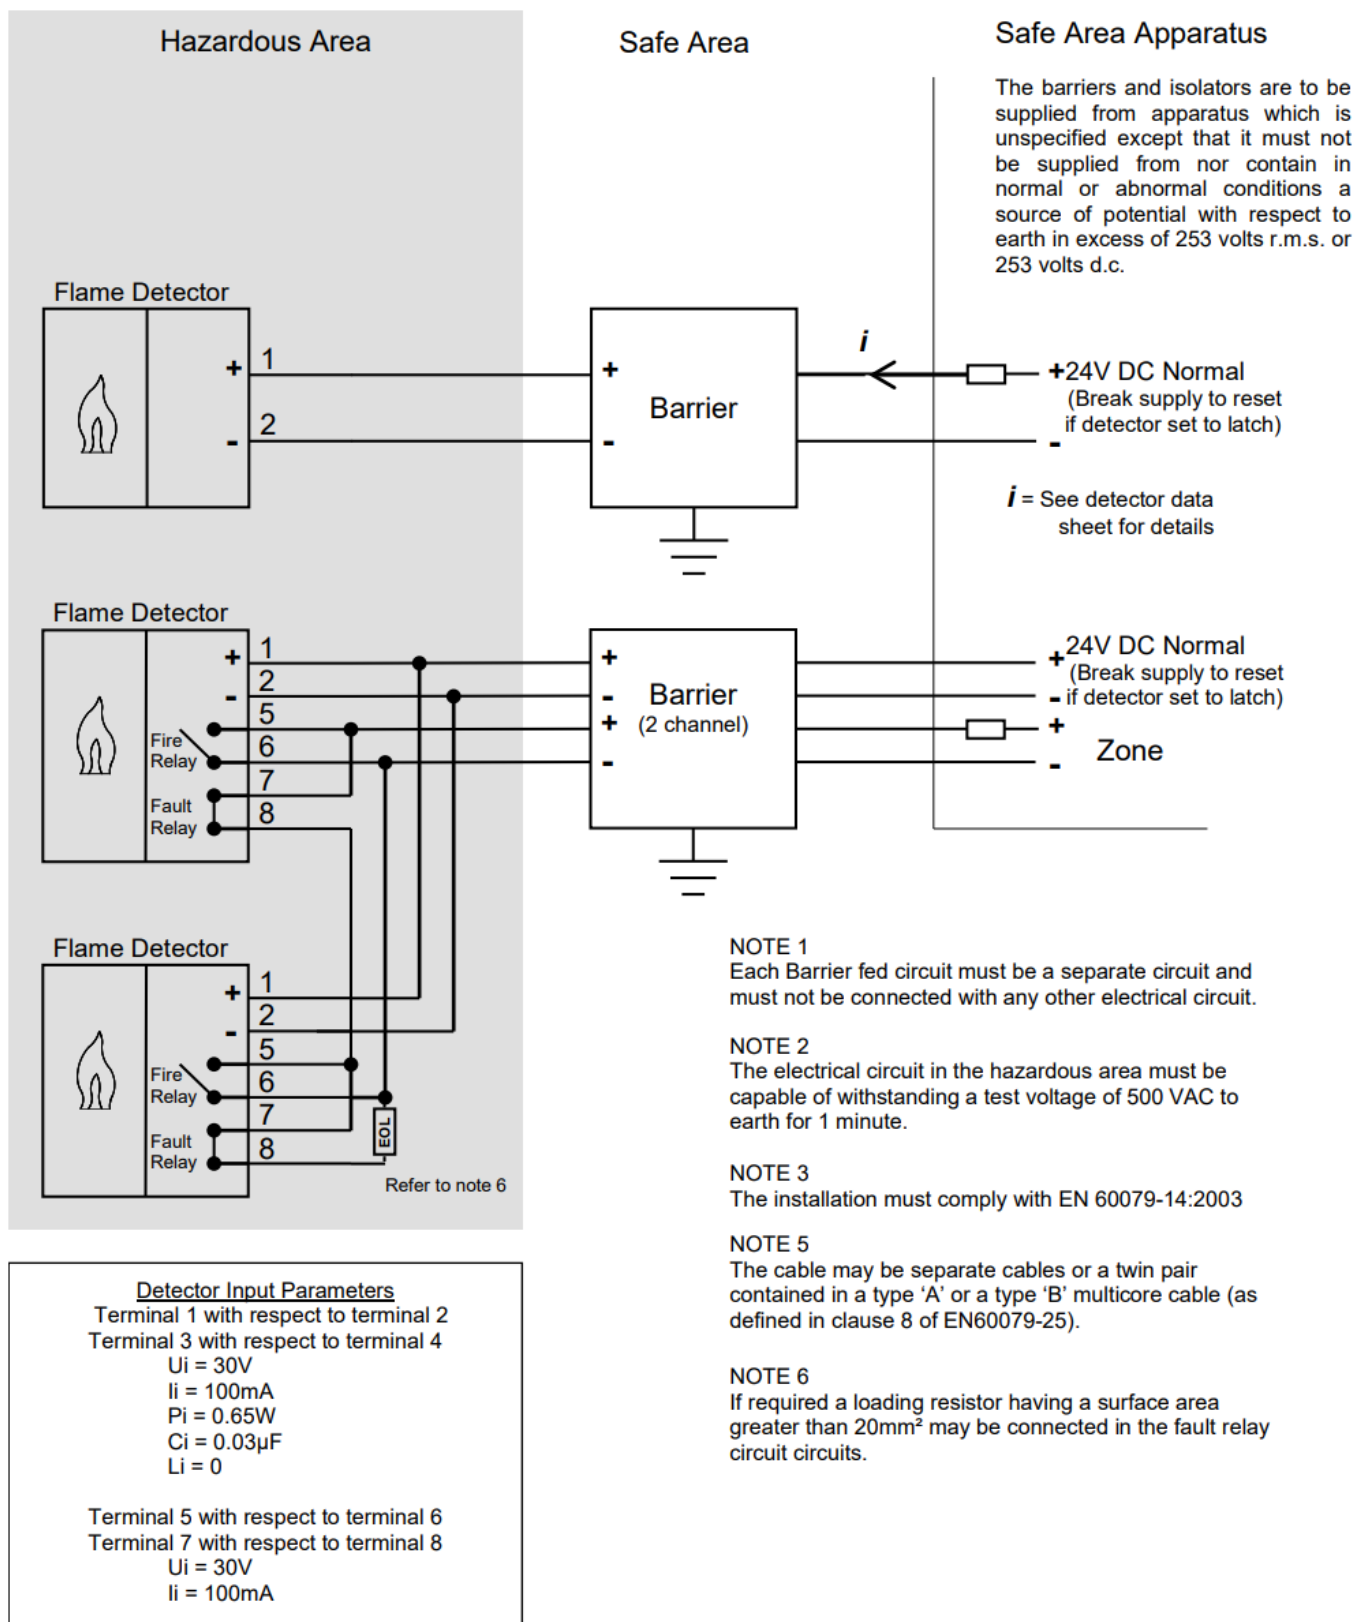

**IS System Drawing with Remote Detector Test Option**

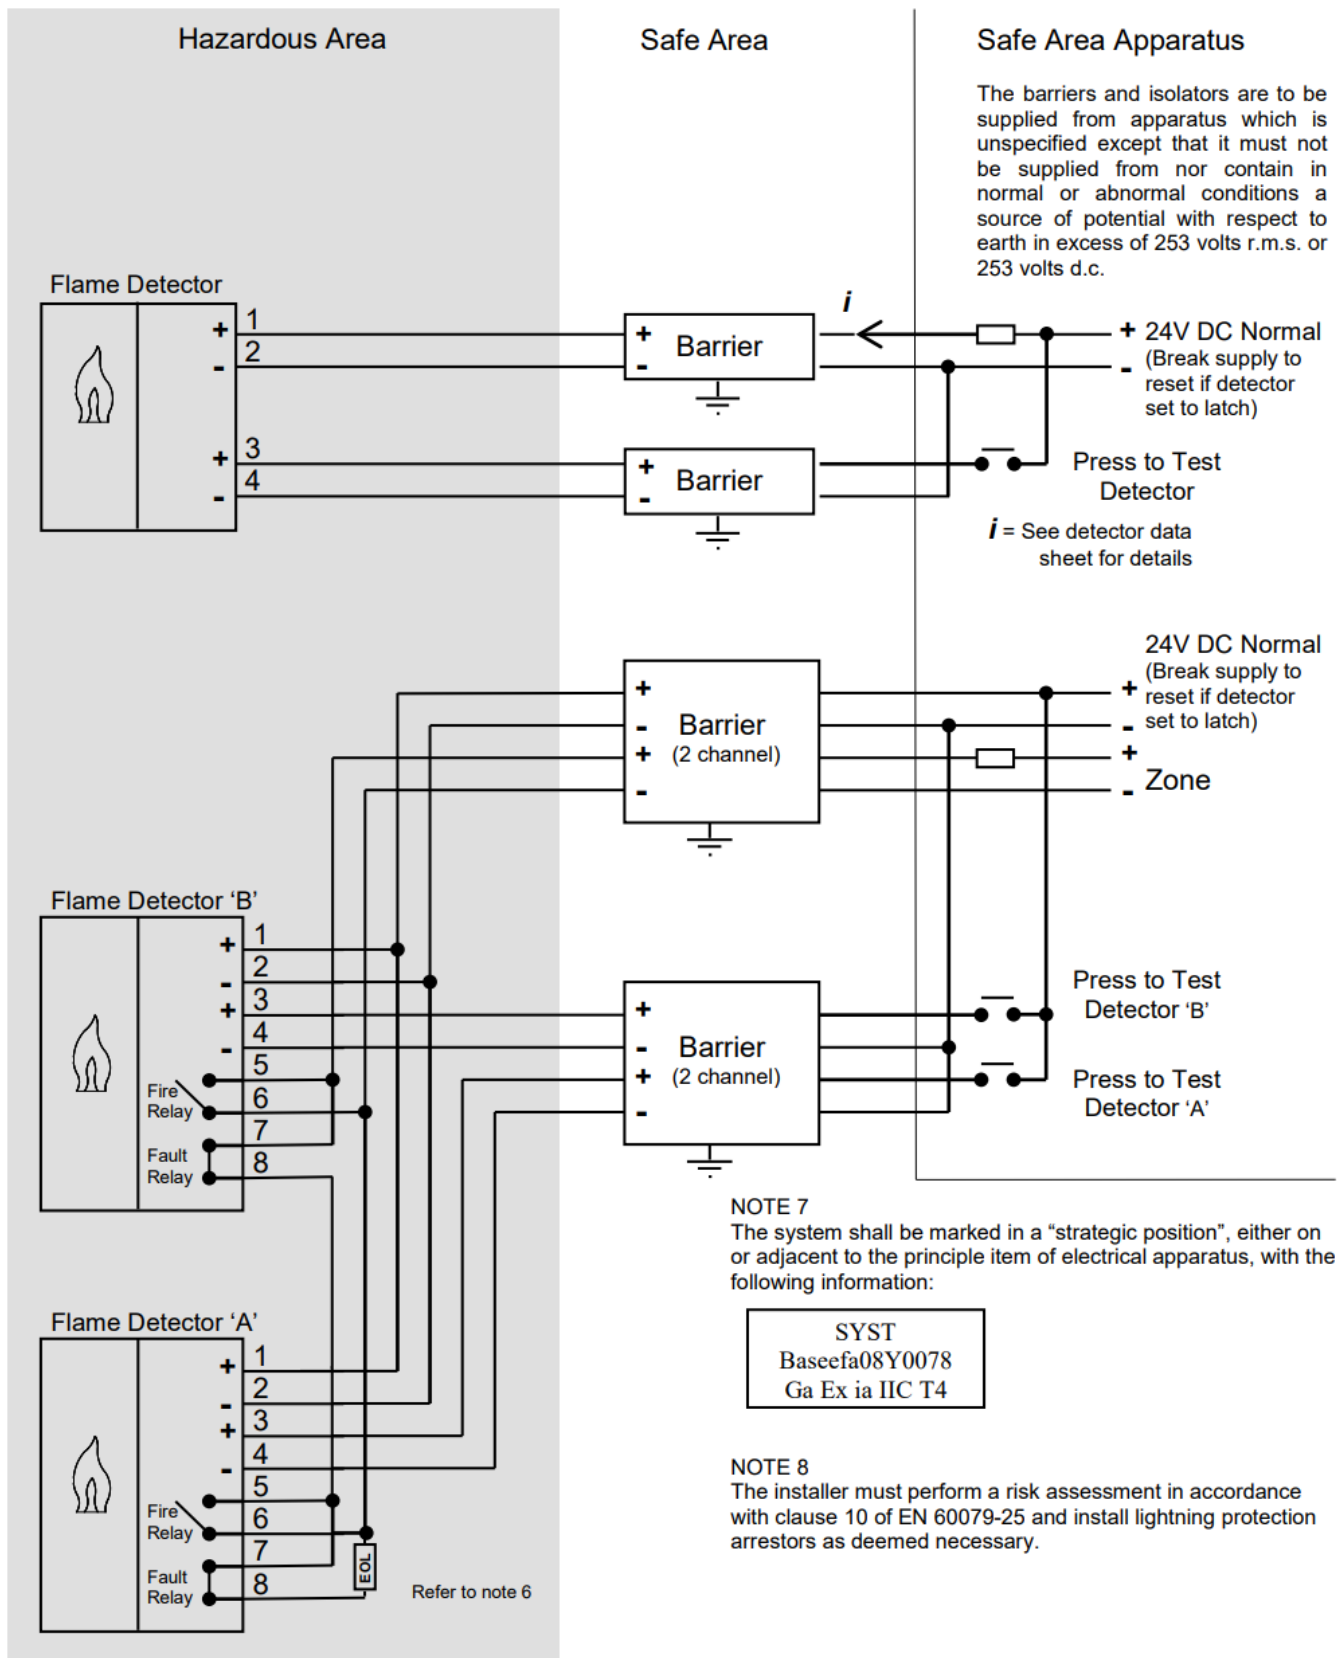

## EC Declaration of Conformity

EMC Directive 2014/30/EU/RoHS2 Directive 2011/65/EU/ATEX Directive 2014/34/EU





Product: The following products are covered by this DoC:  
  
16571 IR2 IS Flame Detector  
16579 IR3 IS Flame Detector

Description: Flame detector – for use in fire detection and alarm systems

Manufacturer: FFE Ltd.,  
9 Hunting Gate,  
Hitchin,  
Hertfordshire,  
SG4 0TJ,  
U.K.

This declaration of conformity is issued under the sole responsibility of the manufacturer. We hereby declare that the FFE manufactured products identified above meets the requirements of the EMC Directive 2014/30/EU, RoHS2 Directive 2011/65/EU and ATEX Directive 2014/34/EU and therefore qualify for free movement within markets comprising the European Union (EU) and the European Economic Area (EEA), by application of the following standards:

|                               |  |
|-------------------------------|--|
| EN 50130-4:2011+A1:2014       | Alarm systems - Part 4: Electromagnetic compatibility - Product family standard: Immunity requirements for components of fire, intruder and social alarm systems |
| EN 61000-6-3:2007<br>+A1:2011 | Electromagnetic compatibility (EMC). Generic standards. Emission standard for residential, commercial and light-industrial environments                          |
| EN 50581:2012                 | Technical documentation for the assessment of electrical and electronic products with respect to the restriction of hazardous substances                         |
| EN 60079-0:2012+A11:2013      | Explosive atmospheres. Equipment. General requirements   |
| EN 60079-11:2012              | Explosive atmospheres. Equipment protection by intrinsic safety 'i'  |
| EN 60079-26:2015              | Explosive atmospheres. Equipment with protection level (EPL) Ga  |

Specific to the ATEX Directive:

|  |  |
|--|--|
| Relevant provisions fulfilled by the equipment:      | II 1G Ex ia IIC T4 Ga  |
| Notified body responsible for Initial Type Testing:  | Baseefa Ltd, Buxton, SK17 9RZ, Notified Body No. 1180                    |
| Notified Body responsible for ongoing production QA: | SIRA Certification Service, Chester, CH4 9JN, UK, Notified Body No. 0518 |
| EC-Type Examination Certificate:                     | BAS02ATEX1001/3X   |

For and on behalf of FFE Ltd:

Print Name: JACOB ANDELIN

Signed:   
Position: TECHNICAL DIRECTOR

Date: 9/11/16

9 Hunting Gate  
Hitchin  
Hertfordshire  
SG4 0TJ UK  
T. +44 (0) 1462 444740  
F. +44 (0) 1462 444789  
E. [sales@ffeuk.com](mailto:sales@ffeuk.com)

Documents / Resources

|   |  |
|---|--|
|  | <a href="#">Ornicom FF767 Intrinsically Safe Flame Detector</a> [pdf] Installation Guide<br>FF767 Intrinsically Safe Flame Detector, FF767, Intrinsically Safe Flame Detector, Safe Flame Detector, Flame Detector, Detector |
|---|--|

References

- [Pepperl+Fuchs International. Industrial Sensors, Factory Automation, Process Automation, Intrinsic Safety, Explosion Protection](#)
- [User Manual](#)

[Manuals+](#), [Privacy Policy](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.