



PCI Multi-Trans Smart Ecosystem User Guide

[Home](#) » [PCI](#) » PCI Multi-Trans Smart Ecosystem User Guide 



Multi-Trans Smart Ecosystem

QUICK START GUIDE

PLEASE READ AND FOLLOW ALL INSTRUCTIONS CAREFULLY. FAILURE TO COMPLY WITH THESE INSTRUCTIONS COULD CAUSE DAMAGE TO THE DEVICE!

OVERVIEW

The Multi-Trans Smart Ecosystem (MTSE) is factory configured so it will be ready to read airflow and pressure measurements after following this quick start guide. This guide is intended for the field startups of the MTSE only. The full MTSE Installation, Operation, and Maintenance Manual (IO&M) can be downloaded from PCI's website at www.paragoncontrols.com.



Contents

[1 INSTALLATION CONSIDERATIONS](#)

[2 Documents / Resources](#)

[3 Related Posts](#)

INSTALLATION CONSIDERATIONS

Power Requirements 20 – 28VAC/VDC

Power Consumption 8.5Watts, 15.3VA Max

Analog Outputs (4) 16-bit Analog Outputs Field Selectable 0-10V & 4-20mA

Analog Inputs (4) 12-bit Analog Inputs Field Selectable 0-5V, 0-10V, & 4-20mA

Supported Protocols Modbus RTU Slave, BACnet MS/TP

Max communication length 4000 ft. (EIA-485)

Operating Temperature -20°F to 158°F (-29°C to 70°C)

Do not exceed ratings. Only qualified personnel should perform the installation. Connection code is located on the inside cover.

The MTSE can be custom configured to match most applications to measure, sum, and report up to 5 sensing points in 3 systems (i.e., Supply Air, Return Air, and Outside Air) and 4 additional P points of measurement (i.e., pre-filter, final filter, coils, etc.) for a total of up to 9 sensing points. Depending on how your MTSE was ordered, the system quantity and P quantity will change the appearance of the Main Screen. Shown in the above image is a three-system configuration with no P points of measurement.

INSTALLATION

Before any electrical connections are made, ensure the POWER SWITCH is in the OFF position. The MTSE is rated for either indoor or outdoor installation. When installed outdoors, do not install the MTSE where the screen is in direct sunlight. Avoid locations that are subject to high vibration.

Step 1. Open the cover by unlatching the stainless-steel clasps.

Step 2. Ensure the Power Switch is in the OFF position.

Step 3. Install the interface wiring for the electrical connectors as described below. The electrical connectors have removable terminal blocks for ease of installing the interface wiring. Shielded 24 AWG (min.) twisted-wire cable is recommended for all connections between the MTSE, temperature transmitter, and network communication. The electrical connection code and example of electrical connections are shown below.

– For network communication, connect Pins 31 and 32 (J4) to the positive and negative connectors on the communication device. Ensure that only one side of the shielding wire is connected to EARTH ground at the building network communication device.

– If a loop-powered 4-20mA temperature transmitter (TT) is to be installed for OA, determine which system is OA from the inside label. For System 1 – connect Pins 71 and 81 (J7 and J8) on the MTSE to the positive and negative connectors on the TT, respectively; for System 2 connect Pins 71 and 83, or for System 3 connect Pins 71 and 85. The TT must be connected to the correct pins for temperature compensation of the corresponding system.


– Connect Pins 91 and 92 (J9) for System 1 analog process output to the positive and negative connectors on an analog receiving device; connect Pins 93 and 94 for System 2, and connect Pins 95 and 96 for System 3 (if available).

– Connect Pins 1 and 2 (J1) to a 24 VAC or 24 VDC power supply. Ensure that Pin 3 is used to connect the MTSE to EARTH ground.

Step 4. Connect the total (high) pressure and static (low) pressure ports of the MTSE to the high- and low-pressure ports of the Airflow Measuring Station (or fans if multiple systems) using plenum-rated tubing (by others). Transducers in the MTSE are numbered sequentially; therefore, all connections for System 1 must be made in order starting at sensor 1, and then System 2 will start immediately after the last sensor in System 1, and so on. See label inside cover of MTSE for sensor numbering relative to system tagging. An example of this label is shown below.

Step 5. Turn the Power Switch (S1) to the ON position.


Step 6. Close the cover.

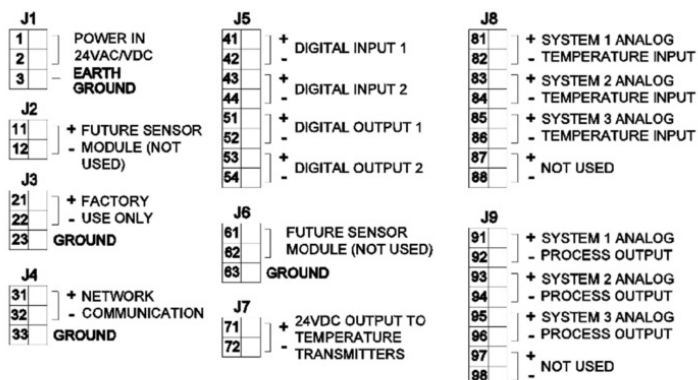

Electrical Connection Code

(LEFT SIDE)		W.O. No.: 12345	(RIGHT SIDE)
LO - HI		SERIAL No.: 6789	HI - LO
• 1 •	•	POWER: 20-28 VAC/DC	• 6 •
• 2 •	•	SYSTEM #1 AHU-1 SA	• 7 •
• 3 •	•	Sensor(s) 1 to 2	• 8 •
• 4 •	•	SYSTEM #2 AHU-1 RA	• 9 •
• 5 •	•	Sensor(s) 3 to 4	
		SYSTEM #3 AHU-1 OA	
		Sensor(s) 5	
		ΔP1 Sensor 6	
		ΔP2 Sensor 7	
		ΔP3 Sensor 8	
		ΔP4 Sensor 9	


Example Inside Label

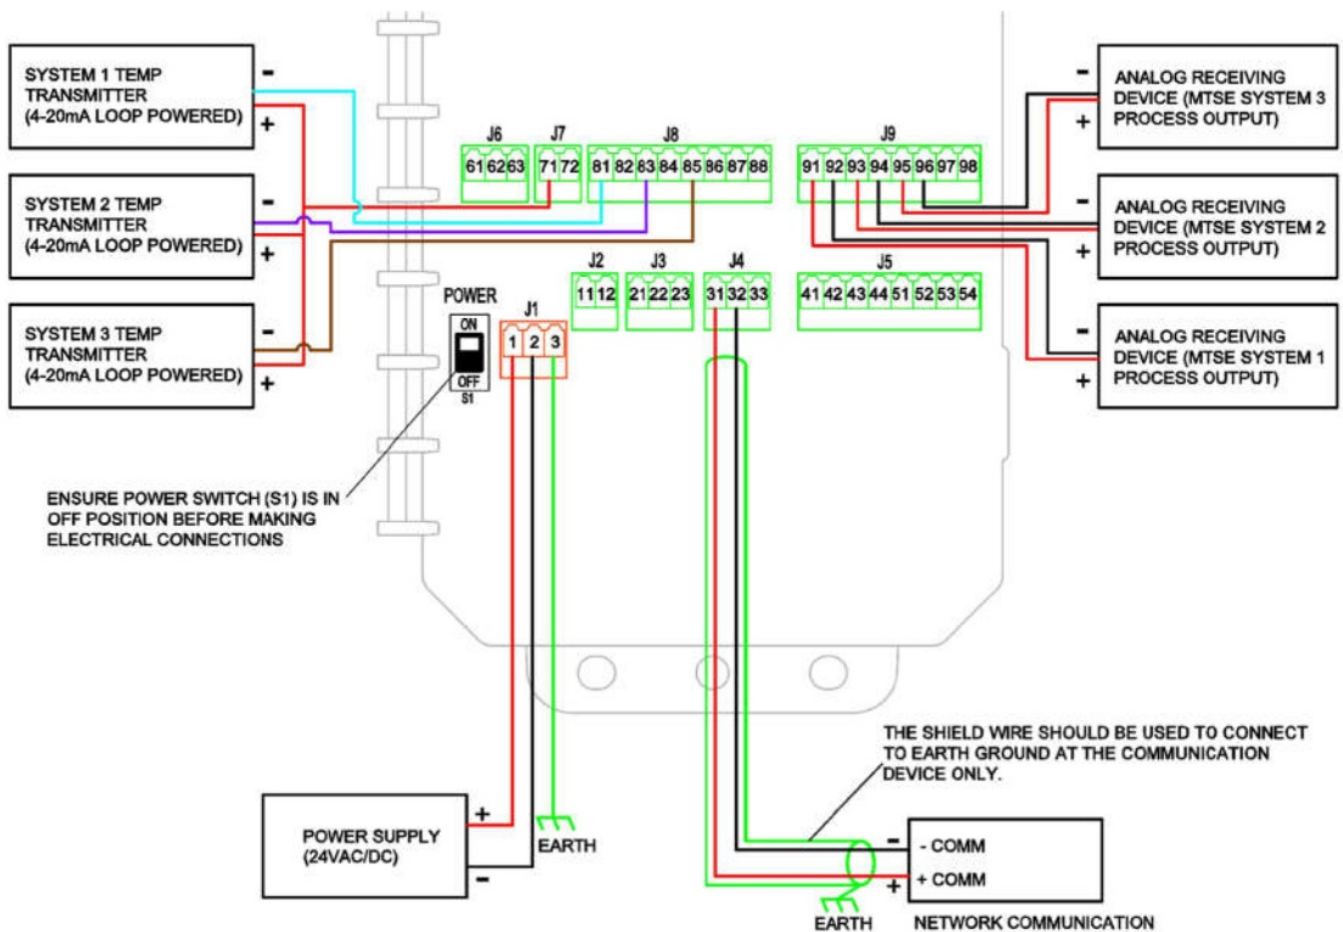

Electrical Connections

STARTUP

Upon power-up, the Main Screen will show how the MTSE was configured for the application. If one system was ordered, only System 1 will be visible on the Main Screen, and if two systems were ordered then System 1 and System 2 will show on the screen, etc. If P points of measurement were ordered, they will appear at the bottom half of the screen as shown to the right is a fully loaded MTSE with 3 systems and 4 P points of measurement.

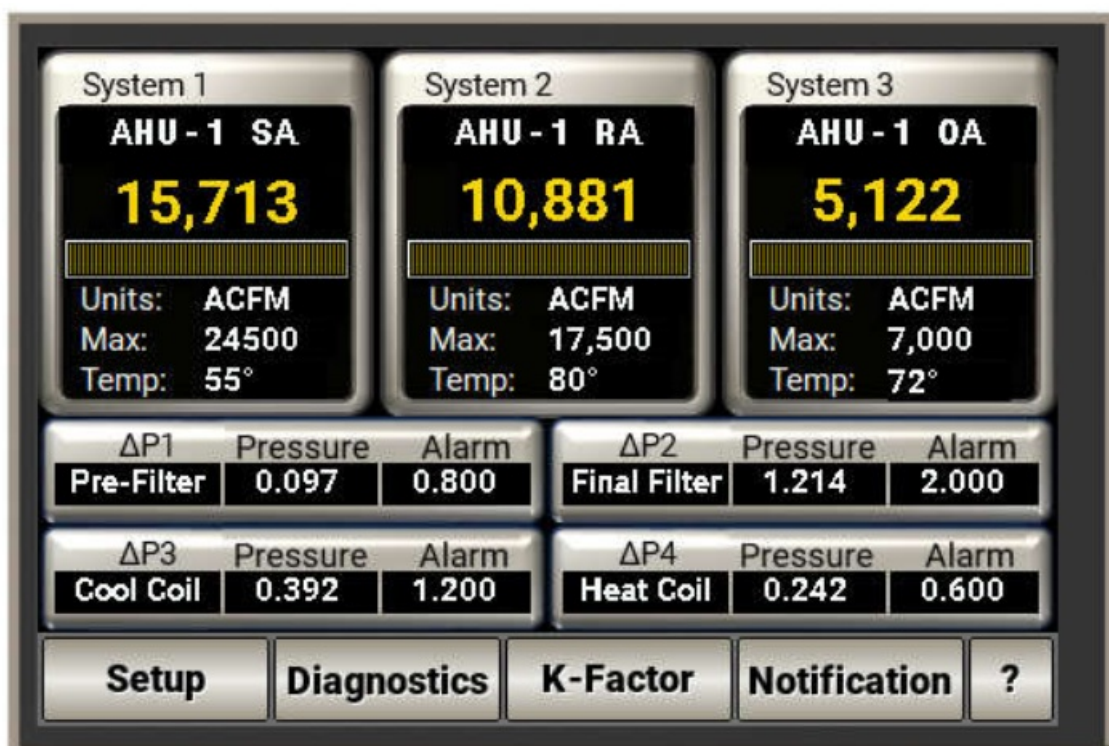

MENU CHANGES

If any values need to be changed, the user can navigate through the Setup Menu to the appropriate screen to make changes by pressing the Setup button on the bottom of the Main Screen. On occasion, system effects will require the MTSE airflow measurement to be corrected with a K-factor to match a balancer or reference airflow rate. See the flow chart of the Setup Menus on page 4 for easy navigation through the Setup Menu or the MTSE Installation, Operation & Maintenance Manual for more information.

PROPER INSTALLATION CHECK PROCEDURE

Upon power up, a form of the Main Screen as discussed in the Startup Section above will appear. A check for proper installation can be made by navigating to the Sensor Data page from the Main Screen by pressing DIAGNOSTICS » SENSOR DATA to confirm individual sensor flow and pressure and then checking the following:


- 1) A negative pressure reading indicates reversed tubing to a sensor (other than a very small negative pressure value from possible zero drift); swap the low and high signal tubing for that sensor number.
- 2) S_Err in the Pressure column indicates a "sensor acknowledge error" from an unresponsive sensor. Cycle power and contact the Factory if this is not resolved.
- 3) If flow and pressure are being displayed on Sensor Data page but there is no system flow displayed on Main Screen, the MTSE is in lockdown for that system; reduce the lockdown percent (SETUP MENU » 7.ALARMS).
- 4) If a single fan in a system array is reading near zero or very different from other fans in the same system, this could indicate either fan failure, closed fan backdraft damper, or a problem with the pneumatics (e.g., kinked or blocked signal tubing, etc.), please check for these issues.


The MTSE is user-friendly with many help screens available in the menus. The "?" button available at the bottom right corner on most pages will provide an explanation of the parameter configurations and available options for each menu selection. The "?" button on the Main Screen shows Factory contact information and firmware revision levels; pressing the right arrow will bring up a series of troubleshooting steps the user should perform before contacting the Factory. Continue pressing the right arrow for additional troubleshooting steps, such as no flow or incorrect flow readings, analog output, and communication issues. Consult Factory for additional information, technical questions, or repair. Do not disassemble or repair the unit unless directed by Factory.

- Sensor Data -				
Sensor #	Fan #	Flow	Pressure	Sensor Status
1	SA-1	10,009	25.073	Normal
2	SA-2	10,003	25.043	Normal
3	RA-1	7,496	14.063	Normal
4	RA-2	7,472	13.974	Normal
5	OA-1	5,002	0.0881	Normal
6	Pre Filter		0.097	Normal
7	Final Filter		1.214	Normal
8	Cool Coil		0.392	Normal
9	Heat Coil		0.242	Normal
<div><div>←</div><div>Zero Single Sensor</div><div>Sensor: 1</div><div>- Enter -</div></div>				

SETUP MENUS

SETUP MENUS

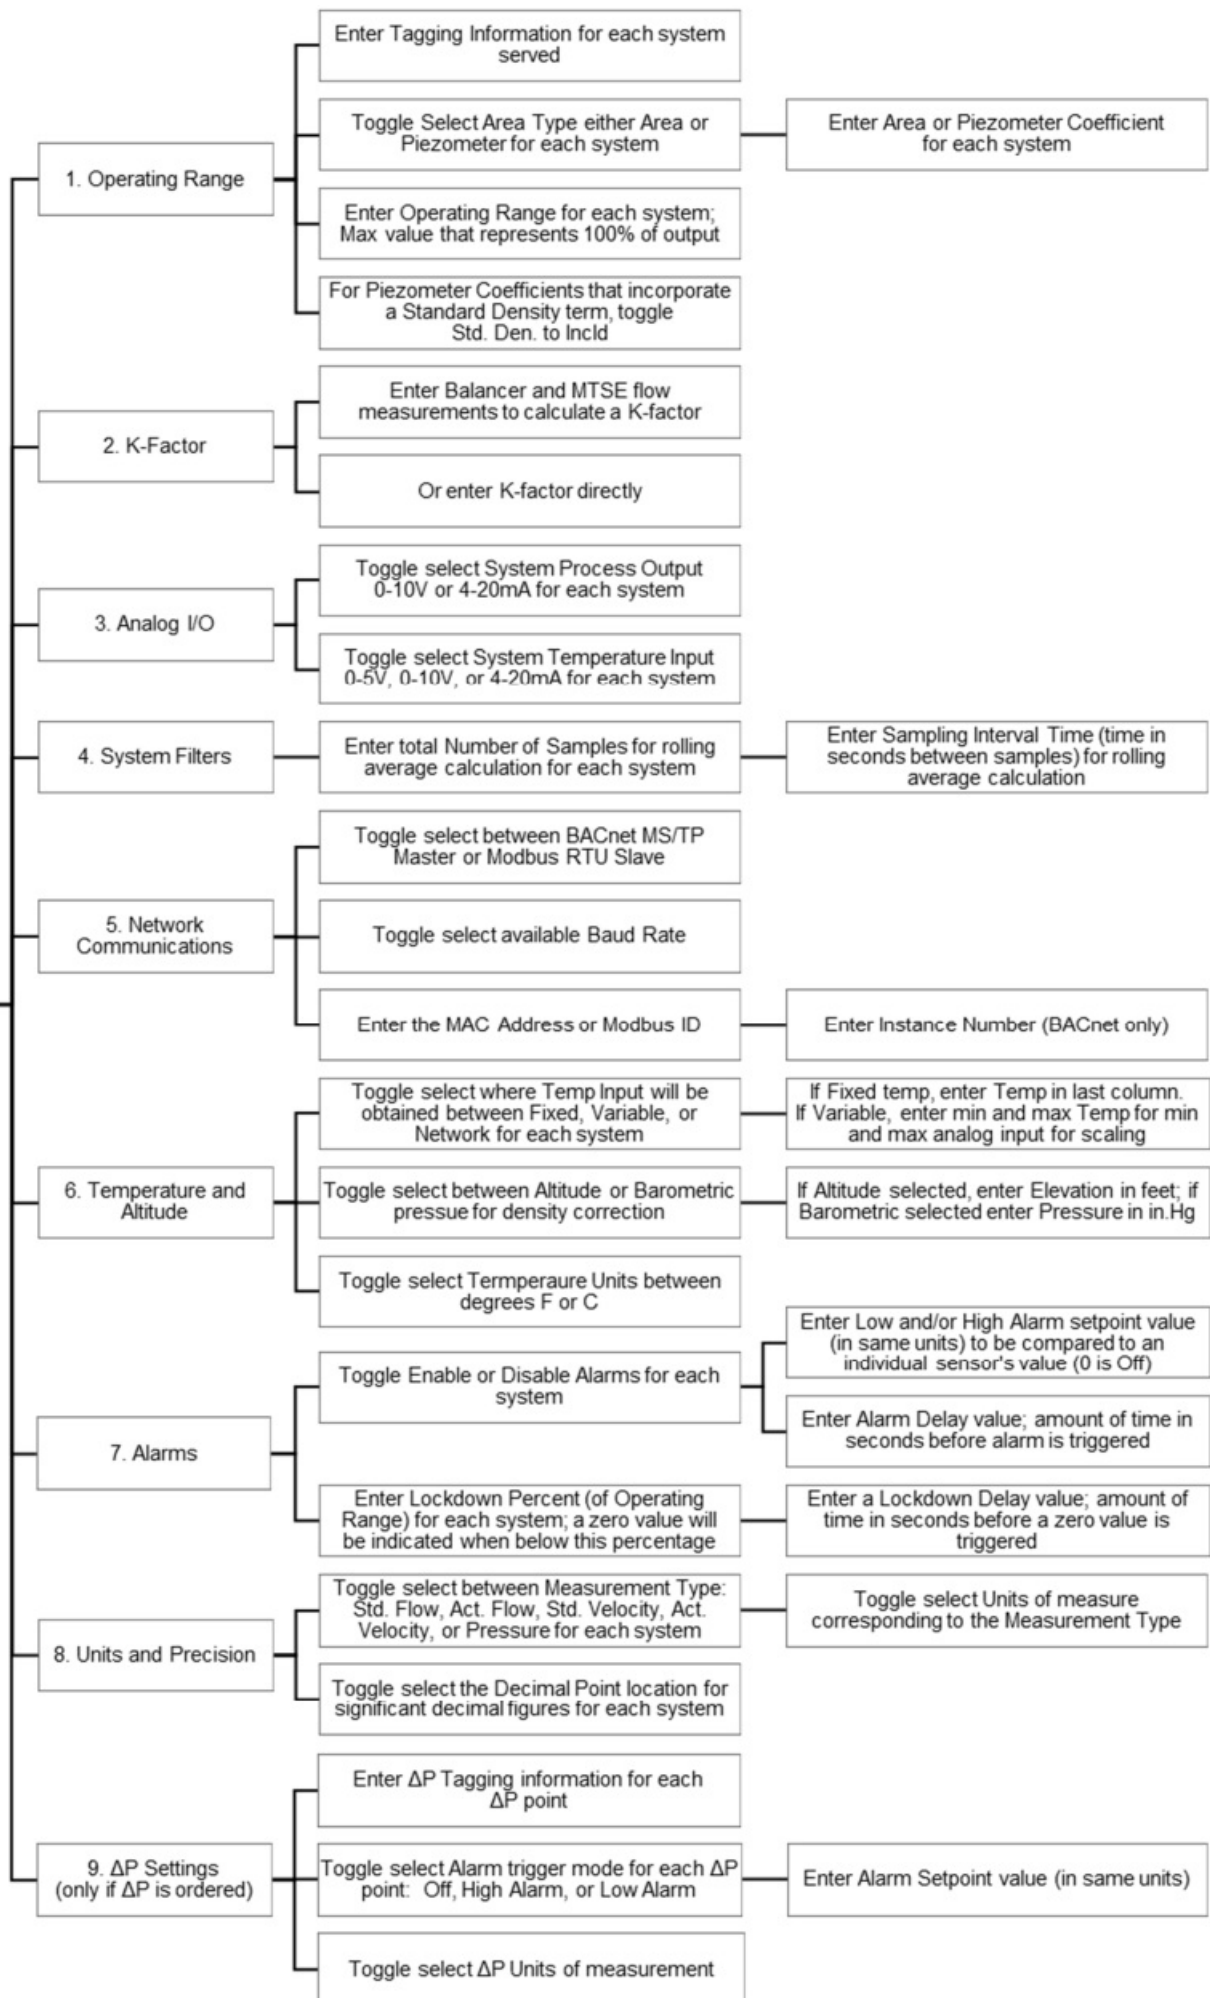

	<p>PCI Multi-Trans Smart Ecosystem [pdf] User Guide</p> <p>Multi-Trans, Smart Ecosystem, Multi-Trans Smart Ecosystem, MTSE</p>
---	--