



# PEAKNX Controlmicro Adapter for the Flush-Mounted Box User Manual

[Home](#) » [PEAKnx](#) » PEAKNX Controlmicro Adapter for the Flush-Mounted Box User Manual 

## Contents

- [1 PEAKNX Controlmicro Adapter for the Flush-Mounted Box](#)
- [2 INSTALLATION INSTRUCTIONS](#)
- [3 Documents / Resources](#)
  - [3.1 References](#)
- [4 Related Posts](#)




**PEAKNX Controlmicro Adapter for the Flush-Mounted Box**




## INSTALLATION INSTRUCTIONS

### Adapter for the flush-mounted box of the Merten Touch Panel 7


- Switch off the power supply and remove your Merten Touch Panel 7 from the flush-mounted box.

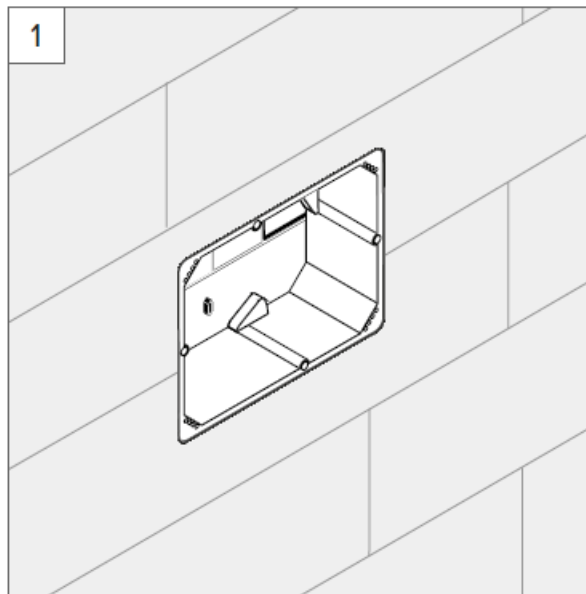


- Fasten the Merten Touch Panel 7 adapter plate to the flush-mounted box using the associated Merten mounting screws.

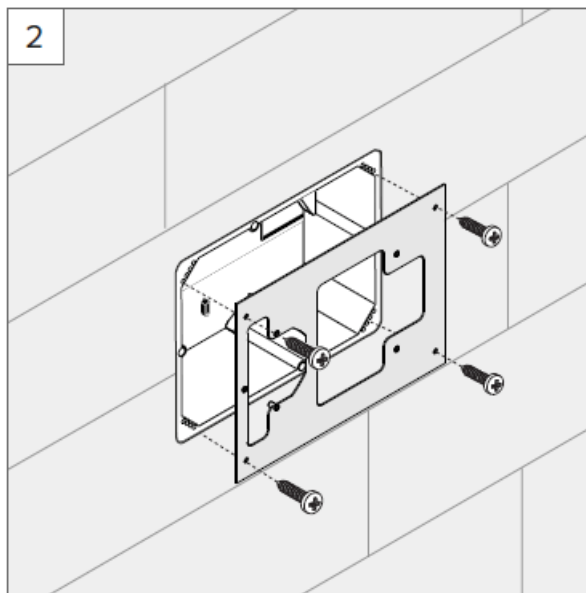


- Plug the 24 V cable wires coming from the power supply unit into the screw terminals (GND, 24 V) of the Controlmicro mounting plate. Connect the KNX and the network cable. Attach the Controlmicro mounting plate to the adapter using the screws provided.

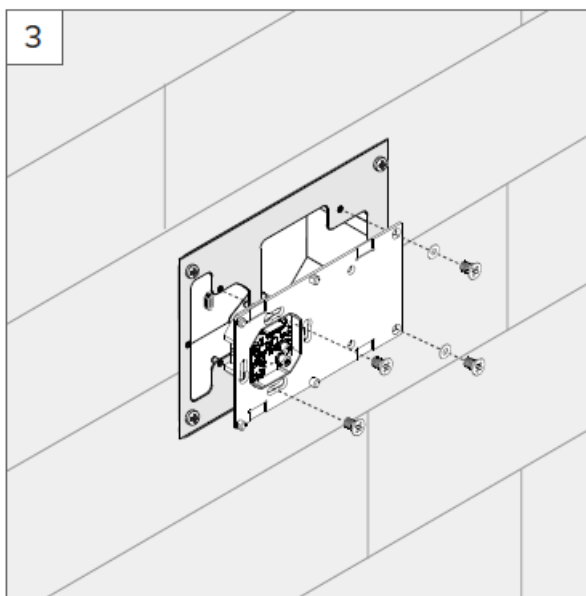

- Insert the panel into the mounting plate and, if necessary, fasten the grub screws to prevent theft.

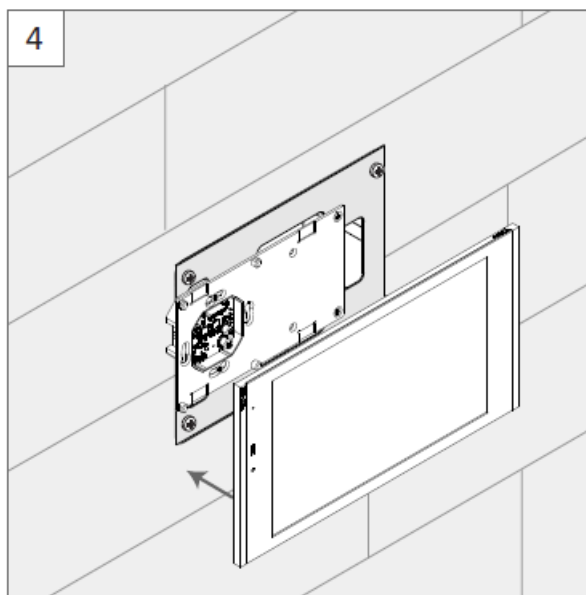

## Documents / Resources

	<p><b><a href="#">PEAKNX Controlmicro Adapter for the Flush-Mounted Box</a></b> [pdf] User Manual Controlmicro Adapter for the Flush-Mounted Box, Controlmicro, Adapter for the Flush-Mounted Box, Adapter, Flush-Mounted Box, Box</p>
---	--

## References

-  **[PEAKNX: Hard- & Software für KNX Smart Homes](#)**