



# POTTER RCDS SERIES Releasing Circuit Disable Switch Owner's Manual

[Home](#) » [POTTER](#) » POTTER RCDS SERIES Releasing Circuit Disable Switch Owner's Manual 

## Contents

- [1 POTTER RCDS SERIES Releasing Circuit Disable Switch](#)
- [2 Features](#)
- [3 Description](#)
- [4 Technical Specifications](#)
- [5 Installation](#)
- [6 Operation](#)
- [7 Potter Electric Signal Company, LLC](#)
- [8 Documents / Resources](#)
- [9 Related Posts](#)



**POTTER RCDS SERIES Releasing Circuit Disable Switch**



## Features

- Meets requirements of NFPA 72 and 2001
- Colored LEDs indicate system status
- Stainless steel plate mounts to single gang box
- **RCDS-1**: key removable in both positions
- **RCDS-2001**: key only removable in enabled position to comply with NFPA 2001
- Compatible with any 24VDC system

## Description

The device consists of a stainless steel faceplate, green LED, amber LED, and a switch assembly. It is designed to mount on a standard single gang electrical enclosure.

## Application

The RCDS-1 complies with the requirements of NFPA 72 (National Fire Alarm and Signaling Code):


The RCDS-2001 complies with the requirements of NFPA 2001 (Standard on Clean Agent Fire Extinguishing Systems):

- Specifying a physical switch to disconnect the release circuit in place of a software-controlled disconnect.
- Creating a supervisory condition on the associated release panel.

## Technical Specifications

Dimensions	2 3/4" W x 4-1/2" H x 2" D (Approximate) Mounts on single gang or handy box
Contact Rating	1 AMP @ 40 VDC
Power Requirements	24 VDC, 10mA
Environmental Specifications	Indoor use only Temperature range -22°F to 140°F (-30°C to 60°C)

## Installation

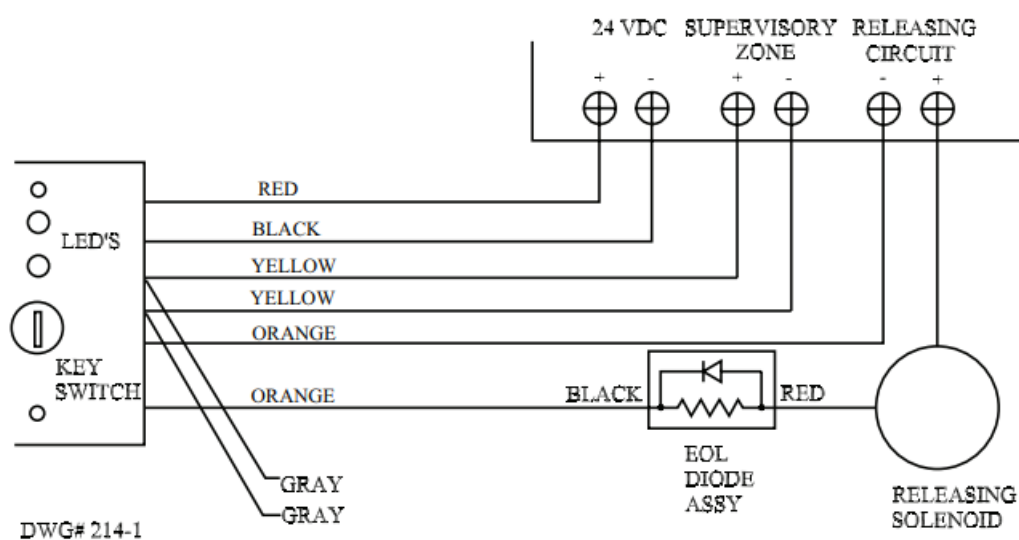

1. Connect the red and black leads to the 24 VDC auxiliary power terminals on the release panel. Be certain to observe polarity.
2. Connect the yellow wires to the supervisory zone on the panel.

## Operation

- The green LED indicates the RCDS is in Normal condition and the release circuit is enabled.
- The amber LED indicates that the release circuit is disabled.

## Ordering Information

Model	Description	Stock No.
RCDS-1	Releasing Circuit Disable Switch	3001002
RCDS-2001	Releasing Circuit Disable Switch (Clean Agent)	3001005


**NOTICE:** The connection for the supervisory circuit has 4 wires: 2 yellow and 2 gray. The 2 yellow wires are for connection to the supervisory circuit. The 2 gray wires are for connection to additional supervisory devices or the EOLR for the supervisory zone.

## Potter Electric Signal Company, LLC

- St. Louis, MO
- **Phone:** 800-325-3936
- [www.pottersignal.com](http://www.pottersignal.com)

[firealarmresources.com](http://firealarmresources.com)

## Documents / Resources

	<p><b><a href="#">POTTER RCDS SERIES Releasing Circuit Disable Switch</a></b> [pdf] Owner's Manual  RCDS SERIES Releasing Circuit Disable Switch, RCDS SERIES, Releasing Circuit Disable Switch, Circuit Disable Switch, Disable Switch</p>
--	---

[Manuals+](#)