

Precedent FIAOVFL001 Drain Pan Overflow Switch Packaged Rooftop Units Instruction Manual

Contents

1 FIAOVFL001 Drain Pan Overflow Switch Packaged Rooftop Units

2 Specifications

3 Parts List

4 FAQs

5 SAFETY INFORMATION

6 Installation

7 Documents / Resources

7.1 References

Precedent

FIAOVFL001 Drain Pan Overflow Switch Packaged Rooftop Units

Specifications

- Model Number: FIAOVFL001*
- Compatibility: T/Y*036-300, W/D/G*036-300
- Capacity: 3 to 25 Tons
- Release Date: September 2024
- Part Number: ACC-SVN242B-EN

Parts List

| Qty | Description |
|-----|---------------------------|
| 1 | Wire tie |
| 1 | Drain pan overflow switch |

FAQs

Q: Can I install this product myself?

A: No, only qualified personnel should install and service the equipment to ensure safety and proper functioning.

SAFETY INFORMATION

WARNING

Only qualified personnel should install and service the equipment. The installation, starting up, and servicing of heating, ventilating, and air-conditioning equipment can be hazardous and require specific knowledge and training. Improperly installed, adjusted or altered equipment by an unqualified person could result in death or serious injury. When working on the equipment, observe all precautions in the literature and on the tags, stickers, and labels that are attached to the equipment.

Inspection

1. Unpack all components of the kit.
2. Check carefully for shipping damage. If any damage is found, report it immediately, and file a claim against the transportation company

Warnings, Cautions, and Notices

Read this manual thoroughly before operating or servicing this unit. Safety advisories appear throughout this manual as required. Your personal safety and the proper operation of this machine depend upon the strict observance of these precautions.

The three types of advisories are defined as follows:

WARNING Indicates a potentially hazardous situation which, if not avoided, could result in death or serious injury.

CAUTION Indicates a potentially hazardous situation which, if not avoided, could result in minor or moderate injury. It could also be used to alert against unsafe practices.

NOTICE Indicates a situation that could result in equipment or property damage only accidents.

Important Environmental Concerns

Scientific research has shown that certain man-made chemicals can affect the earth's naturally occurring stratospheric ozone layer when released to the atmosphere. In particular, several of the identified chemicals that may affect the ozone layer are refrigerants that contain Chlorine, Fluorine and Carbon (CFCs) and those containing Hydrogen, Chlorine, Fluorine, and Carbon (HCFCs). Not all refrigerants containing these compounds have the same potential impact to the environment. Trane advocates the responsible handling of all refrigerants.

Important Responsible Refrigerant Practices

Trane believes that responsible refrigerant practices are important to the environment, our customers, and the air conditioning industry. All technicians who handle refrigerants must be certified according to local rules. For the USA, the Federal Clean Air Act (Section 608) sets forth the requirements for handling, reclaiming, recovering, and recycling certain refrigerants and the equipment that is used in these service procedures. In addition, some states or municipalities may have additional requirements that must also be adhered to for responsible management of refrigerants. Know the applicable laws and follow them.

WARNING

Proper Field Wiring and Grounding Required! Failure to follow the code could result in death or serious injury. All

field wiring **MUST** be performed by qualified personnel. Improperly installed and grounded field wiring poses **FIRE** and **ELECTROCUTION** hazards. To avoid these hazards, you **MUST** follow requirements for field wiring installation and grounding as described in NEC and your local/state/national electrical codes.

WARNING

Personal Protective Equipment (PPE) Required! Failure to wear proper PPE for the job being undertaken could result in death or serious injury. Technicians, in order to protect themselves from potential electrical, mechanical, and chemical hazards, **MUST** follow precautions in this manual and on the tags, stickers, and labels, as well as the instructions below:

- Before installing/servicing this unit, technicians **MUST** put on all PPE required for the work being undertaken (Examples; cut-resistant gloves/sleeves, butyl gloves, safety glasses, hard hat/bump cap, fall protection, electrical PPE, and arc flash clothing). **ALWAYS** refer to appropriate Safety Data Sheets (SDS) and OSHA guidelines for proper PPE.
- When working with or around hazardous chemicals, **ALWAYS** refer to the appropriate SDS and OSHA/GHS (Global Harmonized System of Classification and Labeling of Chemicals) guidelines for information on allowable personal exposure levels, proper respiratory protection, and handling instructions.
- If there is a risk of energized electrical contact, arc, or flash, technicians **MUST** put on all PPE in accordance with OSHA, NFPA 70E, or other country-specific requirements for arc flash protection, **PRIOR** to servicing the unit. **NEVER PERFORM ANY SWITCHING, DISCONNECTING, OR VOLTAGE TESTING WITHOUT PROPER ELECTRICAL PPE AND ARC FLASH CLOTHING. ENSURE ELECTRICAL METERS AND EQUIPMENT ARE PROPERLY RATED FOR THE INTENDED VOLTAGE.**

WARNING

Follow EHS Policies!

Failure to follow the instructions below could result in death or serious injury.

- All Trane personnel must follow the company's Environmental, Health, and Safety (EHS) policies when performing work such as hot work, electrical, fall protection, lockout/tagout, refrigerant handling, etc. Where local regulations are more stringent than these policies, those regulations supersede these policies.
- Non-Trane personnel should always follow local regulations.

WARNING

R-454B Flammable A2L Refrigerant!

- Failure to use proper equipment or components as described below could result in equipment failure, and possibly fire, which could result in death, serious injury, or equipment damage. The equipment described in this manual uses R-454B refrigerant which is flammable (A2L). Use **ONLY** R-454 B-rated service equipment and components. For specific handling concerns with R-454B, contact your local representative.

Copyright

This document and the information in it are the property of Trane, and may not be used or reproduced in whole or

in part without written permission. Trane reserves the right to revise this publication at any time, and to make changes to its content without obligation to notify any person of such revision or change.

Trademarks

- All trademarks referenced in this document are the trademarks of their respective owners.

Revision History

- Used with model number information updated.
- Updated Installation section.


Installation

WARNING

Hazardous Voltage w/Capacitors! Failure to disconnect power and discharge capacitors before servicing could result in death or serious injury. Disconnect all electric power, including remote disconnects and discharge all motor start/run capacitors before servicing. Follow proper lockout/ tagout procedures to ensure the power cannot be inadvertently energized. Verify with a CAT III or IV voltmeter rated per NFPA 70E that all capacitors have discharged.


1. Open and lock the unit disconnect.
2. Detach pipe, P-trap connected to condensate drain opening in the post.
3. Remove the indoor refrigeration coil panel (A), indoor fan panel (B), and heat section panel(s) (C), followed by the vertical post (D) to which these were attached. See Figure 1.

Figure 1. Remove panels and post

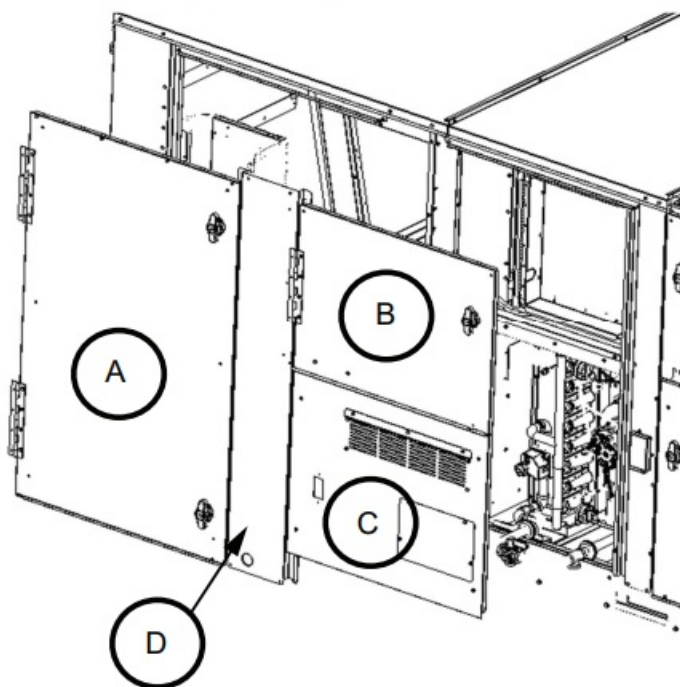

4. Locate drain pan below the evaporator coil. Place the switch in the slot provided in the overflow bracket and tighten nut. See Figure 2. For A, B, and C cabinet units, if the drain pan is set for rear drainage, remove the drain pan from the unit to access overflow mounting location. Attach condensate drain sensor to bracket. Reinstall drain pan.


Figure 2. D cabinet overflow mounting

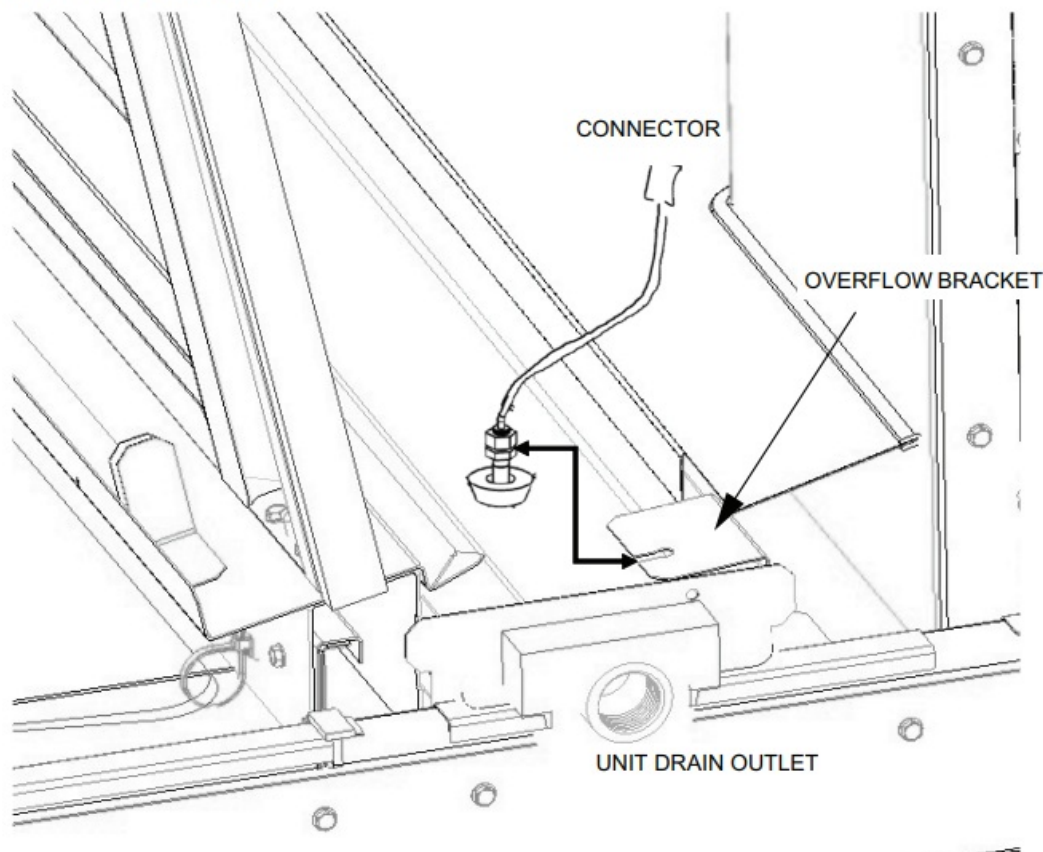

5. The condensate switch bracket needs to be attached in the correct orientation as shown in Figure 3.

Important: Exercise caution while shooting the screw slowly through the opening. The end cap is made of plastic and can develop cracks on rough handling. See Figure 3.

Figure 3. Install bracket

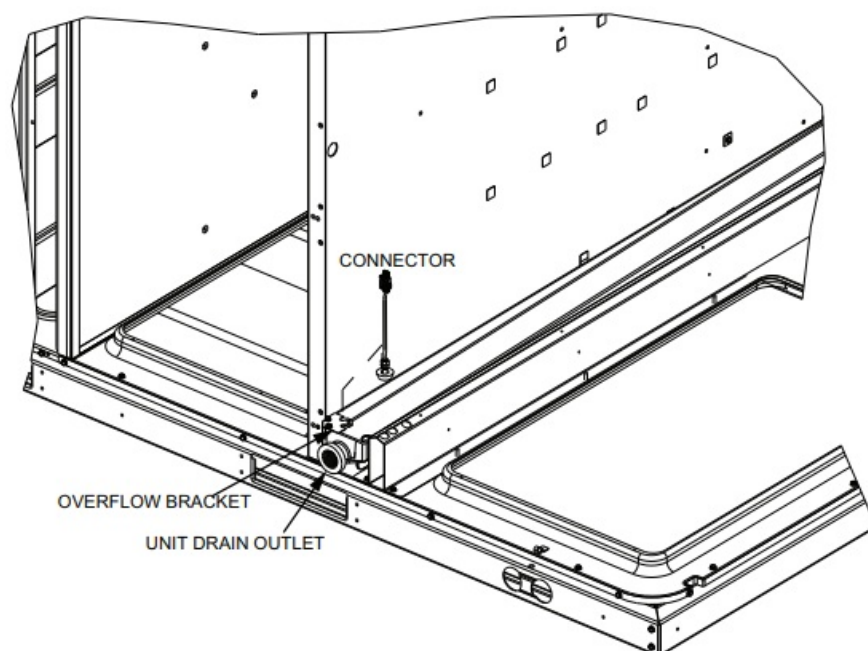


6. Connect PPF121(red connector) from the factory-installed harness to the connector on the switch pigtail. PPF121 harness is shipped with every unit and is located to the right of the switch mounting location. See the main unit schematic, sheet 5 for B, C, and D cabinets or sheet 7 for A cabinet for the balance of the circuit. After installation is complete, the Symbio™ 700 UC configuration will need to be updated to enable this installed feature

MORE INFO



Trane and American Standard create comfortable, energy-efficient indoor environments for commercial and residential applications. For more information, please visit trane.com or americanstandardair.com.

Trane and American Standard have a policy of continuous product and product data improvement and reserve the right to change design and specifications without notice. We are committed to using environmentally conscious print practices.

Documents / Resources

| | |
|-----------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  | <p>Precedent FIAOVFL001 Drain Pan Overflow Switch Packaged Rooftop Units [pdf] Instruction Manual</p> <p>FIAOVFL001, T-Y 036-300, W-D-G 036-300, FIAOVFL001 Drain Pan Overflow Switch Packaged Rooftop Units, FIAOVFL001, Drain Pan Overflow Switch Packaged Rooftop Units, Overflow Switch Packaged Rooftop Units, Switch Packaged Rooftop Units, Packaged Rooftop Units, Rooftop Units</p> |
|-----------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

References

-  [American Standard® | Air Conditioning and Heating | HVAC Systems](#)
-  [Trane Heating & Air Conditioning](#)
- [User Manual](#)

[Manuals+](#), [Privacy Policy](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.