



# SCHRACK TECHNIK NLK5U413SC Self Contained Autotest Emergency Luminaire Instruction Manual

[Home](#) » [SCHRACK TECHNIK](#) » SCHRACK TECHNIK NLK5U413SC Self Contained Autotest Emergency Luminaire Instruction Manual 



Installation and operating instruction  
Self-contained Autotest emergency luminaire NLK5U413SC



## Contents

- [1 Technical data](#)
- [2 Security advice:](#)
- [3 Mounting instruction Design K5](#)
- [4 Documents / Resources](#)
  - [4.1 References](#)

## Technical data

Viewing distance:	20m
Illuminant:	LED
Mains voltage:	220-240V 50/60Hz
Autonomy time:	3h
Battery	LiFePO4 3.2V 1500mAh
Connected load:	3.5W
Protection category:	IP 65
Insulation class:	II
Permitted temp. range:	0° C to +55° C
Mounting:	Wall, ceiling (optionally ceiling recessed)

Self-contained Autotest emergency luminaire according to EN 60598-1, EN 60598-2-22, ISO 7010 and EN 1838 for wall- or ceiling mounting. Suitable for maintained and non-maintained operation. Pictogram set (left, right, up and down) included.

### Security advice:

**Attention:** Works on the 230V AC mains may only be done from qualified personnel considering the local installation requirements. Before installation the supply voltage must be switched off.




**Remark:** In order to attain the full functionality of a self-contained emergency luminaire the battery has to be charged for min. 24 hours.



Caution: Claims for warranty cannot be lodged in the event of damage caused by non-observance of this instruction. No liability for follow-on damages resulting from this can be accepted. The installation instruction must be read thoroughly before commissioning the product.

### Dimensional sketch:

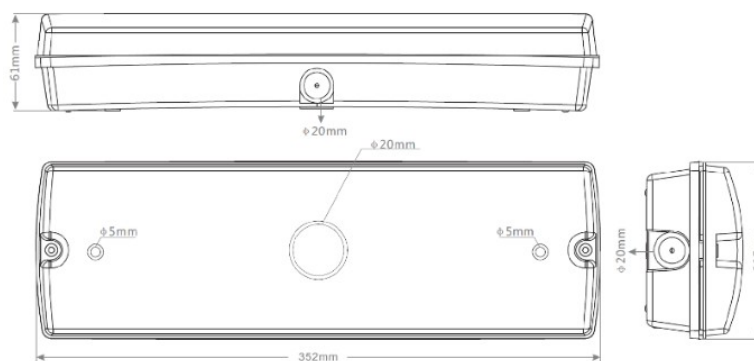


**Important:** Make sure the battery is replaced as stated in regulations otherwise the function of the lamp is not guaranteed.

When replacing the battery ! Do not use abrasive cleaners or cleaners that contain solvent.



**Mounting instruction Design K5**

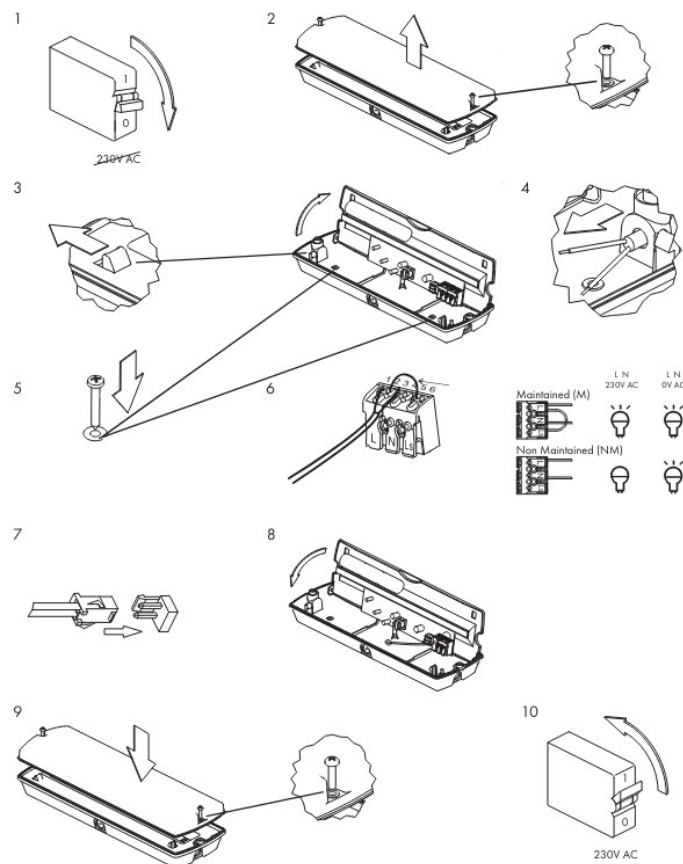


Schrack Technik GmbH  
 Seybelgasse 13, A – 1230 Vienna, PHONE +43 1/866 85-0  
 E-MAIL [info@schrack.com](mailto:info@schrack.com), INTERNET [www.schrack.com](http://www.schrack.com)

PAGE 2/2

06-2023

Errors and omissions excepted.

## Documents / Resources



[SCHRACK TECHNIK NLK5U413SC Self Contained Autotest Emergency Luminaire](#) [pdf] Instruction Manual

NLK5U413SC Self Contained Autotest Emergency Luminaire, NLK5U413SC, Self Contained Autotest Emergency Luminaire, Autotest Emergency Luminaire, Emergency Luminaire, Luminaire

## References

- [S International](#)
- [S International](#)
- [User Manual](#)

## **Manuals+, Privacy Policy**

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.