



SHINKO TECHNOS SG Signal Conditioner Instruction Manual

[Home](#) » [SHINKO TECHNOS](#) » SHINKO TECHNOS SG Signal Conditioner Instruction Manual 

Contents

- 1 SHINKO TECHNOS SG Signal Conditioner
- 2 Specifications
- 3 Product Usage Instructions
- 4 FAQ
- 5 Preface
- 6 Safety Precautions
- 7 Wiring Precautions
- 8 Name and Functions
- 9 Mounting
- 10 Wiring
- 11 CONTACT
- 12 Documents / Resources
 - 12.1 References

Shinko

SHINKO TECHNOS SG Signal Conditioner



Specifications

- **Model:** Signal Conditioner SG, SGW, SGL
- **Model Number:** SG11JE7 2024.02
- **Material:** Flame-resistant resin
- **Display:** Multi-Display A and B
- **Output:** Output 1 and Output 2 (only applicable to SGW)
- **Indication Unit:** mA and %

Product Usage Instructions

The front panel includes the following key functions:

- **Display section:** Indicates setting contents, input value, and output value.
- **Mounting screw:** Used for fixing the instrument to the socket or removal from it.
- **DISP key:** Switches display and move to the next setting item. In manual mode, Output 1 and Output 2 settings can be switched.
- **MODE key:** Selects either a setting mode or a display mode. Shifts the digit on the Custom display.
- **UP key:** Increases the numerical value. Allows changing contents of Multi-Display A and B alternately.
- **DOWN key:** Decreases the numerical value. Enter manual mode by pressing for 3 seconds.
- **Output Adjustments:** Includes Zero and Span adjustments for Output 1 and Output 2 (applicable to SGW).

The display section includes various indicators such as Setting display, Input indicator, Alarm indicator, Output indicator, mA indicator, and % indicator for different modes and settings.

FAQ

- **Q:** Can the Signal Conditioner be used in military applications?
- **A:** To avoid misuse, please investigate the end users and final use of the instrument to comply with export trade control regulations.
- **Q:** How do I adjust the output values of Output 1 and Output 2?
- **A:** Use the appropriate keys on the front panel to adjust the Zero and Span values for Output 1 and Output 2 (applicable to SGW).

Preface

- Thank you for purchasing our SG, SG W, and SG L, Signal Conditioners.
- This manual contains instructions for the mounting, functions, operations and notes when operating the instruments. To prevent accidents arising from the misuse of these instruments, please ensure the operator receives this manual.
- For detailed usage, please refer to the Instruction Manual for each instrument.
- For the instrument with serial communication (SG L), refer to the Communication Instruction Manual.
- Please access our website from the following URL or QR code to download the detailed Instruction Manual as well as the Communication Instruction Manual. https://shinko-technos.co.jp/e/download/d_manual_download.html#S



Notes

- This instrument should be used under the specifications described in the manual. If it is not used according to the specifications, it may malfunction or cause a fire.
- Be sure to follow the warnings, cautions and notices. If they are not observed, serious injury or malfunction may occur.
- The contents of this instruction manual are subject to change without notice.
- Care has been taken to ensure that the contents of this instruction manual are correct, but if there are any doubts, mistakes or questions, please inform our sales department.
- This instrument is designed to be installed on a DIN rail within a control panel indoors. If it is not, measures must be taken to ensure that the operator cannot touch power terminals or other high-voltage sections.
- Any unauthorized transfer or copying of this document, in part or in whole, is prohibited.
- Shinko Technos Co., Ltd. is not liable for any damage or secondary damage(s) incurred as a result of using this product, including any indirect damage.

Safety Precautions

Safety Precautions (Be sure to read before using our products)

The safety precautions are classified: as “Warning” and “Caution”. Depending on circumstances, procedures indicated by ⚠ Caution may result in serious consequences, so be sure to follow the directions for usage.

- **Warning:** Procedures that may lead to dangerous conditions and cause death or serious injury, if not carried out properly.
- **Caution:** Procedures which may lead to dangerous conditions and cause superficial to medium injury or physical damage or may degrade or damage the product, if not carried out properly.

Warning

- To prevent an electrical shock or fire, only Shinko or other qualified service personnel may handle the inner

assembly.

- To prevent an electrical shock, fire or damage to the instrument, parts replacement may only be undertaken by Shinko or other qualified service personnel.

Safety Precautions

- To ensure safe and correct use, thoroughly read and understand this manual before using this instrument.
- This instrument is intended to be used for industrial machinery, machine tools and measuring equipment. Verify correct usage after purpose-of-use consultation with our agency or main office. (Never use this instrument for medical purposes with which human lives are involved.)
- External protection devices must be installed, as a malfunction of this product could result in serious damage to the system or injury to personnel. Proper periodic maintenance is also required.
- This instrument must be used under the conditions and environment described in this manual. Shinko Technos Co., Ltd. does not accept liability for any injury, loss of life, or damage occurring due to the instrument being used under conditions not otherwise stated in this manual.

Caution for Export Trade Control Ordinance To avoid this instrument from being used as a component in, or as being utilized in the manufacture of weapons of mass destruction (i.e. military applications, military equipment, etc.), please investigate the end users and the final use of this instrument. In the case of resale, ensure that this instrument is not illegally exported.

Installation Precautions

Caution

This instrument is intended to be used under the following environmental conditions (IEC61010-1): Overvoltage category, Pollution degree 2 Ensure the mounting location corresponds to the following conditions:

- A minimum of dust, and an absence of corrosive gases
- No flammable, explosive gases
- No mechanical vibrations or shocks
- No exposure to direct sunlight, an ambient temperature of -10 to 55 (14 to 131) that does not change rapidly, and no icing
- An ambient non-condensing humidity of 35 to 85 %RH
- No large capacity electromagnetic switches or cables through which large current is flowing
- No water, oil, chemicals, or vapors of these substances can come into direct contact with the unit
- Please note that the ambient temperature of this unit – not the ambient temperature of the control panel – must not exceed 55 (131) if mounted through the face of a control panel, otherwise the life of electronic components (especially electrolytic capacitors) may be shortened.

Note: Avoid setting this instrument directly on or near flammable material even though the case of this instrument is made of flame-resistant resin.

Wiring Precautions

Caution

- Do not leave wire remnants in the instrument, because they could cause a fire or malfunction.
- When wiring, use crimping pliers and a solderless terminal with an insulation sleeve in which an M3 screw fits.
- Tighten the terminal screw using the specified torque.
- This instrument does not have a power switch, circuit breaker or fuse. Therefore, it is necessary to install a power switch, circuit breaker, and fuse externally near the instrument.
(Recommended fuse: Time-lag fuse, rated voltage 250 V AC, rated current 2 A)
- Connect the AC power to the designated terminal as is written in this instruction manual. Otherwise, it may burn and damage the instrument.
- Do not apply a commercial power source to the sensor which is connected to the input terminal nor allow the power source to come into contact with the sensor.
- Use a thermocouple and compensating lead wire according to the sensor input specifications of this instrument.
- Use the 3-wire RTD according to the sensor input specifications of this instrument.
- When using direct current or DC voltage input, ensure the polarity is correct.
- When wiring, keep Input/Output wires away from AC power sources.


Operation and Maintenance Precautions

Caution

- Do not touch live terminals. This may cause an electrical shock or problems in operation.
- Turn the power supply to the instrument OFF before retightening the terminal or cleaning. Working on or touching the terminal with the power switched ON may result in severe injury or death due to electrical shock.
- Use a soft, dry cloth when cleaning the instrument.
(Alcohol based substances may tarnish or deface the unit.)
- As the display section is vulnerable, be careful not to put pressure on, scratch or strike it with a hard object.

Name and Functions

Front Panel

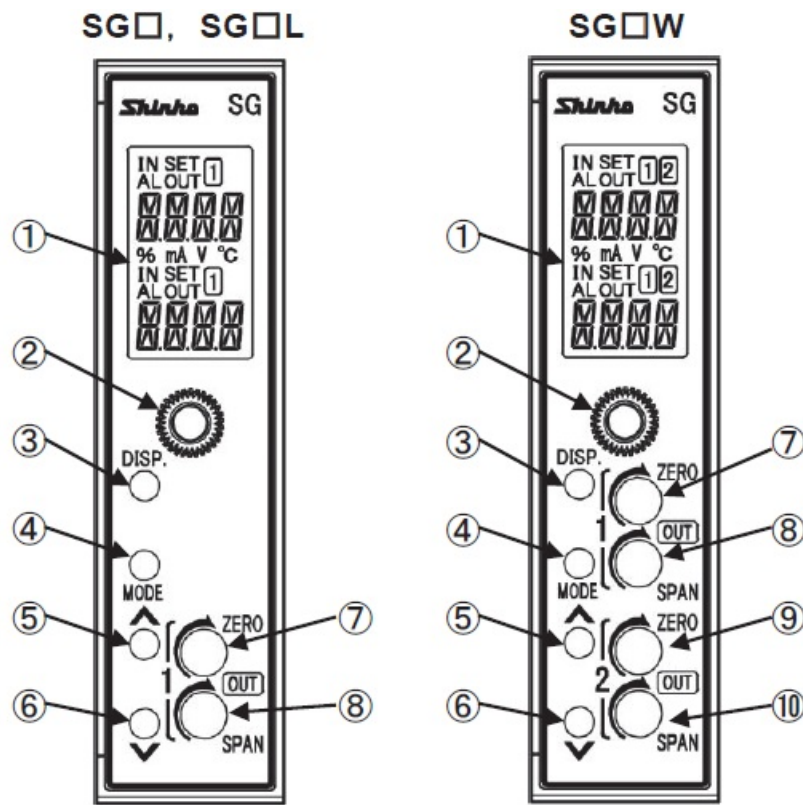


(Fig. 1.1-1)

1	Display section	Indicates setting contents, input value and output value.
2	Mounting screw	Used for fixing the instrument to the socket or removal from it.
3	DISP key	Switches the displays, and moves to the next setting item. In manual mode, Output 1 and Output 2 settings can be switched. Releases the lock status of the DISP key by pressing and holding for 3 seconds.
4	MODE key	Selects either a setting mode or a display mode. Shifts the digit on the Custom display. Enter the setting mode by pressing and holding for 5 seconds.
5	UP key	Increases the numerical value. Contents of Multi-Display A and B can be changed alternately when Default Display is RUN display mode 1, 2(*), 3, 4(*), 5, and 6(*).
6	DOWN key	Decreases the numerical value. Enter manual mode by pressing for 3 seconds.
7	Output 1 Zero	Adjusts the output value of Output 1 Zero.
8	Output 1 Span	Adjusts the output value of Output 1 Span.
9	Output 2 Zero(*)	Adjusts the output value of Output 2 Zero.
10	Output 2 Span (*)	Adjusts the output value of Output 2 Span.

(*) Applicable to the SG?W (2-outputs spec) only.

Display Section

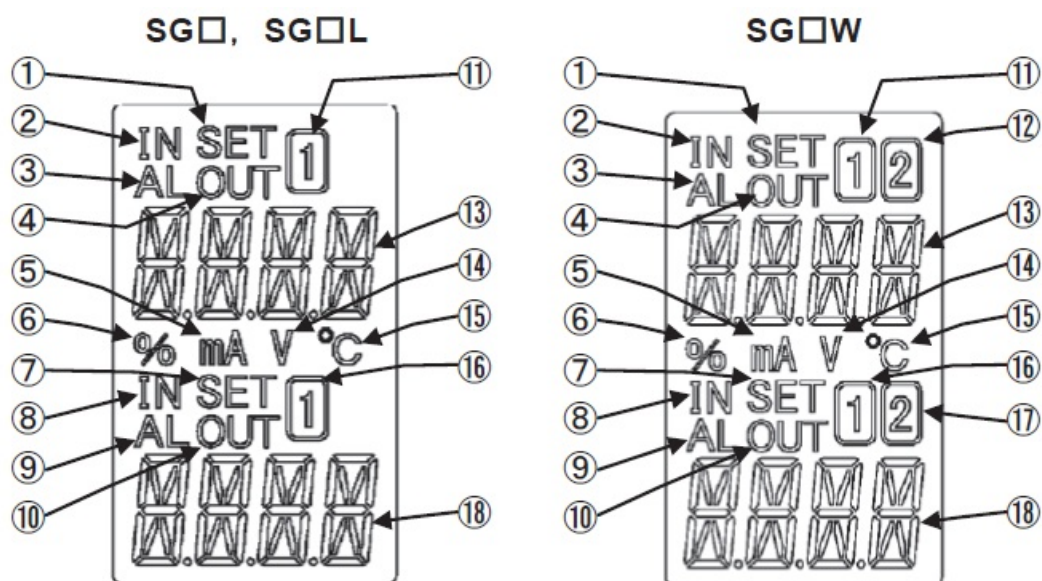

(Fig. 1.2-1)


1	Setting display indicator A	Lights up in Manual mode.
2	Input indicator A	Lights up when Multi-Display A indicates an input value.
3	Alarm indicator A	Lights up if an input error, input burnout, or input disconnection occurs while Multi-Display A indicates an input value. Lights up if an input error, input burnout, or input disconnection occurs in the following mode: Custom display mode 1, 2, 3, 4, Unlit display mode, Model display mode
4	Output indicator A	Lights up when Multi-Display A indicates an output value.
5	mA indicator	Lights up when mA is selected in [Indication unit].
6	% indicator	Lights up in Manual mode, or when % is selected in [Indication unit].
7	Setting display indicator B	Lights up while in a setting display.
8	Input indicator B	Lights up when Multi-Display B indicates an input value.
9	Alarm indicator B	Lights up if an input error, input burnout or input disconnection occurs while Multi-Display B indicates an input value.
10	Output indicator B	Lights up when Multi-Display B indicates an output value.
11	1 indicator A	Lights up in Manual mode, or when Multi-Display A indicates Output 1.
12	2 indicator A(*)	Lights up when Multi-Display A indicates Output 2.
13	Multi-Display A	Indicates the following by the display indication: Input value, output value, custom characters, setting item
14	V indicator	Lights up when V is selected in [Indication unit].
15	°C indicator	Lights up when °C is selected in [Indication unit].
16	1 indicator B	Lights up when Multi-Display B indicates Output 1, or while in Output 1 setting display.
17	2 indicator B(*)	Lights up when Multi-Display B indicates Output 2, or while in Output 2 setting display.
18	Multi-Display B	Indicates the following per the display indication: Input value, output value, custom characters, setting value

Output indicators A and B, Alarm indicators A and B: Red, Other indicators: White

(*) Applicable to the SG?W (2-outputs spec)?only.


Mounting

Dimensions (Scale: mm)

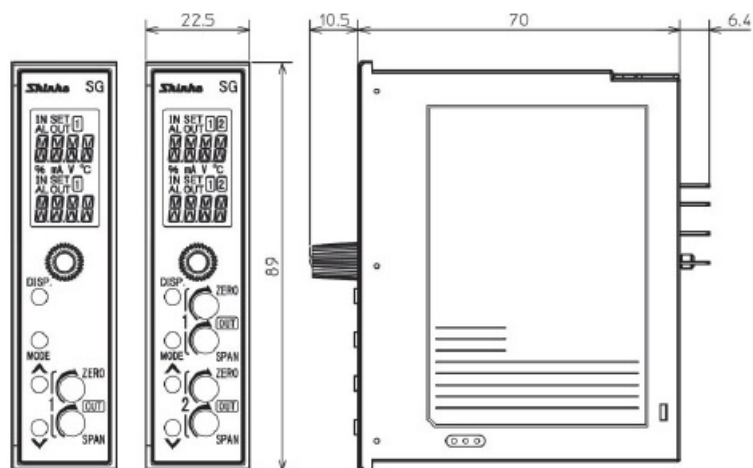


(Fig. 2.1-1)

8P socket (SG□, SG□L)

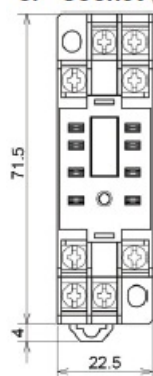


11P socket (SG□W)

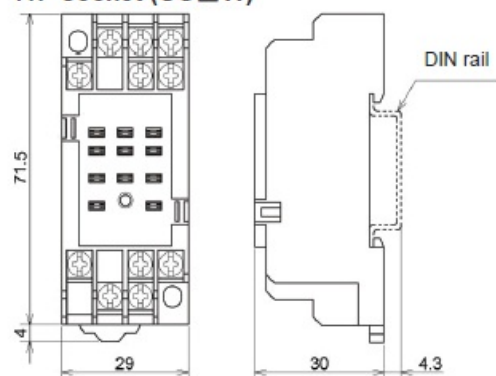

(Fig. 2.1-2)

Mounting to, and Removal from the DIN Rail Mounting to the DIN Rail (Fig. 2.2-1)

1. Separate the instrument from the socket by loosening the mounting screw on the front panel.
2. Make sure the lock lever of the socket is located in the lower part of the socket. Hook the upper side of the socket onto the DIN rail, then fit the lower part of the socket onto the DIN rail. (A clicking sound should be heard when done properly.)

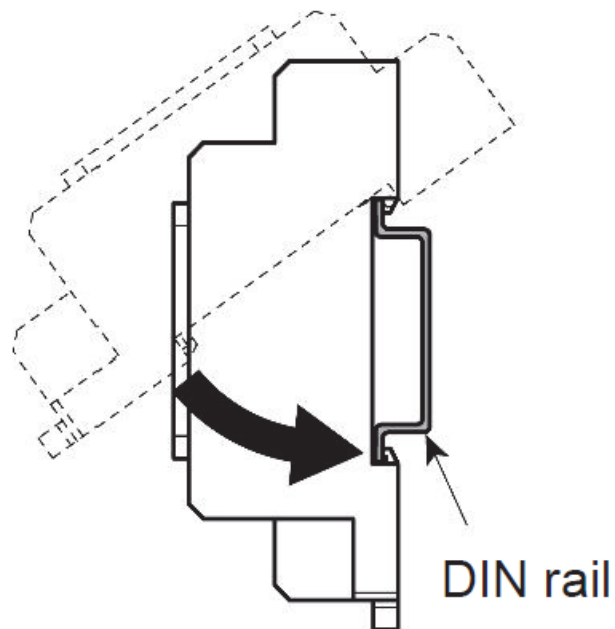


(Fig. 2.2-1)

Caution

- Before inserting the instrument into the socket, wire the cable. (Refer to “3. Wiring”.)
- When inserting or removing the socket, make sure the socket is oriented vertically. If force is applied in any other direction than vertically, a malfunction may occur.
- If the mounting screw is fastened too tightly, a malfunction may occur.
- Insert the unit into the socket.
- Fasten the mounting screw by turning it clockwise, to secure the unit onto the socket.
- Tighten the screw lightly.

Removal from the DIN Rail (Fig. 2.2-2)

1. Turn the power to the instrument OFF.
2. Separate the instrument from the socket by loosening the mounting screw on the front panel.
3. Insert a flat-blade screwdriver into the lock lever (lower part of the socket), and remove the socket from the DIN rail while pulling the lever down.

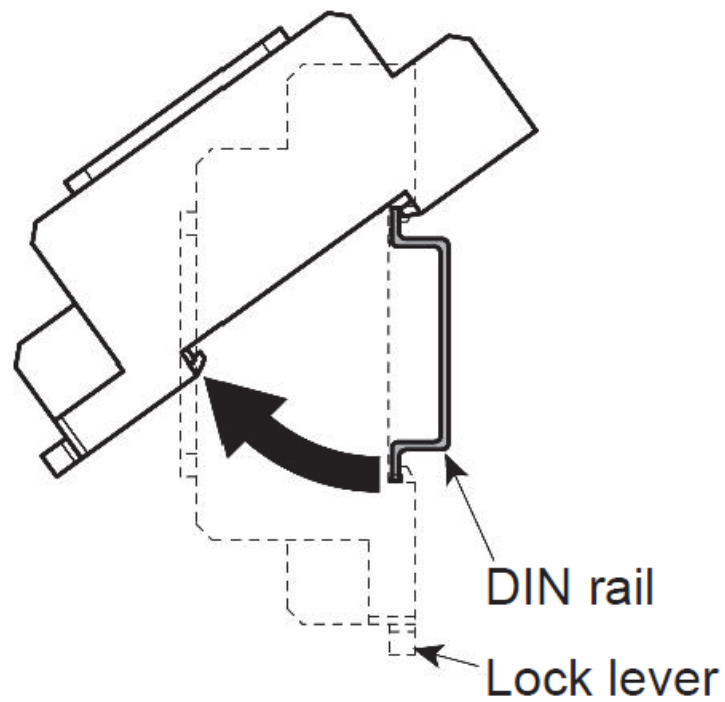

(Fig. 2.2-2)


Wiring

Lead Wire Solderless Terminal


Use a solderless terminal with an insulation sleeve in which an M3 screw fits shown below. The torque should be 0.63 N•m.

Solderless Terminal	Manufacturer	Model
Y-type	NICHIFU TERMINAL INDUSTRIES CO., LTD.	TMEX1.25Y-3
	J.S.T.MFG.CO., LTD.	VD1.25-B3A
Ring-type	NICHIFU TERMINAL INDUSTRIES CO., LTD.	TMEX1.25-3
	J.S.T.MFG.CO., LTD.	V1.25-3

Y-type (Scale: mm)

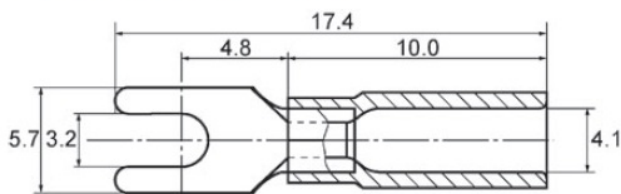

Ring-type (Scale: mm)

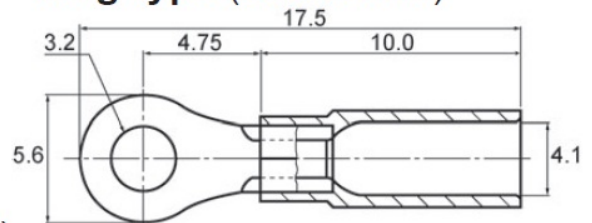

(Fig. 3-1)

For the terminal arrangement, refer to the Instruction Manual (Detailed version) or Specification Sheet for each unit.

Adjustment

- The output of this unit has been already adjusted before shipping. Therefore, it is not required to adjust the unit in the case users use it with the ordered Input/Output specification. However, in the case of fine adjustment or calibration between connected units, adjust the value following the procedure described below.
- Connect an mV generator or Dial resistor to the input terminals of this unit.
- Connect a digital multimeter to the output terminals.

Adjust Output 1

1. Enter the value corresponding to 0% output, then adjust the value with the Output 1 Zero trimmer while viewing the output value (on the digital multimeter).
2. Enter the value corresponding to 100% output, then adjust the value with the Output 1 Span trimmer while viewing the output value (on the digital multimeter).
3. Enter the value corresponding to 0% output again, and confirm the output value (on the digital multimeter).
4. If the value corresponding to 0% output is not at 0%, repeat steps (1) to (3) again.

Adjust Output 2 [For SG?W (2-outputs spec)]

- The procedure for Output 2 adjustment is the same as that of Output 1 adjustment.
- Use the Output 2 Zero and Span trimmers for adjustment.

Inquiries

- For any inquiries about this unit, please contact our agency or the vendor where you purchased the unit after checking the following.

(e.g.)


- Model _____ SGU-A01-0-0
- Serial number _____ 154F05000

- In addition to the above, please let us know the details of the malfunction, or discrepancy, and the operating conditions.

CONTACT

- SHINKO TECHNOS CO., LTD.
- URL: <https://shinko-technos.co.jp/e/>
- 2-5-1, Senbahigashi, Minoo, Osaka, 562-0035, Japan
- TEL: +81-72-727-6100 FAX: +81-72-727-7006

Documents / Resources



[SHINKO TECHNOS SG Signal Conditioner](#) [pdf] Instruction Manual
SG, SGW, SGL, SG Signal Conditioner, SG, Signal Conditioner, Conditioner

References

- [🌐 J.S.T.MFG.CO](https://www.j.s.t.mfg.co)
- [!\[\]\(83eb2aa26b610eb6a9dca7cf4702d681_img.jpg\) **Shinko Technos for temperature and humidity control**](#)
- [User Manual](#)

[Manuals+](#), [Privacy Policy](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.