



SIEMENS MPI-2 Mounting Plate Instruction Manual

[Home](#) » [SIEMENS](#) » SIEMENS MPI-2 Mounting Plate Instruction Manual 

Contents

- [1 SIEMENS MPI-2 Mounting Plate](#)
- [2 Installation Instructions](#)
- [3 OPERATION](#)
- [4 INSTALLATION](#)
- [5 Documents / Resources](#)
 - [5.1 References](#)
- [6 Related Posts](#)


SIEMENS

SIEMENS MPI-2 Mounting Plate



Installation Instructions

Model MPI-2 Mounting Plate

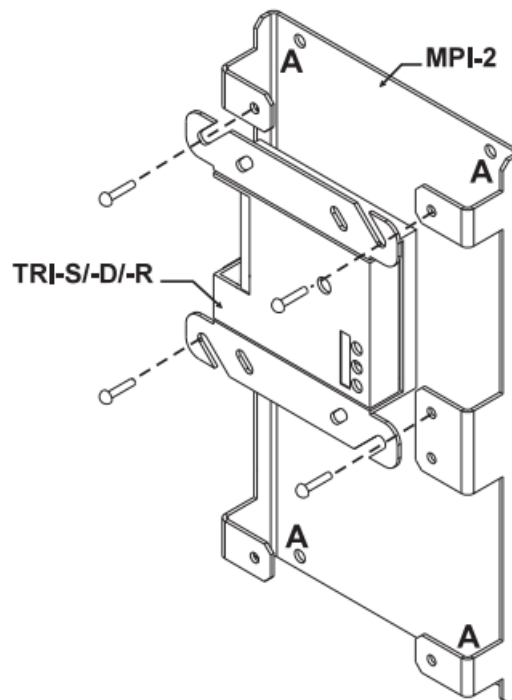

OPERATION

The Model MPI-2 Mounting Plate from Siemens Industry, Inc., is used to mount TRI-S, TRI-D, or TRI-R addressable devices onto a System 3 Rail Assembly. The MPI-2 occupies two module spaces on the rails. The mounting plate can be used for a single TRI-S, TRI-D, or TRI-R device or for any two of the TRI devices, mixed types or the same type.

Note: Refer to the System 3 Control Panel Installation Instructions, P/N 315-093680, for power limited and non-

power limited wire routing.


INSTALLATION

Using the four 8 x 1/4 Phillips head screws provided, mount the MPI-2 plate to the rail assembly at the upper and lower corners of the plate labeled position A in the figure. Install one or two TRI-S, TRI-D, or TRI-R modules on the MPI-2 plate as shown in the figure, using 4 of the 8 x 1/4 Phillips head screws provided for each TRI module. Fasten the BP-30 cover plate in the System 3 door so as to cover the MPI-2 plate.

Siemens Industry, Inc. Building Technologies Division Florham Park, NJ P/N 315-096447-5 Siemens Building Technologies, Ltd. Fire Safety & Security Products 2 Kenview Boulevard Brampton, Ontario L6T 5E4 Canada

- firealarmresources.com

Documents / Resources

	SIEMENS MPI-2 Mounting Plate [pdf] Instruction Manual MPI-2 Mounting Plate, MPI-2, Mounting Plate, Plate
---	---

References

- [🔥 Fire Alarm Resources | Download fire alarm documents](#)