

Simply45 S45-2624 24 Port Loaded Patch Panel Instructions

Home » Simply45 » Simply45 S45-2624 24 Port Loaded Patch Panel Instructions



S45-2624 24 Port Loaded Patch Panel Instructions



P/N: S45-2624

24-Port Loaded Patch Panel, Unshielded Cat6 UTP, 1RU, Rear 110 IDC Punch Down, Numbered Ports w/Labels, Cable Mgt Bracket, ANSI/TIA 568.2-D, ISO/IEC 11801 Class D, PoE: IEEE 802.3bt, UL – Black – 1 ea/Box

Contents

1 S45-2624 24 Port Loaded Patch


2 Documents / Resources

2.1 References


3 Related Posts

S45-2624 24 Port Loaded Patch Panel


1. Punch down cables to 110/Krone IDC Connector according to TIA568A/B wiring instruction label.

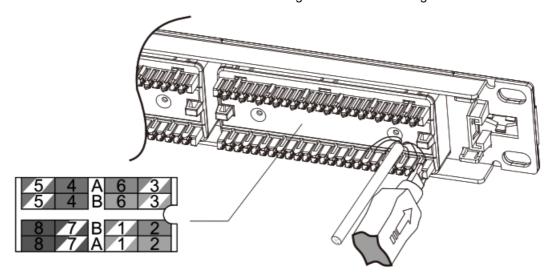


2. Punch down solid cable to each port until termination is completed.

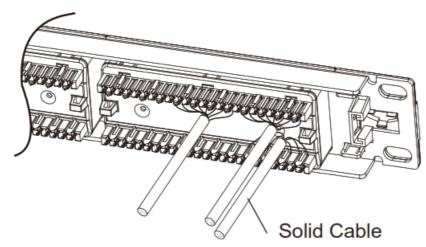


3. Write port description on label and put on plastic cover

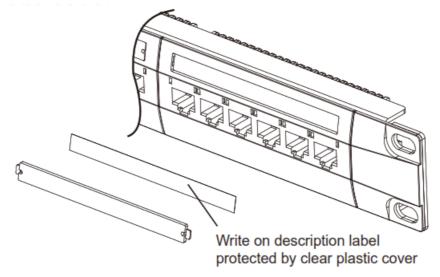

4. Expand the Foldable Cable Management Grip, hook the grips into fixture at both ends of the patch panel.

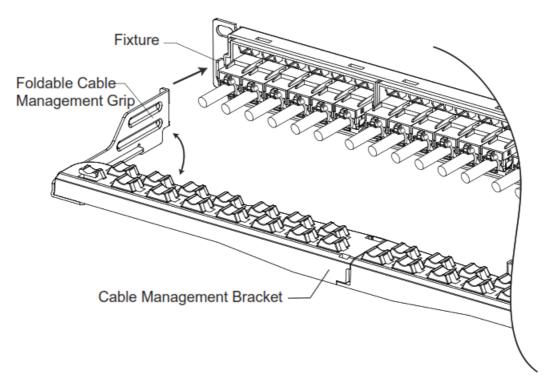

5. Fix the solid cables to the cable fixture hole using cable ties.

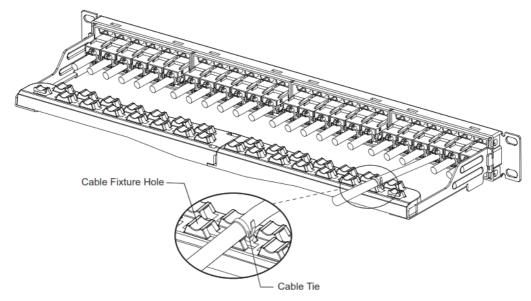

Simply45 Phone USA Direct: 1-954-928-8600 Web: www.simply45.com



Documents / Resources



Simply45 S45-2624 24 Port Loaded Patch Panel [pdf] Instructions

S45-2624, 24 Port Loaded Patch Panel, S45-2624 24 Port Loaded Patch Panel, Loaded Patch Panel, Panel, Panel

References

• @ Home - simply45.com - We Have Re-Engineered The Pass Through RJ45

Manuals+,