

# SmartGen HSM340 Synchronous Module User Manual

Home » SmartGen » SmartGen HSM340 Synchronous Module User Manual



#### **Contents**

- 1 SmartGen HSM340 Synchronous Module
- **2 OVERVIEW**
- **3 PERFORMANCE AND CHARACTERISTICS**
- **4 SPECIFICATION**
- **5 PANEL INDICATORS AND TERMINALS DESCRIPTION**
- **6 SCOPES AND DEFINITIONS OF PROGRAMMABLE**

**PARAMETERS** 

- **7 FUNCTION DESCRIPTION**
- 8 RAISE/DROP SPEED RELAY OUTPUT CONTROL
- 9 TYPICAL DIAGRAM
- **10 CASE DIMENSION**
- 11 INSTALLATION NOTES
- 12 Documents / Resources
  - 12.1 References
- **13 Related Posts**



SmartGen HSM340 Synchronous Module



## **OVERVIEW**

HSM340 Synchronous Module is specially designed for automatic parallel of 400Hz system genset. According to the pre-set parameters, the module can automatically complete genset parallel condition detection (volt difference, frequency difference and phase) and send parallel signal when the conditions are well prepared. HSM340 Synchronous Module applies to the occasion where it can synchronize generator to the bus. The module is simple to operate, easy to install and widely used on ship genset and land genset.

#### PERFORMANCE AND CHARACTERISTICS


#### Main characteristics are as below:

- Suitable for 3-phase 4-wire, 3-phase 3-wire, 2-phase 3-wire, single phase 2-wire power system with 400Hz frequency;
- Adjustable potentiometer allowing to set the main parameters about synchronization;
- Operating parameters can be set via PC test software. LINK port should be connected to computer via SG72 module (USB to LINK);
- 4 relay outputs, 2 of which are used for speed UP output and DOWN output; 1 SYNC relay is used for sync close output, and 1 STATUS relay is used for status output after close;
- 1 INH "inhibit sync close output" digital input; when it is active and gens synchronizes with bus, the SYNC indicator will illuminate and sync close relay is inhibited to output;
- Wide power supply range DC(8~35)V;
- 35mm guide rail mounting;
- Modular design, pluggable terminal, compact structure with easy installation.

### **SPECIFICATION**

Items	Contents		
Working Voltage	DC8.0V to 35.0V, continuous power supply.		
Overall Consumption	≤1W(Standby mode≤0.5W)		
AC Voltage Input	AC50V~ AC620 V (ph-ph)		
AC Frequency	400Hz		
SYNC Output	7A AC250V Volts free output		
UP Output	5A AC250V/5A DC30V Volts free output		
DOWN Output	5A AC250V/5A DC30V Volts free output		
STATUS Output	5A AC250V/5A DC30V Volts free output		
Case Dimensions	71.6mm x 89.7mm x 60.7mm		
Working Conditions	Temperature: (-25~+70)°C Relative Humidity: (20~95)%		
Storage Conditions	Temperature: (-30~+80)°C		
Insulation Intensity	Apply AC2.2kV voltage between high voltage terminal and low voltage terminal;  The leakage current is not more than 3mA within 1min.		
Weight	0.20kg		

# PANEL INDICATORS AND TERMINALS DESCRIPTION

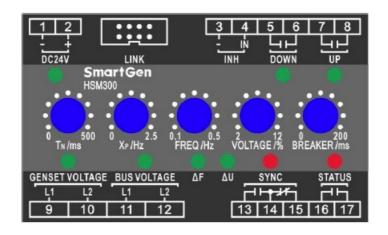

**Table 4 – LEDs Definition Description** 

Indicators	Color	Description	Notes
DC 24V	Green	Power indicator, it illuminates when power works well.	
UP	Green	It illuminates when raising speed pulse is sent.	
DOWN	Green	It illuminates when decreasing speed pulse is sent.	
GENSET	Green	It always illuminates when gens voltage and frequency are normal; it flashes when gens voltage and frequency are abnormal; it is extinguished when there is no power.	
BUS	Green	It always illuminates when bus voltage and frequency are normal; it flash es when bus voltage and frequency are abnormal; it is extinguished when there is no power.	
ΔF Freq	Green	It illuminates when gens' and bus' frequency and voltage are normal, and real-time difference is in the pre-set range.	
ΔU Volt Diff.	Green	It illuminates when gens' and bus' frequency and voltage are normal, and real-time voltage difference is in the pre-set range.	
SYNC Close	Red	When close relay outputs, the lamp will illuminate. Close pulse: 400ms.	
STATUS	Red	After close signal outputs, the relay outputs and it illuminates; when sync hronization between gens and bus isn't detected, the relay will not output and the lamp will extinguish.	

**Table 5 – Potentiometer Description** 

Potentiometer	Range	Description	Note
TN/ms Length of Control Pulse	(25-500)ms	Min. lasting time of control pulse.	
XP/Hz Proportion Ran ge	(0-±2.5)Hz	In this area, pulse width is in direct proportion to devi ation value of rated frequency.	XP/Hz proportion range
FREQ/Hz	(0.1-0.5)Hz	Acceptable frequency difference.	
VOLTAGE/%	(2-12)%	Acceptable voltage difference	
BREAKER/ms	(20-200)ms	The time of switch close.	

**Table 6 – Terminal Connection Description** 

No	Function		Cable Siz	Note				
1.	DC Power Input –		1.5mm2	Connected with negative of starter battery.				
2.	DC Power Ir	iput +		1.5mm2	Connected with positive of starter battery.			
3.	INH	_		1.0mm2	"Close Output Inhi			
4.	IIIII	IN		1.0mm2	"Close Output Inhibit" Input			
5.	DOWN Out	out		1.0mm2	Output when spe ed reduces.	Normally oper	n; Volts free output; 5	
6.					eu reduces.	A Haleu		
7.	UP Output			1.0mm2	Output when spe		n; Volts free output; 5	
8.		OP Output			ed raises.	A Rated		
9.	GEN L1 Phase Input		1.0mm2	Gen AC voltage input.				
10.	GEN L2 Phase Input							
11.	BUS L1 Phase Input		1.0mm2	Bus AC voltage input.				
12.	BUS L2 Phase Input			1.01111112	Bus AC Voltage Input.			
13.			N/O				Relay normally ope	
14.	SYNC	SYNC	COM	СОМ	1.5mm2	Output when	SYNC closes	n, normally close co ntacts; Volts free o utput; 7A
15.	N/C					Rated		
16.			1.0mm2			Normally open cont act, Volts free; 5A R		
17.	STATUS			1.0mm2	Close status outpu		ated	
LI NK	Licad for parameters setting or setting an entity and linguistic							



**NOTE:** PC programming connection: make LINK port of SG72 module of our company connect with LINK port of the module, and do parameter setting and real time monitoring by PC software of our company. Please see Fig. 2.

# **SCOPES AND DEFINITIONS OF PROGRAMMABLE PARAMETERS**

**Table 7 – Module Configurable Parameters** 

No	Items	Range	Defaults	Description
1.	Gens AC System	(0-3)	0	0: 3P3W, 1: 1P2W, 2: 3P4W, 3: 2P3W
2.	Gens Rated Voltage	(30-30000) V	400	
3.	Gens PT Fitted	(0-1)	0	0: Disabled 1: Enabled
4.	Gens PT Primary Volt.	(30-30000)V	100	
5.	Gens PT Secondary Volt.	(30-1000)V	100	
6.		(0-1)	1	0: Disabled 1: Enabled
7.		(100-120) %	115	Threshold
8.	Gens Over Volt. Set	(100-120) %	113	Return Value
9.		(0-3600) s	3	Delay Value

10.		(0-1)	1	0: Disabled 1: Enabled
11.	Gens Under Volt. Set	(70-100) %	82	Threshold
12.	Gens Onder Voil. Set	(70-100) %	84	Return Value
13.		(0-3600) s	3	Delay Value
14.		(0-1)	1	0: Disabled 1: Enabled
15.	Gens Over Freq. Set	(100-120) %	110	Threshold
16.	Gens Over Freq. Set	(100-120) %	104	Return Value
17.		(0-3600) s	3	Delay Value
18.		(0-1)	1	0: Disabled 1: Enabled
19.	Gens Under Freq. Set	(80-100) %	90	Threshold
20.		(80-100) %	96	Return Value
21.		(0-3600) s	3	Delay Value


No	Items	Range	Defaults	Description
22.	Bus AC System	(0-3)	0	0: 3P3W, 1: 1P2W, 2: 3P4W, 3: 2P3W
23.	Bus Rated Voltage	(30-30000) V	400	
24.	Bus PT Fitted	(0-1)	0	0: Disabled 1: Enabled
25.	Bus PT Primary Volt.	(30-30000)V	100	
26.	Bus PT Secondary Volt.	(30-1000)V	100	

27.		(0-1)	1	0: Disabled 1: Enabled
28.	Bus Over Volt. Set	(100-120) %	115	Threshold
29.	Bus Over voit. Get	(100-120) %	113	Return Value
30.		(0-3600) s	3	Delay Value
31.		(0-1)	1	0: Disabled 1: Enabled
32.	Bus Under Volt. Set	(70-100) %	82	Threshold
33.	Bus officer voit. Get	(70-100) %	84	Return Value
34.		(0-3600) s	3	Delay Value
35.		(0-1)	1	0: Disabled 1: Enabled
36.	Bus Over Freq. Set	(100-120) %	110	Threshold
37.	Bus ever rieg. set	(100-120) %	104	Return Value
38.		(0-3600) s	3	Delay Value
39.		(0-1)	1	0: Disabled 1: Enabled
40.		(80-100) %	90	Threshold
41.	Bus Under Freq. Set	(80-100) %	96	Return Value
42.		(0-3600) s	3	Delay Value
43.	Module Address	(1-254)	1	
44.	TP	(1-20)	10	Speed regulation pulse period=TPxTN

HSM340 Synchronous Module is to synchronize generator to bus. When voltage difference, frequency difference and phase difference are within pre-set value, it will send synchronization signal to close gens switch. Because switch close response time can be set, the module can be used for gensets of various source powers. Users can set over voltage, under voltage, over frequency and under frequency thresholds of gens and bus via PC monitoring software. When the module detects voltage and frequency of gens and bus are normal, it will begin to adjust speed. When voltage difference, frequency difference and phase difference are within pre-set value, it will send synchronization signal to close gens switch.

## RAISE/DROP SPEED RELAY OUTPUT CONTROL

When deviation area XP is set as 2Hz, the working principle of raise/drop speed relay is as follows.

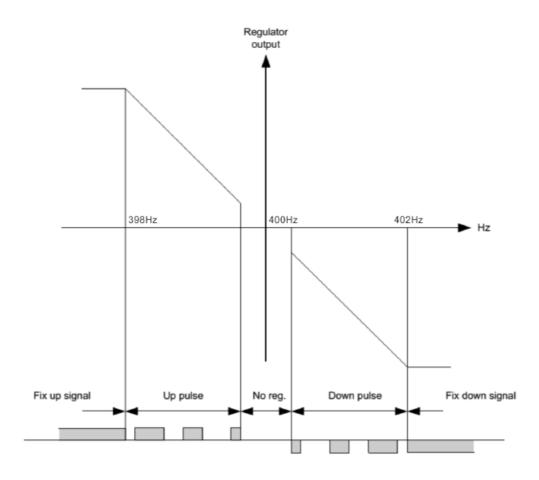


Relay output regulation function can be divided into 5 steps.

**Table 8 – Term Description** 


No.	Range	Description	Note
1	Fix Up Signal	Continuous raise signal	Adjusting activation. For too large derivation, relay has to activate continuously.
2	Up Pulse	Raise the pulse	System adjusting activation. Relay works in pulse to eliminate derivation.
3	No Reg.	No regulation	No regulation in this area.
4	Down Pulse	Drop down the pulse	System adjusting activation. Relay works in pulse to extinguish derivation.
5	Fix Down Signal	Continuous drop signal	System adjusting activation. For too large derivation, drop relay will remain in activating status.

As Fig.3 shows, when adjusting deviation XP exceeds pre-set value, the relay will be in continuous activating status; when XP is not large, the relay will work in pulse. In Up Pulse, much smaller the derivation is, much shorter the pulse becomes. When regulator output value is close to "No Reg.", pulse width will be the shortest value; when regulator output value is nearest to the "Down Pulse", pulse width will be the longest value.

## **TYPICAL DIAGRAM**

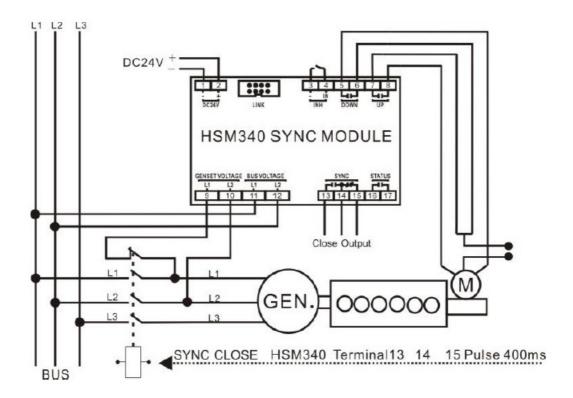

## **CASE DIMENSION**

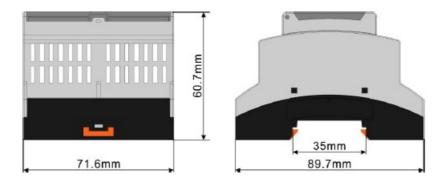

## **INSTALLATION NOTES**

#### **OUTPUT AND EXPAND RELAYS**

All outputs are relay contact outputs. If it needs to expand relay, please add freewheel diode to both ends of expand relay's coils (when coils of relay has DC current), or add resistance-capacitance loop (when coils of relay has AC current), in order to prevent disturbance for controller or other equipments.

### WITHSTAND VOLTAGE TEST

CAUTION! When controller has been installed on control panel, if it needs to do high voltage test, please disconnect relay's all terminal connections, for the purpose of preventing high voltage entering relay and damaging it.

## SmartGen — make your generator smart

SmartGen Technology Co., Ltd. No.28 Jinsuo Road Zhengzhou City Henan Province P. R. China

**Tel:** +86-371-67988888/67981888/67992951

+86-371-67981000(overseas)
Fax: +86-371-67992952
Email: sales@smartgen.cn

Web: www.smartgen.com.cn /www.smartgen.cn

All rights reserved. No part of this publication may be reproduced in any material form (including photocopying or storing in any medium by electronic means or other) without the written permission of the copyright holder. Applications for the copyright holder's written permission to reproduce any part of this publication should be addressed to SmartGen Technology at the address above. Any reference to trademarked product names used within this publication is owned by their respective companies. SmartGen Technology reserves the right to change the contents of this document without prior notice.

Table 1 - Software Version

Date	Version	Content
2019-06-03	1.0	Original release.
2020-12-07	1.1	Modify the cover product picture, wire diameter and other descriptions.

# **Documents / Resources**



SmartGen HSM340 Synchronous Module [pdf] User Manual HSM340 Synchronous Module, HSM340, Synchronous Module, Module

# References

→ 众智

Manuals+,