


## Contents [ [hide](#) ]

- [1 SMARTRISE V.2 Smart Battery Lowering Device](#)
- [2 Specifications](#)
- [3 Turning On the BLD](#)
- [4 Components](#)
- [5 Testing Procedure](#)
- [6 Battery Removal and Replacement](#)
- [7 Troubleshooting Tips](#)
- [8 FAQs](#)
- [9 Documents / Resources](#)
  - [9.1 References](#)



## SMARTRISE V.2 Smart Battery Lowering Device

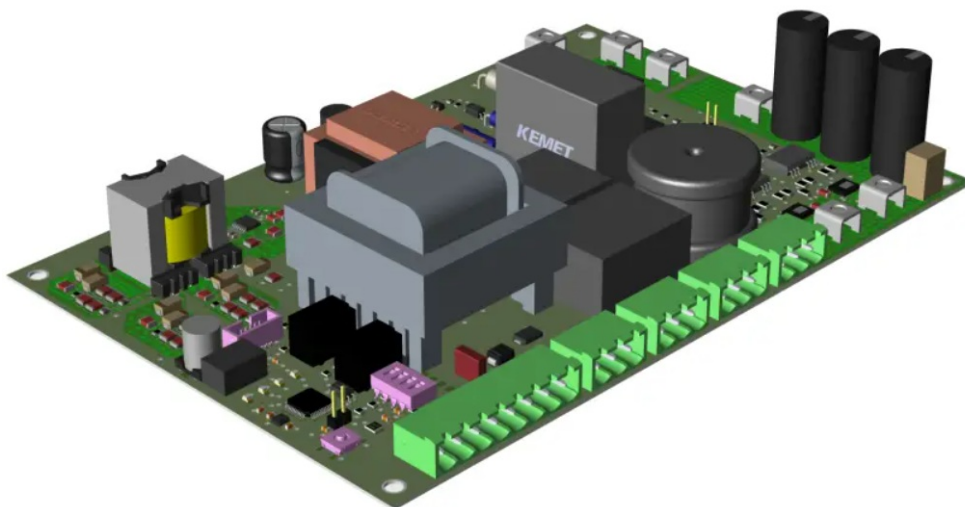

## Specifications

Specification	Value
	<b>Charge Mode</b>
AC Input Voltage	120 VAC
Input Frequency	60 Hz
Input Current to Charging Transformer	500 mA max
Output Charging Current to Batteries	750 mA max
Charging Transformer Output Power	6 VA
DC Out to Batteries Pack Charge	32 VDC Max
	<b>Inverter Mode</b>
DC Input (From External Battery Pack)	20 VDC – 28 VDC
AC Output Voltage	208 – 240 VAC MAX
AC Output Frequency	60 Hz
Output Power	500 W

Specification	Value
Size of Unit	8.5" x 5.75" x 7.5"
Weight of Unit	19.5 lbs

## Safety

**IMPORTANT:** Follow the safety precautions closely when removing or replacing

batteries to prevent injury or equipment damage

**CAUTION:** Risk of explosion if a battery is replaced with an incorrect type.

**CAUTION:** A battery can present a risk of electrical shock and high short-circuit current.

**CAUTION:** Do not disconnect the battery while it is under a load condition.

### **Important Safety Instructions**

The following precautions are important and must be followed when working with batteries during installation and maintenance.

### **SAVE THESE INSTRUCTIONS for future reference**

1. Battery servicing must be performed or supervised by personnel knowledgeable in battery systems and safety precautions.
2. Remove all metal objects, such as watches, rings, or jewelry, before working with batteries.
3. Use tools with insulated handles to avoid electrical contact.
4. Wear rubber gloves and boots for protection.
5. Do not place tools or metal objects on top of the batteries.
6. Disconnect the charging source before connecting or disconnecting battery terminals.
7. Verify whether the battery is mistakenly grounded. If so, remove the grounding source. Contact with a grounded battery can cause an electrical shock. This risk can be minimized by removing the ground during installation and maintenance.
8. Replace batteries only with sealed lead-acid batteries rated at 12 VDC 6AH each.
9. Do not open or damage batteries. The electrolyte inside is harmful to the skin and eyes and can be toxic. Maximum ambient temperature rating: 104°F (40°C). The BLD is intended for use in a controlled environment. Use in restricted-access areas only.

A 4-pole mainline disconnect switch or auxiliary dry contact must be provided and installed.



### **Smart Battery Lowering Device**

In the event of a power loss, the Smart Battery Lowering Device (BLD) will move the elevator to the nearest floor and open the doors.

### **WARNING**

DO NOT TOUCH THE BOARD WHILE THE BATTERY LOWERING OPERATION IS IN PROCESS DUE TO HIGH VOLTAGE. AFTER THE UNIT SHUTS DOWN, WAIT FOR 2 MINUTES TO ALLOW THE CAPACITORS TO FULLY DISCHARGE.

## Battery Lowering Device

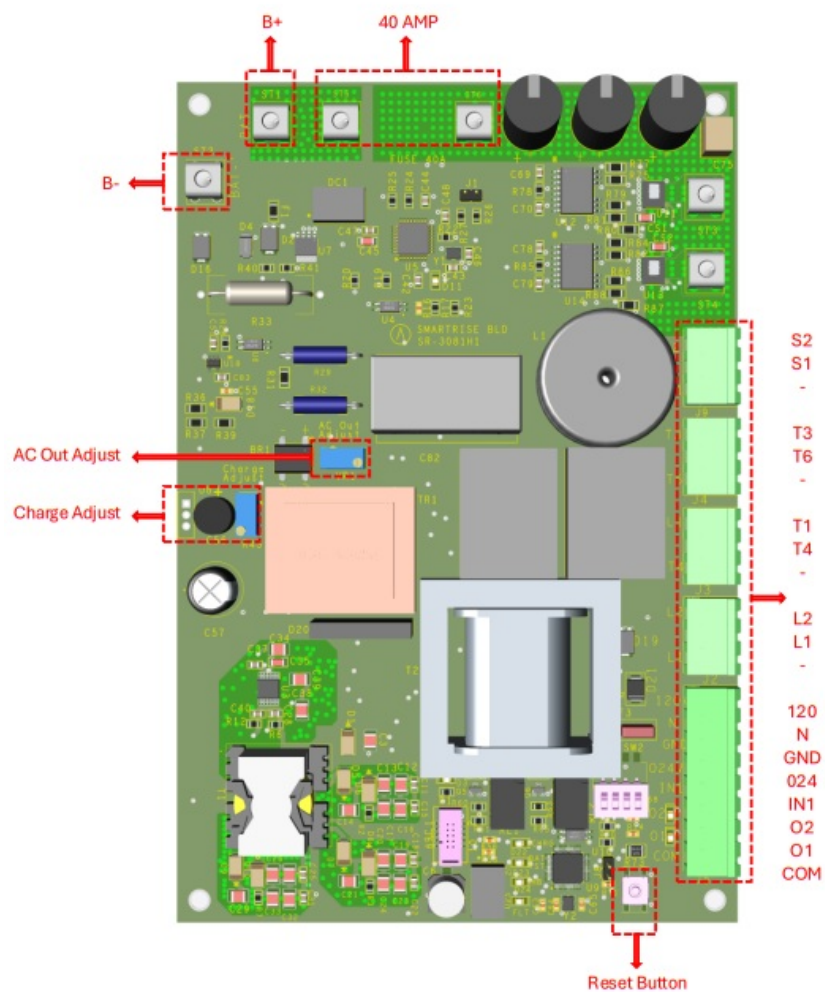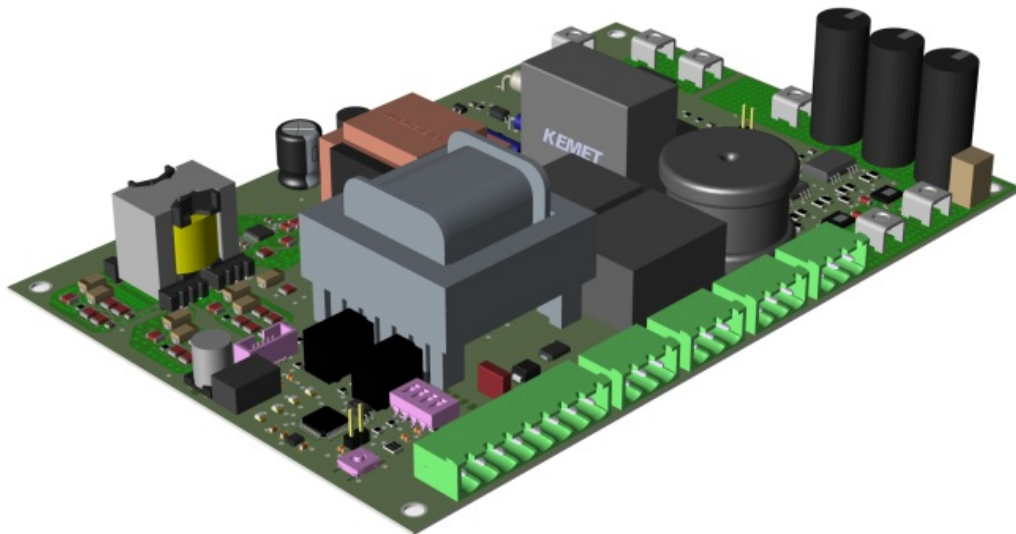


## Turning On the BLD

Ensure the batteries in the BLD are charged and the switch is in the ON position. The


batteries will continue charging as long as the 120 and N terminals are connected to 120 VAC and the BLD is not outputting power.

**NOTE:** If the power switch is in the OFF position or the battery voltage is low, the FLT (fault) output will activate.

### Power Switch – ON

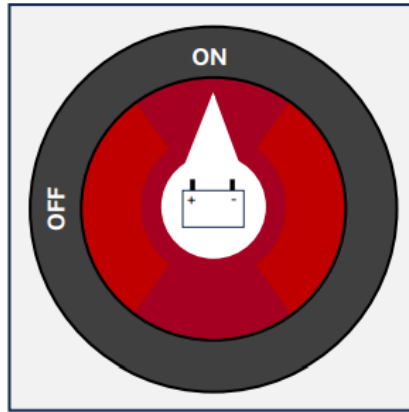

### Power Switch – OFF

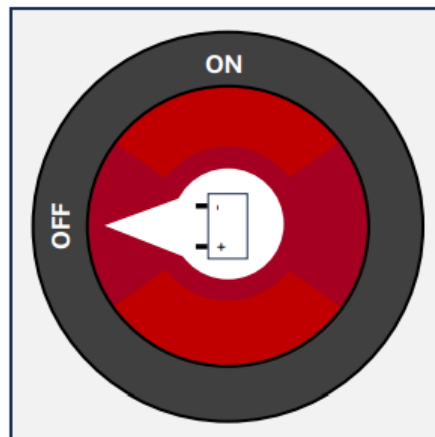

## Components

This section consists of the components present on the BLD.

### Terminals

The terminals on the BLD, along with their descriptions, are outlined below.

- **L1, L2 – L1, L2 from Main Line:** Connected to the main line and detects main power loss.
- **L1, T4, T3, T6:** External connections based on incoming main line power [see Figure 6, Figure 7, and Figure 8].
- **120, N:** 120 VAC – charges the batteries.


- **O24, IN1:** Main line auxiliary switch.
- **O2:** Battery lowering input to the controller.
- **O1:** Battery lowering fault input to the controller.
- **COM:** 24 VDC from the controller.
- **NC/NO Jumper:** Refer to section 3.5 J7 NO/NC BLD Configuration.

## LEDs

The LEDs on the BLD, along with their descriptions, are outlined below

- **FLT:** Indicates a 'low battery' fault.
- **HB:** Indicates power is on and the BLD is operational.
- **Charge:** Solid indicates the battery is charging.
- **Test LED:** Indicates testing when DIP 3 is turned ON.
- **FLT LED:** Flashes in cycles to indicate the state and any faults in the BLD [see Figure 5].
- **O1 LED:** Indicates a BLD fault.
- **O2 LED:** Indicates that the BLD is outputting and operating in rescue mode.
- **Power LED:** Solid LED indicates that the BLD is operational.
- **AC OUT LED:** Indicates that the EG8010 is operational.

## BLD LEDs

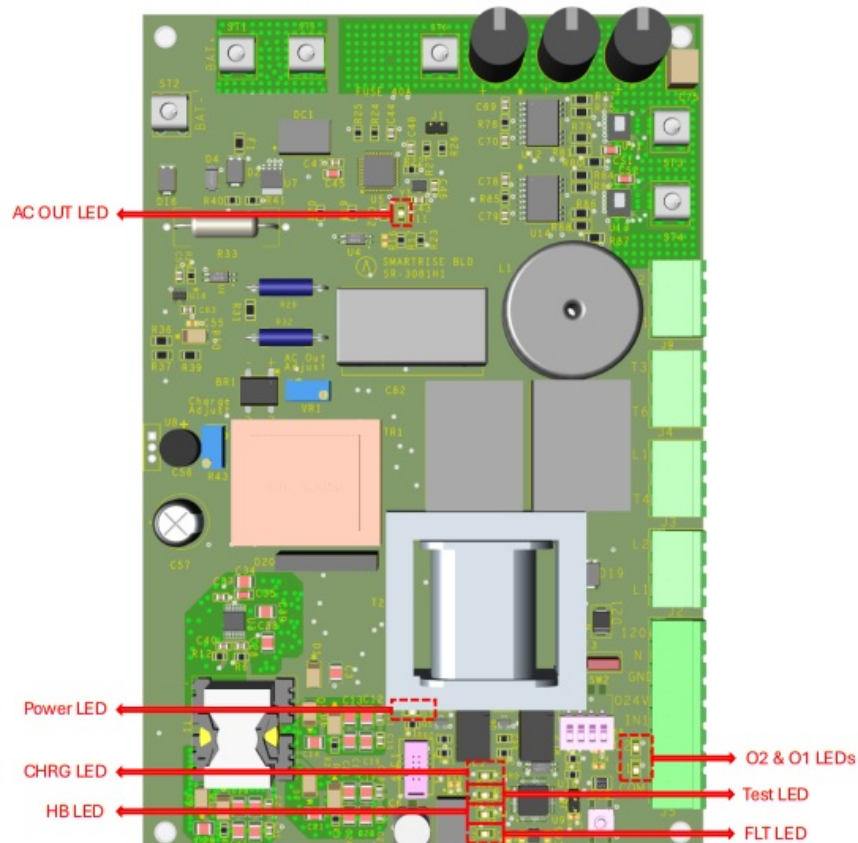

## DIP Switches

- **DIP 1:** Manual Battery Output (5 seconds)
- **DIP 2:** Not used
- **DIP 3:** Manual Battery Test (LED C indicates test)
- **DIP 4:** Not used

**NOTE:** All four DIP switches are set to OFF by default.

## Push Button

- **Reset:** Resets the board.

## J7 NO/NC BLD Configuration


- **NO:** C4 Hydro: Einvolvedd, C4 Traction, V2 Traction.
- **NC:** V2 Hydro

## Wiring Based on Main Line Voltage


The Battery Lowering Device can be configured to operate with 208 VAC, 240 VAC, or

480 VAC main line power.


### Main Line Voltage: 208 VAC

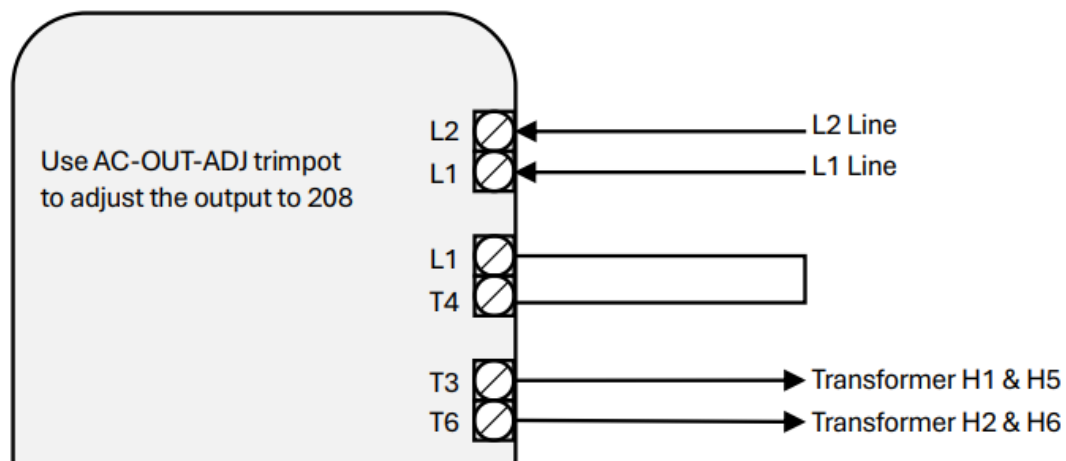

### Main Line Voltage: 240 VAC

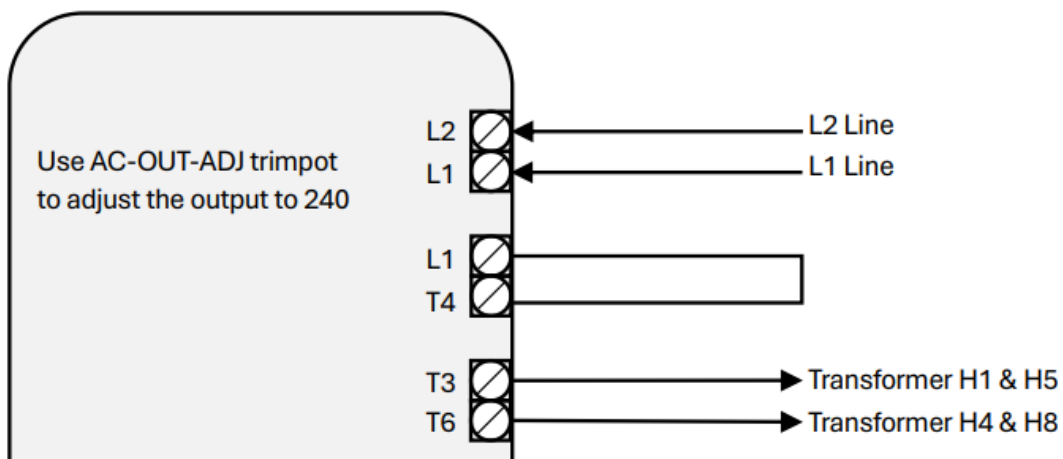

### Main Line Voltage: 480 VAC

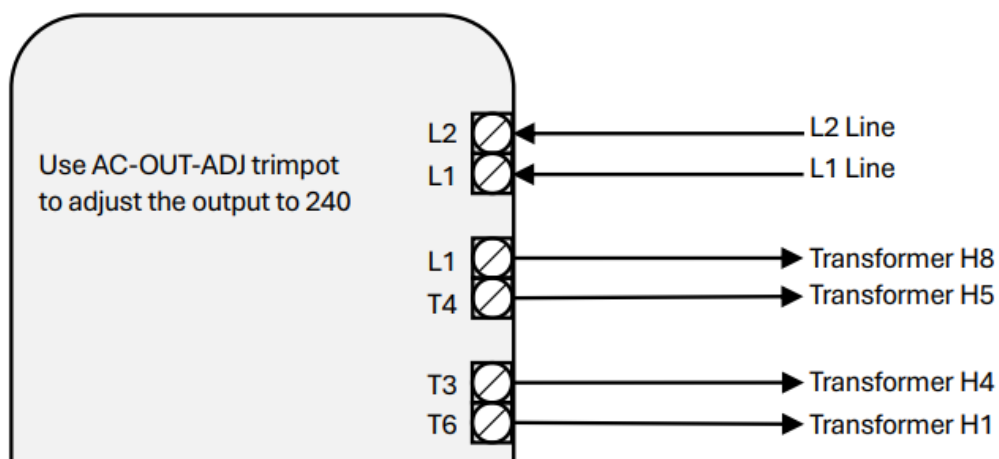

## Testing Procedure

### WARNING

DO NOT TOUCH THE BOARD WHILE THE MAIN POWER IS ON OR THE BLD IS IN



## OPERATION.

### Pre-Test Requirements

Before powering up the BLD, perform the following checks

1. Verify continuity between the following points
  - ST1 to GND
  - ST3 to GND
  - ST4 to GND.

**NOTE:** There should be no continuity (no beep).

### Test Procedure

Follow these steps to test the BLD

1. Turn on the main line power.
2. Set the battery switch to the ON position.
3. Observe the Power, HB, Charge, and Fault LEDs. All should illuminate initially.
4. Wait for 10 seconds; the Fault LED should turn off. If it does not turn off, press the reset button.
5. Turn off the battery switch.
6. Measure the DC voltage between ST2 and ST6 while pressing the reset switch. The reading should be between 28 – 32 VDC.

**NOTE:** If the voltage falls outside the range, turn OFF the battery disconnect switch and adjust the charging potentiometer to 31 – 32 VDC while keeping the reset switch pressed.

7. Once the voltage is confirmed, reverse the previous steps.
8. Turn off the main line. Within three seconds, the BLD should activate if IN1 and 024 are jumped (NC).
9. Confirm that the D11, HB, Power, and O2 LEDs are on.

**NOTE:** The O1 LED should remain off. If it turns on, the BLD has detected a fault.
10. During the test, adjust the AC output potentiometer to match the main line AC voltage. Measure the AC voltage on T3 and T6 of the BLD connector.

**NOTE:** The maximum AC output voltage is 240 VAC for both 240 VAC and 480 VAC main lines.

- ## Smart Battery Lowering Device Wiring

The diagram illustrates the electrical connections for the Smartrise BLD unit. Key components and connections include:

- Power Input:** L1, L2, and L3 are connected to the main power lines. L1 and L2 are connected to the 3 A switch. L3 is connected to the COM terminal.
- Control Transformer:** The T1 transformer provides control power to the BLD unit. Connections include X1, X2, X3, X4, and X5.
- Battery Disconnect Switch (DR):** A switch labeled DR is connected to the BLD unit and the battery monitor.
- Battery Monitor (MRD):** The MRD unit monitors the battery status. It has terminals for BATTERY POWER (503) and BATTERY FAULT (504).
- Grounding:** The chassis is grounded to the N (Neutral) line.

**Notes:**

- Battery Disconnect Switch must be in "ON" position for the BLD unit to function.

## Battery Removal and Replacement

This section provides important instructions to be followed during the installation and maintenance of the BLD unit.

**NOTE:** Battery servicing should be performed or supervised by personnel knowledgeable in batteries and the necessary precautions.

The batteries in the BLD are rechargeable, but they will eventually need replacement. Batteries must be replaced with Yuasa Genesis NPX-25 or an equivalent model.


**WARNING:** Reversing the polarity of the battery terminals may cause damage to the equipment.

**CAUTION:** Risk of explosion if the battery is replaced with an incorrect type.

**CAUTION:** Do not open or mutilate the batteries. Released electrolytes are harmful to the skin and eyes and can be toxic.

The following steps outline how to properly remove and replace a battery

1. Disconnect the main power to the BLD.
2. Open the BLD cabinet.
3. Turn off the battery disconnect switch.
4. Remove the screws located at the four corners to access the batteries.

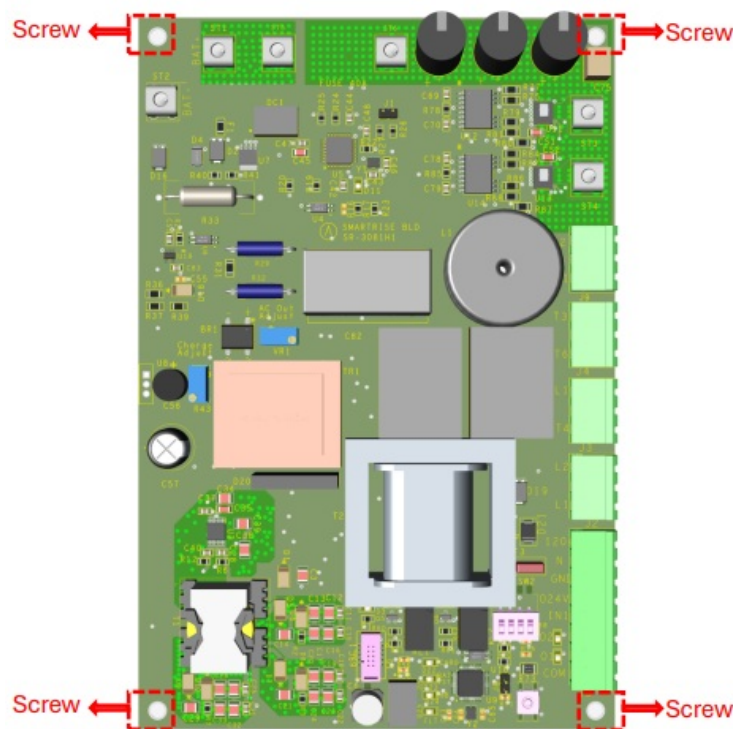

5. Remove the screws from ST1 and ST2.
6. Remove screws, lock washers, washers, and nuts from the power and ground cables.

7. Move the power and ground cables away from the battery set and cabinet.  
**CAUTION:** Risk of explosion if battery is replaced by an incorrect type. Dispose of used batteries according to the instructions.
8. Remove and replace the bad batteries.
9. Reinstall the nuts, washers, lock washers, and screws, and reconnect the power and ground cables.
10. Close the BLD cabinet.
11. Restore power to the BLD.
12. Dispose of the old battery according to local regulations.

## Troubleshooting Tips

Perform the following checks if the BLD does not power on when the main line is disconnected:

- Check that the BLD disconnect switch is in the ON position (SW1 and SW2 should show a short on the battery connector).
- Check the continuity between O24 & IN1.
- BAT+ and BAT- should measure 26 – 28 VDC for fully charged batteries with the battery connector connected to the board.
- T3 and T6 should measure the same as the main line voltage.
- Verify that there is 120 VAC between terminals 120 and N for battery charging (charging will occur regardless of the BLD disconnect switch position) and that there is 28 – 32 VDC while the reset button is pressed.
- Check that the 40A fuse is not blown.
- Ensure proper incoming main line voltage.
- Verify proper outgoing wiring to the control transformer.
- Check for 24 VDC from the controller at terminal COM.
- Ensure correct battery connections.
- Monitor the flashing red LED code on the SR-3081H1 board

The table below lists and describes the different types of faults that may be encountered.

Fault Type	Blink Cycle	Board Type	Description
Low Battery	Solid	BLDh	Triggered when the battery voltage falls below the low voltage threshold while not outputting.
AC Out Fault Input	Solid	BLDh	Activated when the AC Out Fault LED is off while the ERD is outputting.
Battery Test Fail	900ms	BLDh	Triggered when the battery voltage difference across 20 samples exceeds 1V, indicating a faulty battery. This test runs every 24 hours or when DIP 3 is turned on while not outputting.
Rescue Timeout	300ms	BLDh	Triggered when the rescue power (outputting state) reaches the ten-minute timeout. The timer resets when the system reboots or mainline power is restored.

## Disposal

Dispose of used batteries according to local regulations.

**CAUTION:** Do not dispose of batteries in a fire, as they may explode.

## FAQs

**Q: What should I do if the FLT LED indicates a fault?**


A: If the FLT LED indicates a fault, check the power switch position and battery voltage. Ensure proper connections and consult the troubleshooting tips in the manual for further assistance.

## Documents / Resources

BATTERY LOWERING DEVICE V.2

QUICK START GUIDE

VERSION 1.02



SMARTRISE

[SMARTRISE V.2 Smart Battery Lowering Device \[pdf\]](#) User Guide  
V.2 Smart Battery Lowering Device, V.2, Smart Battery Lowering Device, Battery Lowering Device, Lowering Device, Device

## References

- [User Manual](#)

SMARTRISE  
Battery Lowering Device, device, Lowering Device, Smart Battery Lowering Device, SMARTRISE, V-2, V.2 Smart Battery Lowering Device

## Leave a comment

Your email address will not be published. Required fields are marked \*

Comment \*

Name

Email

Website

☐ Save my name, email, and website in this browser for the next time I comment.

Post Comment

## Search:

e.g. whirlpool wrf535swhz

Search

[Manuals+](#) | [Upload](#) | [Deep Search](#) | [Privacy Policy](#) | [@manuals.plus](#) | [YouTube](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.