


Systemair PCA1000 Sensor-control module differential pressure-volume Instructions

Home » SYSTY Mair » Systemair PCA1000 Sensor-control module differential pressure-volume Instructions

Systemair PCA1000 Sensor-control module differential pressure-volume

Contents

- 1 General notes
 - 1.1 Structure of the operating instructions
 - 1.2 Exclusion of liability
- 2 Safety instructions
- 3 Product overview
 - 3.1 Function
 - 3.2 Storage
 - 3.3 Disposal / recycling
- 4 4 Mounting
- 5 Electrical installation
 - 5.1 EMC-compatible installation of control lines
 - 5.2 Connection Voltage supply
 - 5.3 Output voltage 0 10 V
 - 5.4 Input for switch over Setpoint 1/2
- 6 Connection and operating elements
- 7 Programming
 - 7.1 Select operation mode
 - 7.2 Start-up
 - 7.3 Menu structure
 - 7.4 Display unit (metric / inch)
 - 7.5 Parameter table
 - 7.6 Nozzle coefficient (K-Factor)
 - 7.7 Zero point adjustment (Autozero / Offset)
 - 7.8 Check sensor function
- 8 Enclosure
 - 8.1 Technical data
 - 8.2 Connection diagram
 - 8.3 Dimensions [mm]
 - 8.4 Manufacturer reference
- 9 Documents / Resources
- **10 Related Posts**

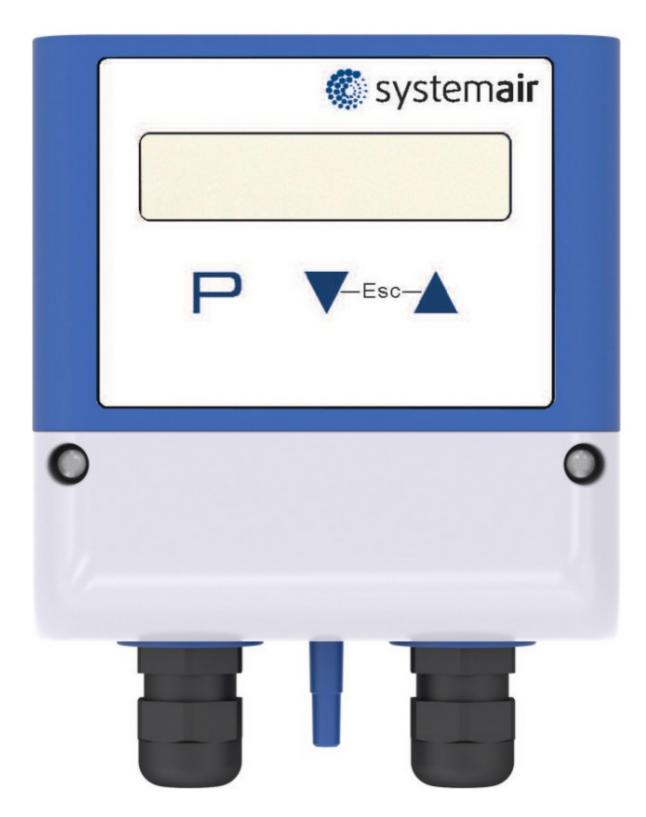

General notes

Structure of the operating instructions

Before installation and start-up, read this manual carefully to ensure correct use!

We emphasize that these operating instructions apply to specific units only, and are in no way valid for the complete system!

Use these operating instructions to work safely with and on the device. They contain safety instructions that must be complied with as well as information that is required for failure-free operation of the device.

Keep these operating instructions together with the device. It must be ensured that all persons that are to work on the device can refer to the operating instructions at any time.

To allow for future developments, construction methods and technical data given are subject to alteration. We do not accept any liability for possible errors or omissions in the information contained in data, illustrations or drawings provided. We accept no liability for damage caused by misuse, incorrect use, improper use or as a consequence of unauthorized repairs or modifications.

Safety instructions



Attention!

- Mounting, electrical connection, and start-up operation may only be carried out by an electrical specialist in accordance with electrotechnical regulations (e.g. DIN EN 50110 or DIN EN 60204)!
- Persons entrusted with the planning, installation, commissioning and maintenance and servicing in connection
 with the device must have the corresponding qualifications and skills for these jobs. In addition, they must be
 knowledgeable about the safety regulations, EU directives, rules for the prevention of accidents and the
 corresponding national as well as regional and in-house regulations.
- It is strictly forbidden for work to be carried out on any components while they are connected to live voltage.
- The safe isolation from the supply must be checked using a twopole voltage detector.
- The owner is obliged to ensure that the device is operated in perfect working order only.
- Inspect electrical equipment periodically: retighten loose connections immediately replace damaged lines and cables.
- Never clean electrical equipment with water or similar liquids.
- A separate fault and performance monitoring-system with an alarm signal function is necessary in order to prevent personal injuries and material damages during malfunctions and in case the device fails. Substitute operation must be taken into consideration!

Intended use

These devices are intended exclusively for measured value acquisition of differential pressures (non-aggressive gases). Their operation is only permitted under observance of the specifications in these operating instructions. Any other use above and beyond this will be considered as improper use. The manufacturer will not be liable for any damage resulting from this. The company using it bears the sole risk.

Product overview

Function

Sensor-control module with differential-pressure sensors in proven ceramic-cantilever technology for climate and clean-room application.

The pressure range from 0 to 6000 Pa (24 in.wg) is covered with 2 types of device. With each type four measuring ranges are programmable.

Function when the pressure at the "Plus"- connection exceeds the pressure at the "Minus"- connection. Depending on the programmed Mode the device can be used as sensor or as a control module for pressure or volume.

- For operation as pressure sensor the device supplies an output signal (0...10 V) proportional to the measuring range.
- For operation as air volume sensor the device supplies an out-put signal (0..10 V) proportional to the air volume

measuring range (INFO / Range qV). Function in combination with centrifugal fans and measuring device in the inlet ring. The controller calculates the air volume of the fan from the "K-Factor" and pressure differential between the suction side and the inlet duct.

• For operation as control module for pressure or volume the purpose of the device is to reach and maintain the target value set. To accomplish this, the measured actual value (sensor value) is compared with the adjusted target value, and the controlled value is deduced from this. Controlled output (0...10 V) e.g. for activating a speed controller for fans or an EC-fan directly.

Storage

- The device must be stored in its original packaging in a dry and weather-proof room.
- Avoid exposure to extreme heat and cold.
- Avoid over-long storage periods (we recommend a maximum of one year).

Disposal / recycling




Disposal must be carried out professionally and in an environmentally friendly way in accordance with the respective national legal stipulations.


"Separate the materials by type and in an environmentally friendly way.

"If necessary, commission a specialist company with the waste disposal.

4 Mounting

- Before installation remove the device from the packing and check for any possible shipping damage!
- Assemble the device on a clean and stable base. Do not distort during assembly! Use the appropriate mounting
 devices for proper installation of the unit!
- Use the templates printed on the device packing to mark the fastening bore holes.
- The pressure measuring depends on position, therefore the mounting must be made vertical and as possible on a vibration- free place (cable inlet and pressure connections down).
- The pressure line's connection should be with plastic-hose (in building), inside diameter 4 / 5 mm. For a firm hold of the hose, its inside diameter must be 1 mm smaller than the outside diameter of the hose nozzle (step spigot 5 / 6 mm).
- Remove the connection cover for mounting, electrical connection and setting of the measuring range. Close
 the lid again carefully before start-up (tightening torque of the lid screws 1.1 Nm).





Vertical mounting

Drilling template on packing

Electrical installation

EMC-compatible installation of control lines

Pay attention to maintain sufficient distance from powerlines and motor wires to prevent interferences. When using a shielded cable the shield must be connected (as short and with as low an induction as possible!) to the PE conductor on one side at the signal input (of the evaluation unit).

Connection Voltage supply

Connection Voltage supply at terminals: "+US" and "GND". Here, it must be strictly observed that the mains voltage lies within the allowable tolerance specifications (Technical data and nameplate affixed to the side).



Danger due to electric current

Only PELV current sources which ensure safe electrical isolation of the operating voltage in accor dance with IEC/DIN EN 60204-1 must be used. There is no potential isolation between supply vol tage and output signal.

Output voltage 0 - 10 V

Connection to Terminals "A" – "GND" (Imax Technical data). It is not permissible to connect outputs of several devices to each other!

Input for switch over Setpoint 1/2

Via voltage at terminals "1" and "2" (10... 24 V DC) a switchover between Setpoint 1 and Setpoint 2 is possible (note polarity connection diagram).

- Voltage OFF => Setting "Setpoint 1" active
- Voltage ON => Setting "Setpoint 2" active


Setpoint 1active

100 Pa (0.401 in.wg) Δp The active Setpoint is indicated in the menu INFO, an active "Setpoint 2" is signalized by the moon symbol.


Setpoint 2 active

80 Pa (0.321 in.wg) Δp


Connection and operating elements

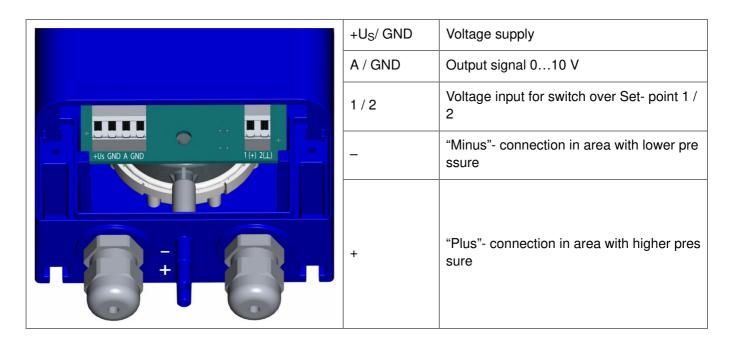

Multipurpose LC display and keyboard

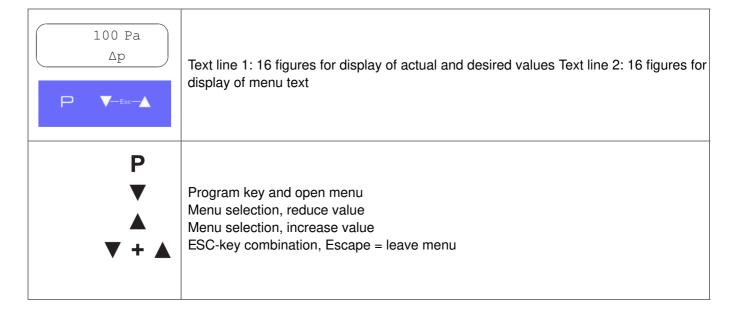

Messages on the display

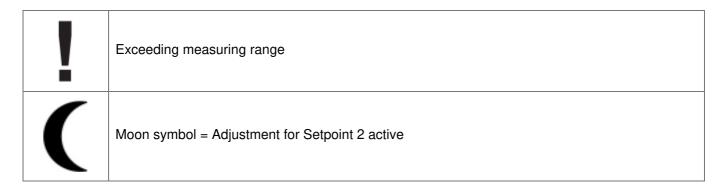

Programming

Select operation mode



Information

Simple installation is possible through the selection of the preprogrammed mode of operation. This determines the basic function of the device, factory set 4.01.


Mode	Function
4.00	Pressure sensor output 010 V proportional to measuring range
4.01	Pressure controller (PID): output 010 V depending on adjusted Setpoint and measured actual value.
5.00	Air volume sensor: Output 010 V propotional to measuring range (depending on setting for K-Factor)
5.01	Air volume controller (PID): Output 010 V depending on adjusted Setpoint and measur ed actual value

Start-up


Procedure

- 1. You must mount and connect the device in accordance with the operating instructions.
- 2. Double check that all connections are correct.

- 3. The supply voltage must match the information on the rating plate.
- 4. Set the mode, unit and measuring range and adjust the sensor in the BASE SETUP.
- 5. Set the parameters for control operation for the modes 4.01 and 5.01 under SETTING.

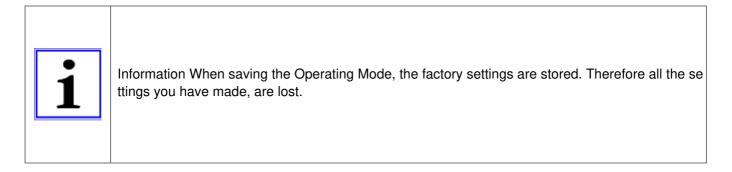


Menu structure

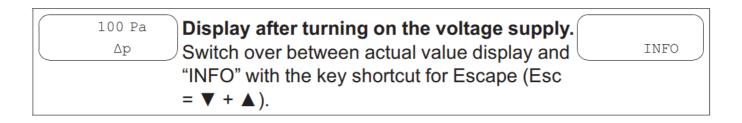

Selection of the menu group (e.g. BASE SETUP) to the right through the ▼-key, to the left through the ▲-key. Youcangotothemenuitemsinthemenugroups (e.g. mode) by using the P key. Use the arrow keys to move up and down within the menu group.

To make adjustments, press the P key after selecting the menu item. If the previously set value starts to flash, it can be adjusted with the ∇ + \triangle keys and then saved with the P key. To exit the menu without making any changes, use the "Esc" short-key, i.e., the originally set values remain.

Example for Mode 4.01 (Factory setting)

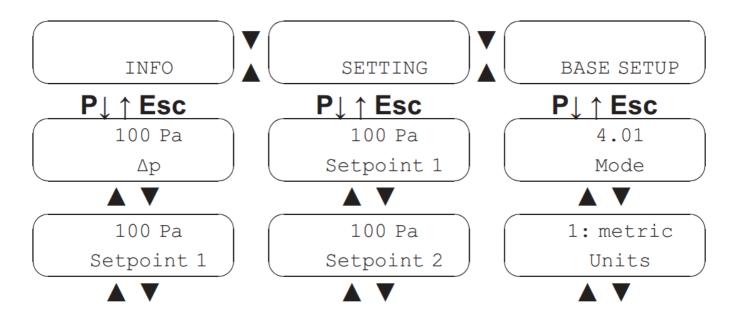

Reprogramming Mode 4.01 to 5.00 in "BASE SETUP"

1		2	3	4	5	6	7
4	.01	D	«4.01»	A («5.00»	D	5.00
М	lode	P	Mode		Mode	P	Mode

Display unit (metric / inch)

The display can be switched between SI units (factory setting) and imperial (US) units BASE SETUP / Units.

Conversion factors

Pressure: 1.0 in.wg = 254 Pa
Air flow: 1.0 cfm = 0.5885 m 3 /h

inlet ring: K-Factor US = 9.3 x K-Factor SI

Parameter table

Example for PCA1000D2

Parameter	arameter Display / factory setting						
Mode	4.00	4.01	Mode				
	Information						
Δρ	0 Pa (0.0 00 in.wg)	0 Pa <i>(0.000 in.wg)</i>	_	_	Display actual value fo r differential pressure		
qV	-	_	0 m ³ /h (0 cfm)	0 m ³ /h (0 cfm)	Display actual value fo r airflow		
Setpoint 1	_	500 Pa <i>(2.000 in.wg)</i>	_	1185 m ³ /h (697 cfm)	Display active Setpoin t		

Range qV	_	_	2371 m ³ / h <i>1394 cf</i> <i>m</i>)	2371 m ³ /h <i>(1394 cfm)</i>	Air volume measuring range depending on s ensor measuring rang e and K-Factor
Uout	0.0 V	9.9 V	0.0 V	9.9 V	Magnitude of the output voltage 010 V
UNIcon	1.00	1.00	1.00	1.00	Software version
Δρ	_	_	0 Pa (0.0 00 in.wg)	0 Pa <i>(0.000 in.wg)</i>	Display actual value fo r volume measuremen t
	SETTII	NG 4.01 + 5.01			Setting
Setpoint 1	-	500 Pa <i>(2.000 in.wg)</i>	_	1185 m ³ /h <i>(697 cfm)</i>	Setpoint 1 ¹
Setpoint 2	-	500 Pa (2.000 in.wg)	_	1185 m ³ /h <i>(697 cfm)</i>	Setpoint 2 ¹ (active if v oltage at ter- minals 1, 2)
Pband	_	500 Pa <i>(2.000 in.wg)</i>	_	1185 m ³ /h <i>(697 cfm)</i>	Pband ^{1,2}
Min. Uout	-	0.0 V	_	0.0 V	Min. output voltage: 0. 0 10.0 V (priority over "Max. Uout")

Max. Uout	_	10.0 V		_	10.0 V		Max. output voltage: 1 0.0 V		
	BA	ASE SETUP		,		Base set	up		
Mode	4.00	4.01	Ę	5.00	5.01	Mode			
Units	metric: f	metric: Pa, m ³ /h, K-Factor <i>inch: in.wg, cfm, K-Factor US</i> SI units or Imperial units (US)					or Imperial units (US)		
Measuring Ra		2: 050 3: 030	00 Pa <i>(0. 2</i> 00 Pa <i>(0. 2</i> 00 Pa <i>(0. 3</i> 00 Pa <i>(0. 3</i>	2.0 in.wg) 1.2 in.wg)		PCA1000D2 Adjustable measuring range			
nge	1: 06000 Pa (0. 24.0 in.wg) 2: 04000 Pa (0 16.0 in.wg) 3: 03000 Pa (0 12.0 in.wg) 4: 02000 Pa (0 8.0 in.wg)					PCA6000 ng range	DD2 Adjustable measuri		
K-Factor K-Fa ctor US	-	_	75	(697)	75 <i>(697)</i>	Nozzle coefficient (K- Factor) fo owing table			
Autozero	OFF => ON					Automati	c "0" offset		
Offset	0 Pa <i>(0.000 in.wg)</i>					en "Auto-	offset (auto- matically where zero") Setting range: + Pa (+/- 4.000 in.wg)		

sensor measuring range)

- 2. small value = quick regulation, great value = slow regulation (high stability)
 - Parameter for selected mode not available (xxx) Values for Imperial units (US)

Nozzle coefficient (K-Factor)

Maximum K-I	Factor depend	ling on the n	neasuring ra	inge of the p	ressure ser	sor		
Range								
[Pa]	200	300	500	1000	2000	3000	4000	6000
[in.wg]	0.8	1.2	2.0	4.0	8.0	12.0	16.0	24.0
Max.								
K-Factor	4596	3752	2906	2055	1453	1186	1027	839
US	32767	32767	32767	32500	22980	18763	16250	13268

Air volume measuring range [m 3 /h], [cfm] depends on selected measuring range of pressure senosr [Pa], [in.wg] and selected "KFactor (US)". In menu "INFO" display for "Range qV". Maximum measuring range at input of each possible maximum "K-Factor (US)"

Air flow measuring range: max. 65000 m 3 /h (38257 cfm) depending on setting of measuring range and K-Factor.

Zero point adjustment (Autozero / Offset)

A zero-point adjustment is possible if the actual value is not "0 Pa Δp " or "0 m 3 /h qV" in pressureless state. A zero point calibration is possible with the function "Autozero" .

This may be necessary, for example, in case of heavy thermal fluctuations in the sensor environment or non-vertical mounting

Procedure

- 1. Pull off the pressurised hoses.
- 2. Switch function "Autozero" in BASE SETUP to "ON".
- 3. The display switches to the actual value display and the value "0" is displayed after zero point calibration has taken place.
- 4. The necessary difference up to "0" is displayed in the BASE SETUP under "Offset".

Alternatively to the automatic zero point calibration, the offset value can also be set manually BASE SETUP / Offset.

Check sensor function

- 1. Program Mode 4.00 for pressure sensor.
- 2. Connect the voltage supply (+US / GND), disconnect output 0 ...10 V (A / GND).
- 3. Remove pressure hoses and measure output signal, nominal = 0 V.
- 4. Create pressure at the "+" connection against the "-" connection (e. g. by carefully blowing in), measure the output signal (0...10 V measuring range).
- 5. If the sensor works, reconnect the pressure hoses and check these if necessary.

Enclosure

Technical data

Туре	PCA1000D2	PCA6000D2
Part-No.	76739 (320064-42)	76740 (320065-42)
Voltage supply	1024 V DC (+20 %) Protected against reverse polarity	


	@ U _S 10 V DC	@ U _S 1324 V DC
Max. load output 010 V (short-circuit-proof)	0.3 mA	10 mA
Max. current consumption ca.	6 mA	14 mA

Pressure connections "+, -"	Hose connectors d = 5 / 6 mm (0.20 / 0.24 inch)
Housing	PC (polycarbonate) Fire protection classification UL94V0
Use position	vertical (measuring depends on position)
Protection class	IP54 according EN 60529
Weight	approx. 230 g (0.50 lb)
Permissible temperature range for op- eration	-1050 °C (14122 °F)
Permissible temperature range for storage and tr ansport	-3050 °C (-22122 °F)
Permissible rel. humidity	85 % no condensation
One-sided permissible overload	0.1 bar (80 in.wg)
Burst prssure	at room temperature: 0.2 bar (80 in.wg)
	at 70 °C (158 °F): 0.15 bar (60 in.wg)
Maximum cross section of terminals	1.5 mm2 / AWG16
Interference emission	according EN 61000-6-3 (domestic household applications)
Interference immunity	according EN 61000-6-2 (industrial applica- tions)

Accuracy and measuring ranges			
Туре		PCA1000D2	PCA6000D2
		01000 Pa	06000 Pa
Pressure measuring range max.		(0 4.0 in.wg)	(0 24.0 in.wg)
Tolerance zero point max.*)	%	+/- 0.9	+/- 0.9
Tolerance full scale max.	%	+/- 1.3	+/- 0.7
Resolution	%	0.1	0.1
Total of linearity, hysteresis and repeatability max.	%	0.6	0.6
Long term stability according to DIN EN 60770	%	+/- 1.0	+/- 1.0
Temperature coefficient typical	% / 10K	+/- 0.2	+/- 0.2
Temperature coefficient max.	% / 10K	+/- 0.4	+/- 0.4
Temperature coefficient sensitivity typical	% / 10K	+/- 0.2	+/- 0.2
Temperature coefficient sensitivity max.	% / 10K	+/- 0.4	+/- 0.4


The accuracy data are percentages and refer to the maximum possible measuring range of the respective type. Test conditions: $25 \, ^{\circ}$ C, $45 \, ^{\circ}$ RH, voltage supply $12 \, ^{\circ}$ VDC

Connection diagram

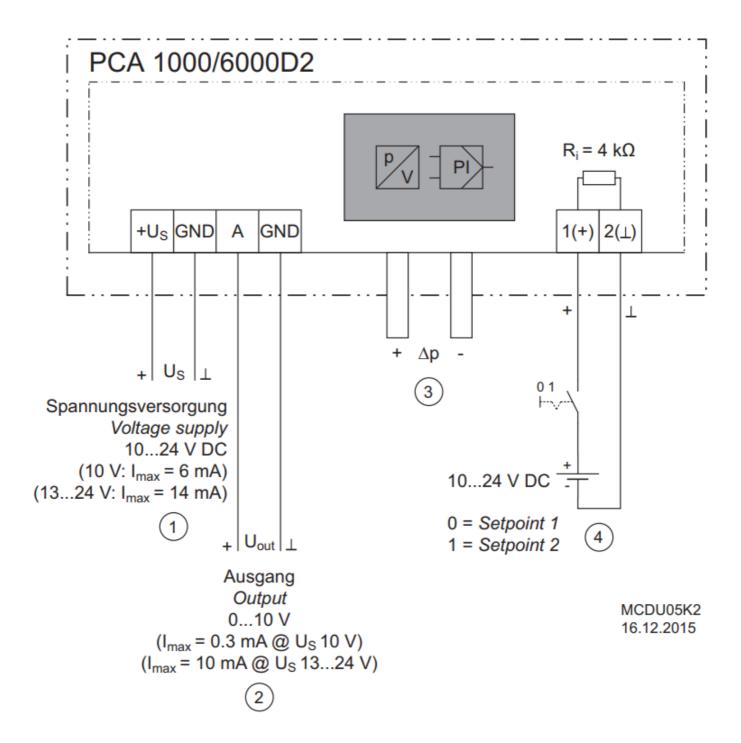

- 1. Voltage supply 10...24 V DC
- 2. Output 0...10 V
- 3. Pressure connections
- 4. Voltage input for switch over Setpoint 1 / Setpoint 2

Dimensions [mm]

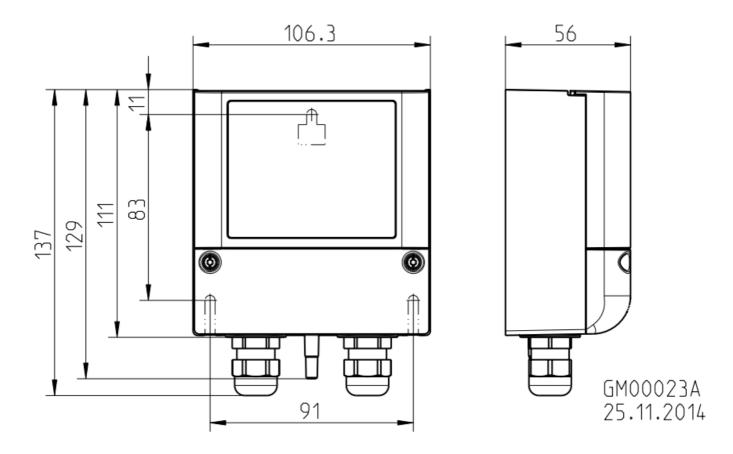

Manufacturer reference

Our products are manufactured in accordance with the relevant international regulations. If you have any questions concerning the use of our products or plan special uses, please contact:

Systemair
Industrievägen 3
73930 Skinnskatteberg
Telefon:+46 (0) 222 440 00
Telefax:+46 (0) 222 440 99
mailbox@systemair.se
www.systemair.se



Documents / Resources



SYSTY Mair PCA1000 Sensor-control module differential pressure-volume [pdf] Instruction

PCA1000 Sensor-control module differential pressure-volume, Sensor-control module differential pressure-volume, differential pressure-volume, pressure-volume, 6000D2