



TCS QWL2040 BACnet Building Manager Instructions

[Home](#) » [TCS](#) » TCS QWL2040 BACnet Building Manager Instructions 

TCS QWL2040 BACnet Building Manager



Contents

- [1 Technical Bulletin](#)
- [2 Customer Support](#)
- [3 Documents / Resources](#)
 - [3.1 References](#)
- [4 Related Posts](#)

Building Manager Reset

This technical bulletin applies to all versions of the QD2040 Building Manager, QD3041 BACnet Building Manager, and the QWL2040 Panel While QD/QWL Building Managers are designed to run continuously for long periods of time, they do occasionally stop functioning properly. This can happen for a host of reasons, such as a power loss or Ethernet service interruption, changes in network wiring, or other anomalies which may not be readily identifiable.


When this happens, resetting the device will usually restore the device to normal operation; the steps are listed below.

NOTE: Before attempting to reset the device, ensure the power cord is plugged into a working 120VAC outlet

QD2040/QD3041


The reset process is the same for both models:

1. Press and hold the Power button on the front of the device until the blue indicator light shuts off.
2. Pause five seconds, then press the Power button again. The blue indicator light will immediately turn on.
3. Wait five minutes for the device to completely reboot.

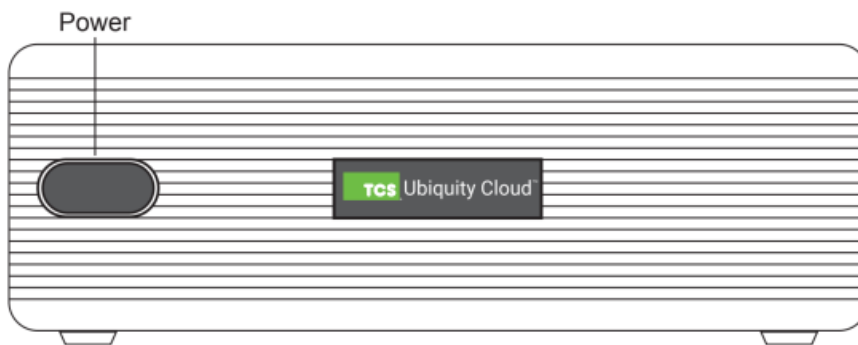

QWL2040 Panel

1. Press and hold the Reset button on the front of the device until the amber Power light shuts off.
2. Pause five seconds, then press the Power button again. The amber Power light will immediately turn on.
3. Wait five minutes for the device to completely reboot.

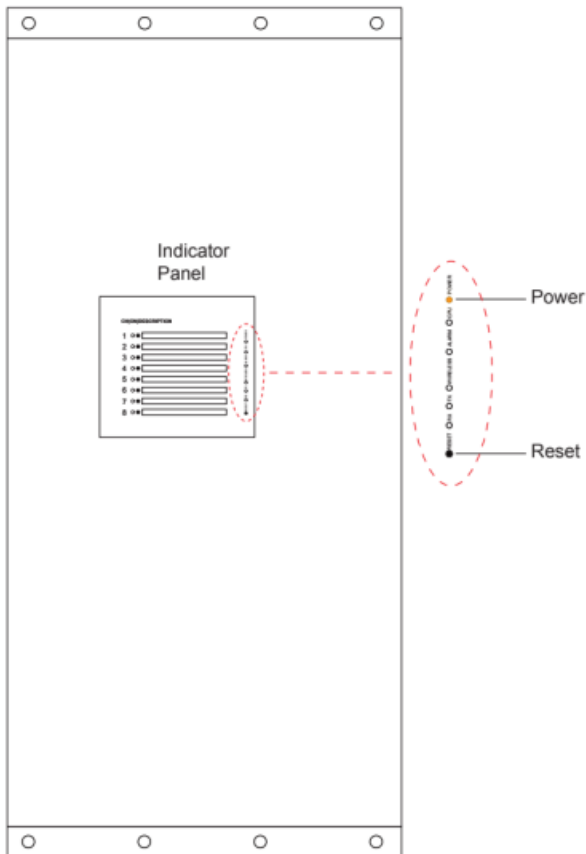

Customer Support

If the device fails to power on or return to normal operation, call TCS Technical Support at 800.388.9383, ext. 2 (Monday – Friday, 7:00 AM through 7:00 PM CST)

2800 Laura Lane Middleton, WI 53562 | 800.288.9383 | www.tcsbasys.com



Documents / Resources

	<p>TCS QWL2040 BACnet Building Manager [pdf] Instructions QD2040, QD3041, QWL2040, QWL2040 BACnet Building Manager, QWL2040, BACnet Building Manager, Building Manager, Manager</p>
--	--

References

- [User Manual](#)

Manuals+. Privacy Policy

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.