



TROVE T3M7724LXK1V Altronix Mercury Access and Power Integration Kit Instruction Manual

[Home](#) » [TROVE](#) » TROVE T3M7724LXK1V Altronix Mercury Access and Power Integration Kit Instruction Manual



TROVE T3M7724LXK1V Altronix Mercury Access and Power Integration Kit



Contents

- [1 Altronix/Mercury Wired Kits](#)
- [2 Overview](#)
- [3 Hardware And Accessories](#)
- [4 Mechanical](#)
- [5 Installation Instructions](#)
- [6 T3M7724LXK1\(D\)V Configuration](#)
- [7 Trove3 Enclosure Dimensions](#)
- [8 Customer Support](#)
- [9 Documents / Resources](#)
 - [9.1 References](#)
- [10 Related Posts](#)

Altronix/Mercury Wired Kits

Models Include

T3M7724LXK1V

24 Door Kit with Fused Outputs Accommodates one (1) Intelligent Dual Reader Controller and eleven (11) Dual Reader Interface Modules.

Each fully assembled kit includes:

- Trove3 enclosure with TM3 Altronix/Mercury backplane and TMV2 Mercury door backplane
- Two (2) AL1024XB2V – Power Supply/Chargers
- Two (2) ACMS12 – Dual Input/Output Fuse Protected Access Power Controllers
- Two (2) PDS16 – Dual Input/Output Fuse Protected Power Distribution Modules
- Two (2) VR6 – Voltage Regulators
- One (1) Rocker Switch Bracket with Two (2) Rocker Switches (Not evaluated by UL)
- Wire harnesses and finger duct

T3M7724LXK1DV

24 Door Kit with PTC Outputs

Accommodates one (1) Intelligent Dual Reader Controller and eleven (11) Dual Reader Interface Modules. Each fully assembled kit includes:

- Trove3 enclosure with TM3 Altronix/Mercury backplane and TMV2 Mercury door backplane
- Two (2) AL1024XB2V – Power Supply/Chargers
- Two (2) ACMS12CB – Dual Input/Output PTC Protected Access Power Controllers
- Two (2) PDS16CB – Dual Input/Output PTC Protected Power Distribution Modules
- Two (2) VR6 – Voltage Regulators
- One (1) Rocker Switch Bracket with Two (2) Rocker Switches (Not evaluated by UL)
- Wire harnesses and finger duct

Overview

Altronix Trove Plus kits are pre-wired, pre-assembled and consist of Trove3M3 enclosure/backplane with factory installed Altronix power supply/ chargers and sub-assemblies, wire harnesses and finger duct.

Configuration Chart:

Altronix Model Number	220V AC 60Hz Input Current (A)	Power Supply Board Input Fuse Rating	Power Supply Board Battery Fuse Rating	Nominal DC Output Voltage Range		Maximum Supply Current for Main Outputs on Power Supply board and ACMS12(CB) Access Power Controller's outputs	Fail-Safe /Fail-Secure or Dry Form "C" Outputs	Current Per ACM S12(CB) and PDS 16(CB) Output (A)	ACM S12(CB) Board Input Fuse (PTC) Rating	ACM S12(CB) Board Output Fuse (PTC) Rating	PDS 16(CB) Board Input Fuse (PTC) Rating	PDS 16(CB) Board Output Fuse (PTC) Rating
				Pow er S uppl y 1	Pow er S uppl y 2							
				Outp ut R ange (VDC)	Outp ut R ange (VDC)							
T3M7724LXK1V	5.0	5A/ 250V	15A / 32V	20.17- 26.4	20.17- 26.4	24VDC @ 9.4A	24	2.5	15A/ 32V	3A/ 32V	15A/ 32V	3A/ 32V
T3M7724LXK1DV								2.0	9A	2.5A	9A	2.5A

Hardware And Accessories

- Two (2) tamper switches (Altronix Model TS112 or equivalent).
- Cam lock.
- Battery leads.

Mechanical

- 16 Gauge enclosure with ample knockouts for convenient access.
- Enclosure Dimensions (H x W x D): 36.12" x 30.125" x 7.06" (917.5mm x 768.1mm x 179.3mm).


Installation Instructions

Wiring methods shall be in accordance with the National Electrical Code/NFPA 70/ANSI, and with all local codes and authorities having jurisdiction.

Product is intended for indoor use only.

1. Remove backplane from enclosure. Do not discard hardware.
2. Mark and predrill holes in the wall to line up with the top three keyholes in the enclosure. Install three upper fasteners and screws in the wall with the screw heads protruding. Place the enclosure's upper keyholes over the three upper screws, level and secure. Mark the position of the lower three holes. Remove the enclosure. Drill the lower holes and install the three fasteners. Place the enclosure's upper keyholes over the three upper screws. Install the three lower screws and make sure to tighten all screws.
3. Mount included UL Listed tamper switches (Altronix Model TS112 or equivalent) in desired location, opposite hinge. Slide the tamper switch bracket onto the edge of the enclosure approximately 2" from the right side (Fig. 1, pg. 2). Connect tamper switch wiring to the Access Control Panel input or the appropriate UL Listed reporting device. To activate alarm signal open the door of the enclosure.
4. Refer to the XBV Power Supply/Charger Installation Guide for AL1024XB2V and corresponding Sub-Assembly Installation Guides for PDS16(CB) and ACMS12(CB) for further installation instructions.
5. Position Lenel/Mercury access controller modules over corresponding spacers and depress onto snap on spacers (Fig. 2-4, pg. 3-5).

Fig. 1

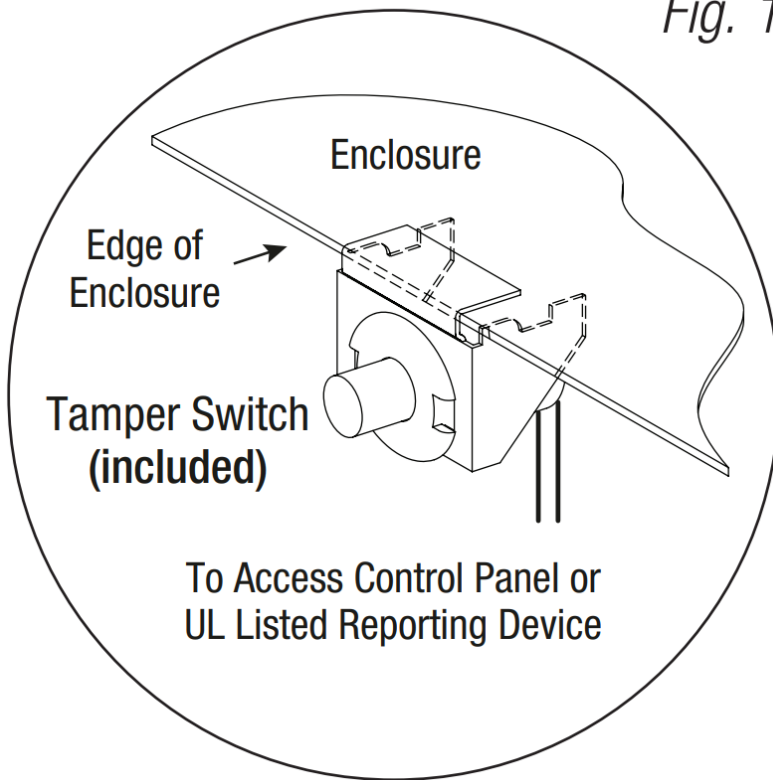

6. Connect wire harnesses to Lenel/Mercury access controller modules (Fig. 2-3, pg. 3-4).
7. Mount backplane to enclosure with hardware.


T3M7724LXK1(D)V Configuration

1. Position access controller module over corresponding spacers and depress onto snap on spacers (Fig. 2, pg. 3).
2. Mount backplane to enclosure with hardware.

Access Controller Position Chart for the Following Models:

LenelS2 / Mercury Access Controller	Pem Mounting						
LNL-2220 / LP1502	E						
LNL-1320-S3 / MR52	A	B	C	D	F	G	H

Fig. 2

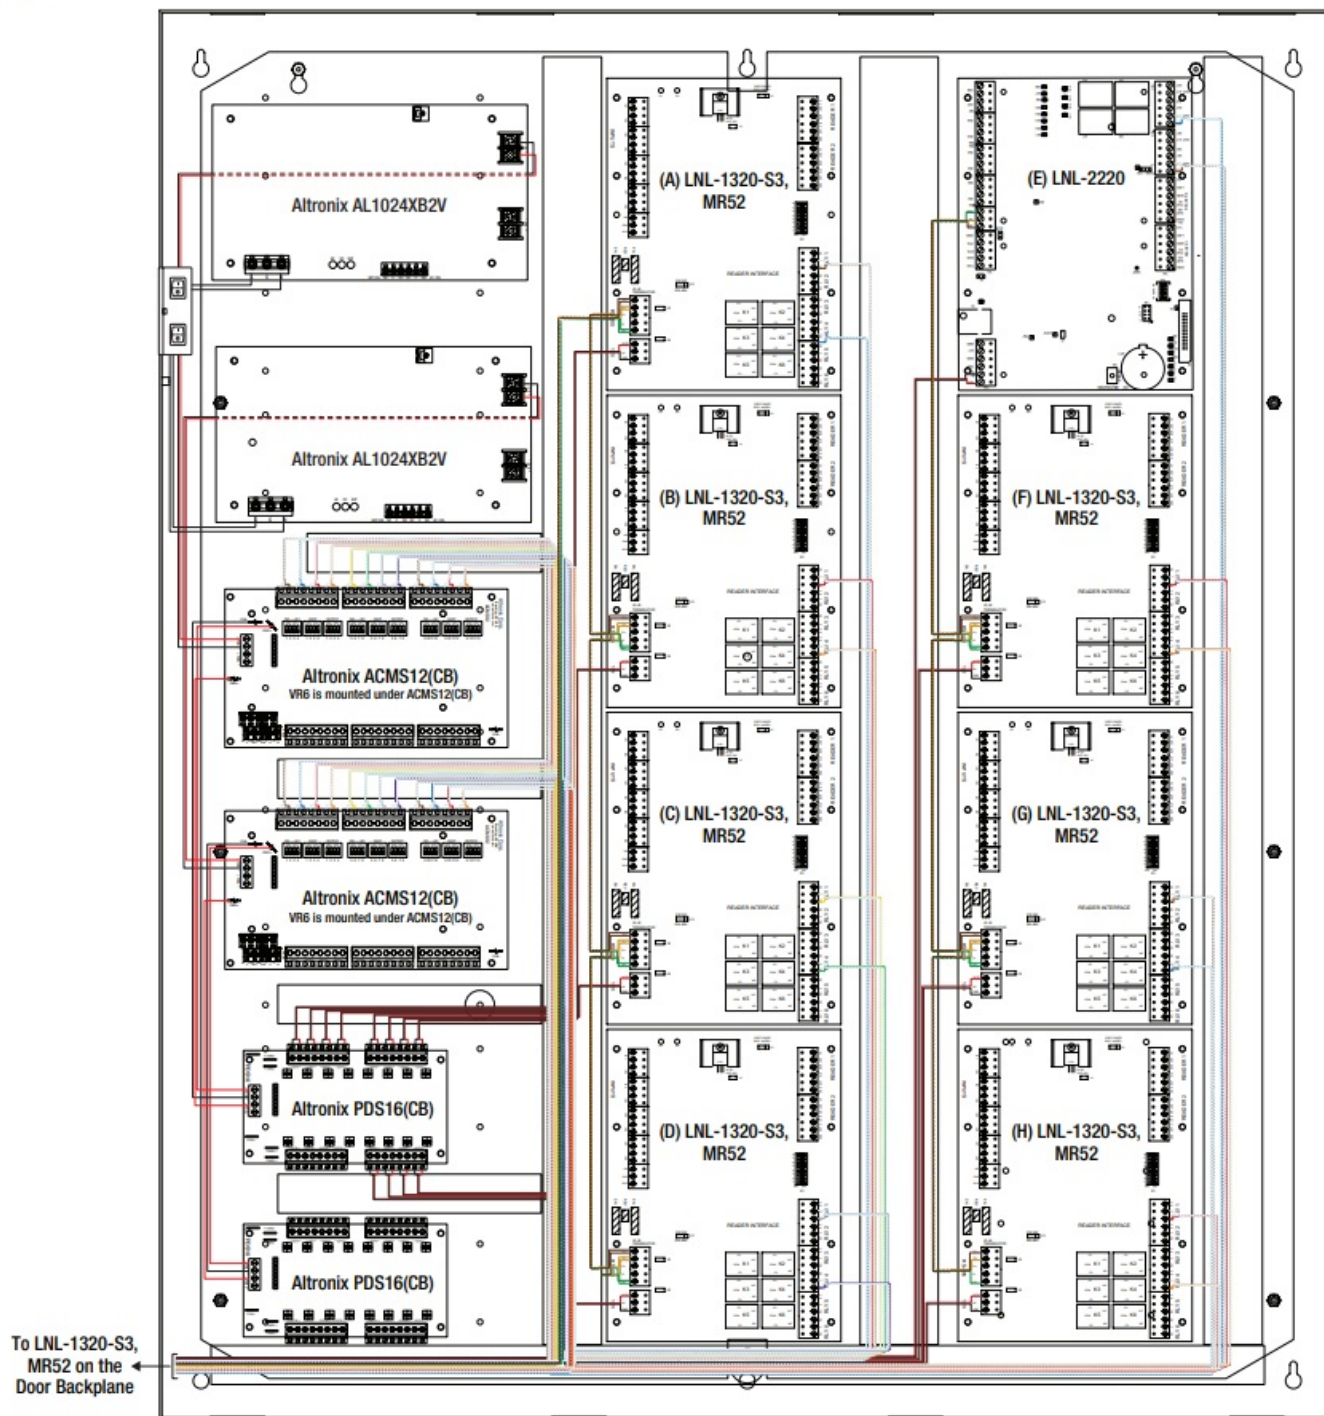


T3M7724LXK1(D)V Door Backplane Configuration:

1. Position access controller module over corresponding spacers and depress onto snap on spacers (Fig. 3 pg. 4).
2. Mount backplane to enclosure with hardware.

Access Controller Position Chart for the Following Models:

LenelS2 / Mercury Access Controller	Pem Mounting
LNL-1320-S3 / MR52	I J K L


Fig. 3

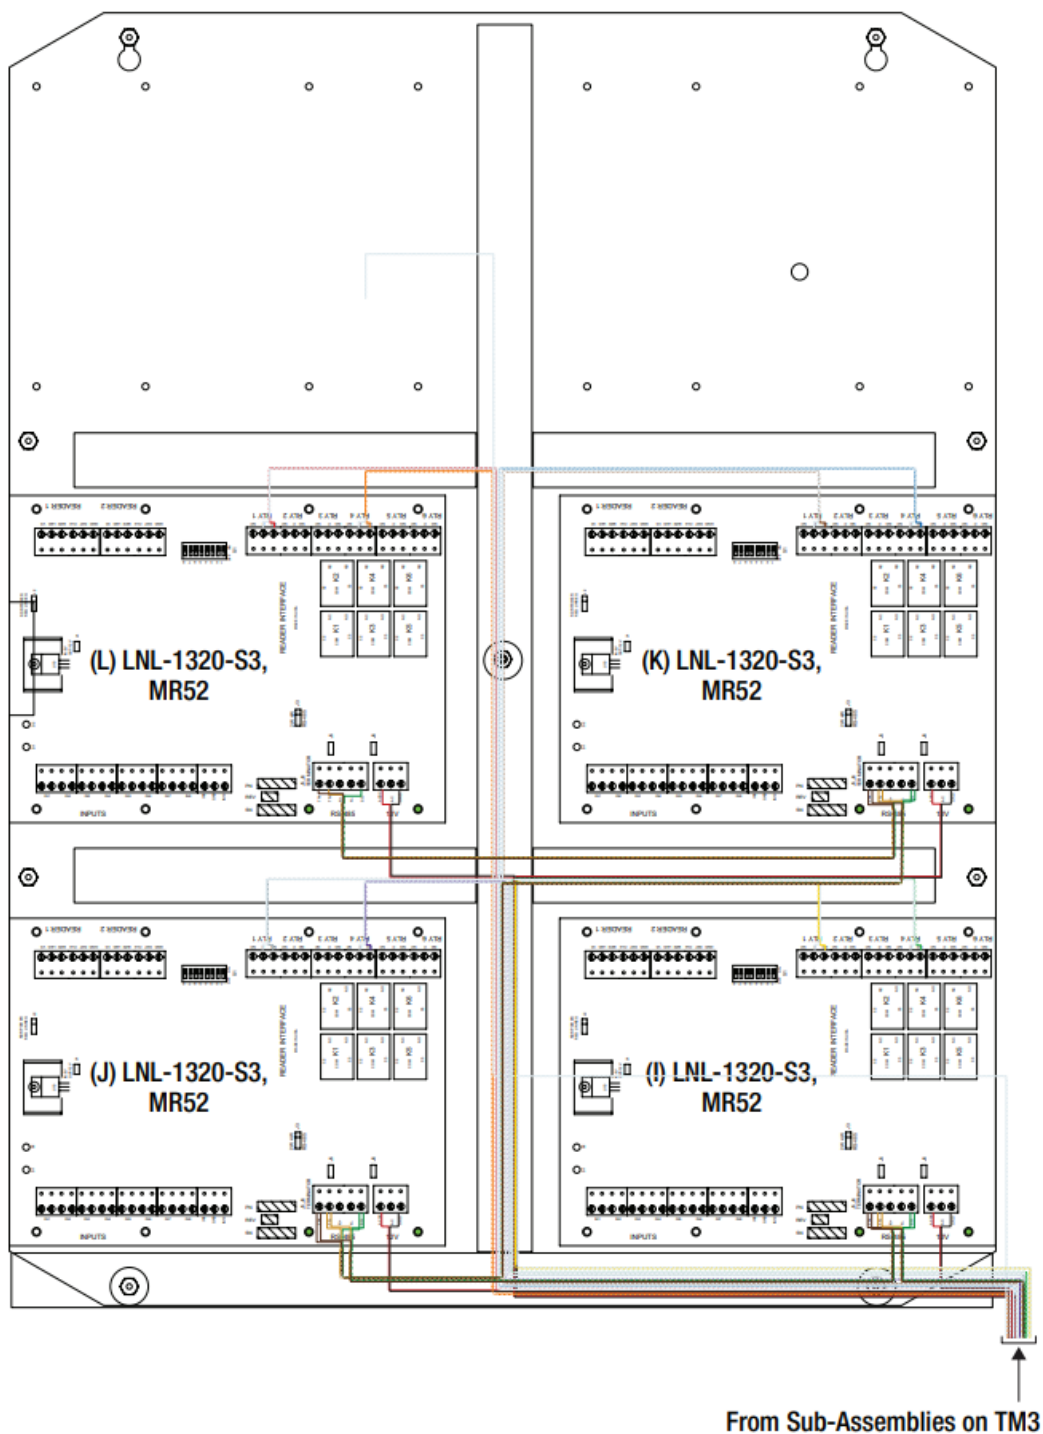

Trove3 Enclosure Dimensions

(H x W x D approximate):

36.12" x 30.125" x 7.06" (917.5mm x 768.1mm x 179.3mm)

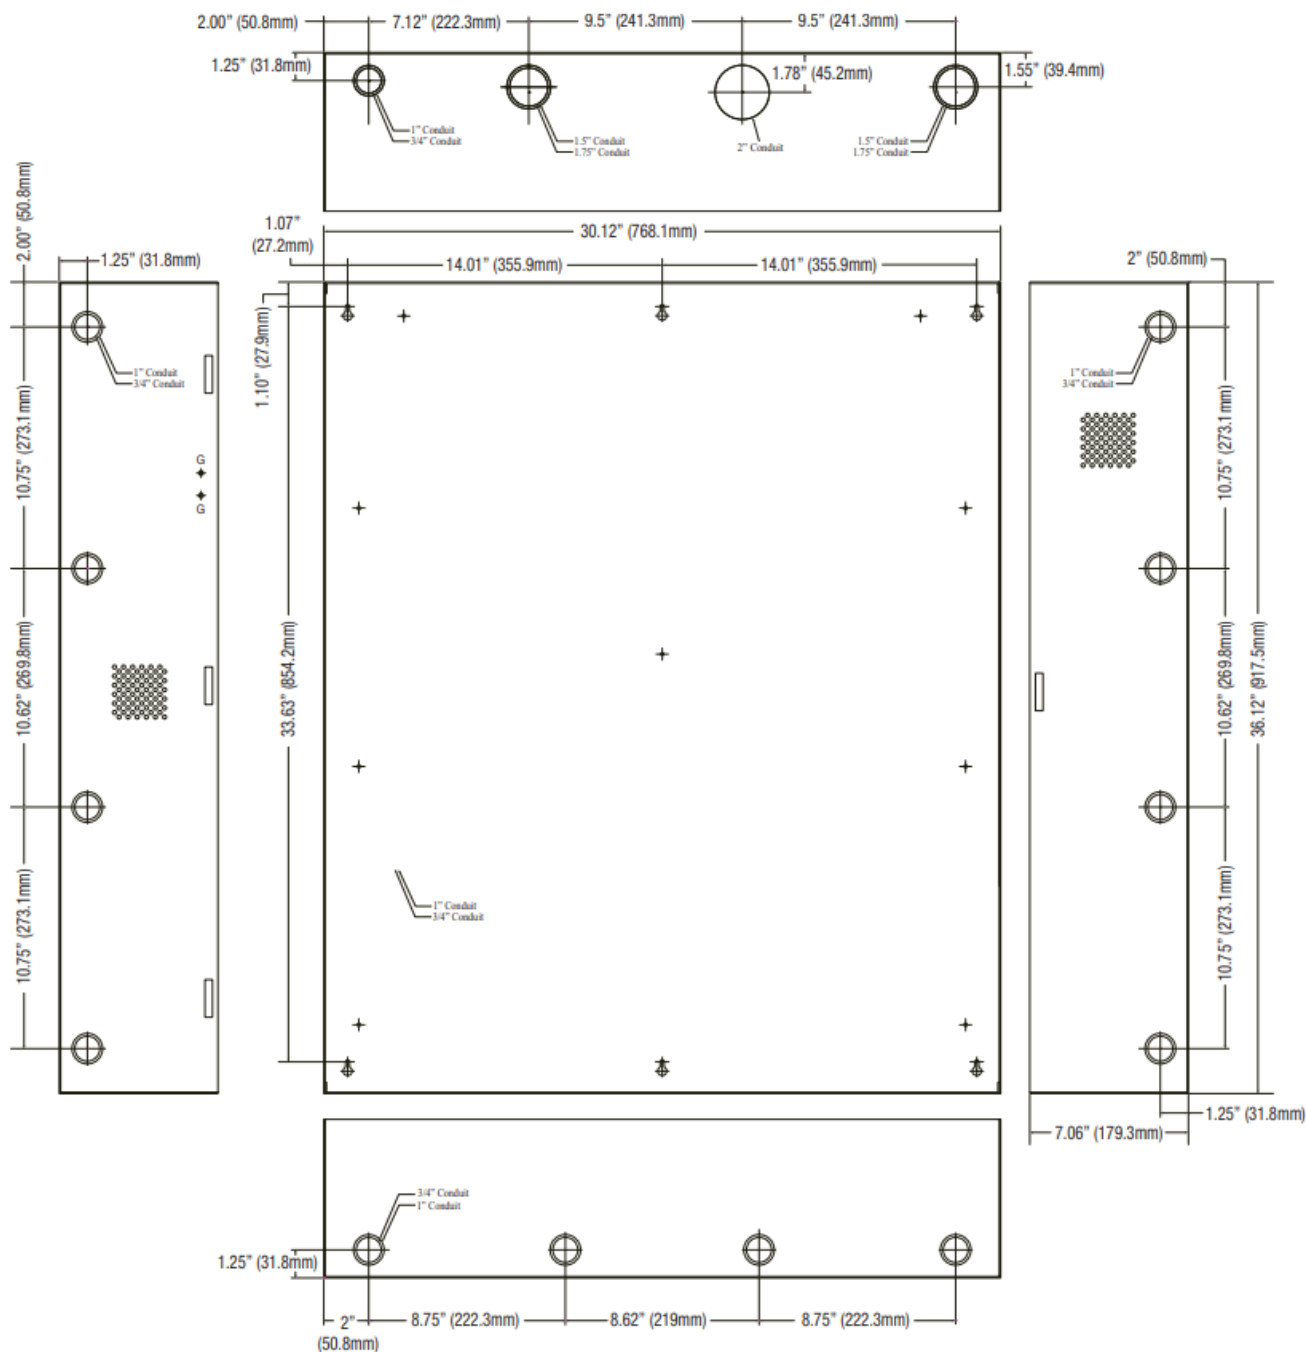


Customer Support

Altronix is not responsible for any typographical errors.
 140 58th Street, Brooklyn, New York 11220 USA | phone: 718-567-8181 | fax: 718-567-9056
 web site: www.altronix.com | e-mail: info@altronix.com | Lifetime Warranty
 IIT3M7724LXKV Kit Series



MEMBER

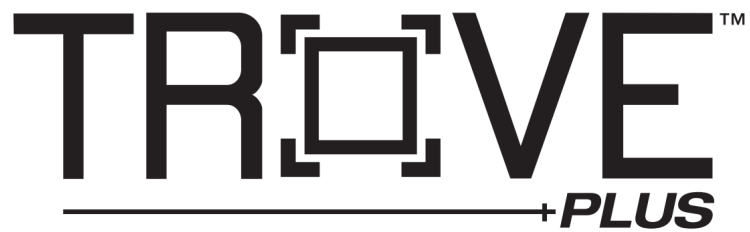

Documents / Resources

	TROVE T3M7724LXK1V Altronix Mercury Access and Power Integration Kit [pdf] Instruction Manual T3M7724LXK1V Altronix Mercury Access and Power Integration Kit, T3M7724LXK1V, Altronix Mercury Access and Power Integration Kit, Access and Power Integration Kit, Power Integration Kit, Integration Kit, Kit
---	---

References

-  [Altronix Home](#)
- [User Manual](#)

Manuals-. [Privacy Policy](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.