

Tyrrell Products TS101 Insertion Temperature Sensor User Guide

Home » Tyrrell Products » Tyrrell Products TS101 Insertion Temperature Sensor User Guide



Contents

- 1 Tyrrell Products TS101 Insertion Temperature **Sensor**
- **2 Product Information**
- **3 Product Usage Instructions**
- **4 Safety Precautions**
- **5 Product Introduction**
- **6 Features**
- 7 Hardware Introduction
- **8 Operation Guide**
- 9 Installation
- 10 Documents / Resources
 - 10.1 References
- 11 Related Posts

Tyrrell

Tyrrell Products TS101 Insertion Temperature Sensor



Product Information

Specifications

• Model: TS101

Temperature Sensor: DS18B20Protection Ratings: IP67, IK10

Measuring Range: Wide temperature range

• Power Source: Battery

Product Usage Instructions

Safety Precautions

Milesight will not shoulder responsibility for any loss or damage resulting from not following the instructions of this operating guide. The probe has a sharp point. Please be careful and keep the edges and points away from human body. The device must not be disassembled or remodeled in any way. To ensure the security of your device, please change the device password during the initial configuration. The default password is 123456. Do not place the device close to objects with naked flames. Do not place the device where the temperature is below/above the operating range. Make sure electronic components do not drop out of the enclosure while opening. When installing the battery, please install it accurately, and do not install the inverse or wrong model. The device must never be subjected to shocks or impacts.

Declaration of Conformity

TS101 conforms with the essential requirements and other relevant provisions of the CE, FCC, and RoHS.

Installation

The TS101 sensor is designed for insertion into various materials for temperature monitoring. Follow the provided guidelines to securely insert the sensor and ensure accurate temperature readings.

Communication Protocol

Refer to the user manual for details on the communication protocol supported by the TS101 sensor for transmitting temperature data.

FAQ

Q: What should I do if the device password is forgotten?

A: If you forget the device password, please contact Milesight technical support for assistance in resetting the password.

Q: Can the TS101 sensor be used for outdoor temperature monitoring?

A: Yes, the TS101 sensor is designed with IP67 protection ratings, making it suitable for outdoor use.

Insertion Temperature

Sensor Featuring LoRaWAN® TS101 User Guide

Safety Precautions

Milesight will not shoulder responsibility for any loss or damage resulting from not following the instructions of this operating guide.

- The probe has a sharp point. Please be careful and keep the edges and points away from human body.
- The device must not be disassembled or remodeled in any way.
- To ensure the security of your device, please change the device password during the initial configuration. The default password is 123456.
- Do not place the device close to objects with naked flames.
- Do not place the device where the temperature is below/above the operating range.
- Make sure electronic components do not drop out of the enclosure while opening.
- When installing the battery, please install it accurately, and do not install the inverse or wrong model.
- The device must never be subjected to shocks or impacts.

Declaration of Conformity

TS101 conforms with the essential requirements and other relevant provisions of the CE, FCC, and RoHS.









Copyright © 2011-2024 Milesight. All rights reserved.

All information in this guide is protected by copyright law. Whereby, no organization or individual shall copy or reproduce the whole or part of this user guide by any means without written authorization from Xiamen Milesight IoT Co., Ltd.



For assistance, please contact

Milesight technical support:

• Email: iot.support@milesight.com

• Support Portal: support.milesight-iot.com

Tel: 86-592-5085280Fax: 86-592-5023065

• Address: Building C09, Software Park III,

· Xiamen 361024, China

Revision History

Date	Doc Version	Description
April 10, 2023	V 1.0	Initial version
Feb. 20, 2024	V 1.1	Add temperature calibration downlink command

Product Introduction

Overview

Milesight TS101 is an all-in-one insertion temperature sensor with an integrated transmitter. It is equipped with an advanced measuring unit that provides a wide temperature measuring range.

With IP67 and IK10 ratings, the exquisite TS101 sensor is suitable for monitoring the inner temperature of Tobacco or grain stacks. It can also be applied in other warehousing scenarios which require inner temperature detection with high efficiency.

TS101 is compatible with Milesight LoRaWAN® gateway and mainstream LoRaWAN® network servers. With this low power consumption technology, TS101 can work for up to 10 years with a 4,000mAh battery. Combining with Milesight LoRaWAN® gateway and Milesight IoT solution, users can manage all data remotely and visually.

Features

- Equipped with highly accurate and stable DS18B20 temperature sensor chip with high resolution
- Adopt food-grade stainless-steel probe and shell material for efficient and safe detection
- Store up to 1200 sets of data locally and support data retrievability and retransmission
- IP67 and IK10 rated and phosphine corrosion-resistant for harsh environment
- Built-in 4000mAh replaceable battery and works for up to 10 years without replacement
- Integrated and compact design for wireless deployment
- Built-in NFC for easy configuration
- Compliant with standard LoRaWAN® gateway and network servers
- · Quick and easy management with Milesight IoT Cloud solution

Hardware Introduction


Packing List




1 × TS101 Device 1 × Quick Start Guide 1 × Warranty Card

If any of the above items is missing or damaged, please contact your sales representative.

Hardware Overview

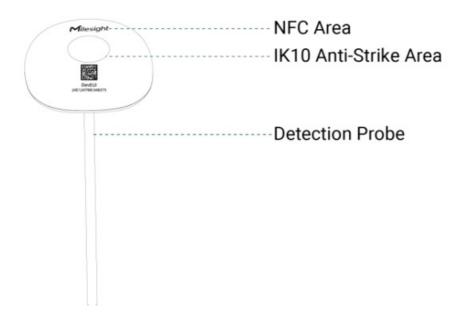

Dimensions (mm)

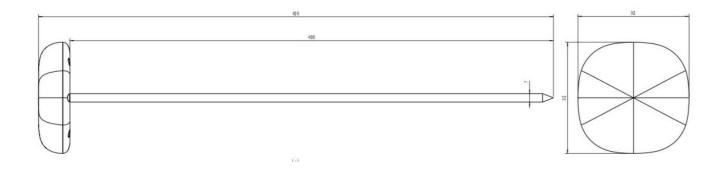

Reset Button & LED Patterns

TS101 sensor equips with a reset button and a LED indicator inside the device, please remove the cover for emergency reset or reboot. Usually, users can use NFC to complete all steps.

Function	Action	LED Indicator	
Power On	Press and hold the button for more than 3 seconds.	Off → On	
Power Off	Press and hold the button for more than 3 seconds.	On → Off	
Reset to Factory De fault	Press and hold the button for more than 10 seconds.	Blinks quickly	
Check		Light On: Device is On.	
On/Off Status	Quickly press the reset button.	Light Off: Device is Off.	


Operation Guide

NFC Configuration

TS101 can be configured via NFC.

- 1. Download and install "Milesight ToolBox" App from Google Play or App Store.
- 2. Enable NFC on the smartphone and open "Milesight ToolBox" App.
- 3. Attach the smartphone with the NFC area to the device to read the basic information.

4.

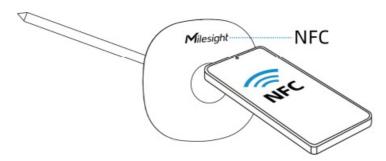

Basic information and settings of devices will be shown on ToolBox if it's recognized successfully. You can read and write the device by tapping the button on the App. Password validation is required when configuring devices via an unused phone to ensure security. The default password is 123456.

Status	Setting	Maintenance
SN	6732	D07453450005
Model		TS101-868M
Device EUI	24E1	24732D074534
Firmware Version		V1.1
Hardware Version		V1.0
Device Status		ON

Note

- 1. Ensure the location of the smartphone NFC area and it's recommended to take off the phone case.
- 2. If the smartphone fails to read/write configurations via NFC, move it away and try again later.

LoRaWAN Settings

LoRaWAN settings is used for configuring the transmission parameters in LoRaWAN® network.



Parameters Description

Device EUI	The device's unique ID can also be found on the label.			
App EUI	The default App EUI is 24E124C0002A0001.			
Application Port	The port used for sending and receiving data, the default port is 85.			
Join Type	OTAA and ABP modes are available.			
Application Key	Appkey for OTAA mode, default is 5572404C696E6B4C6F52613230313823.			
Device Address	DevAddr for ABP mode, default is the 5th to 12th digits of SN.			
Network Session				
Key	Nwkskey for ABP mode, default is 5572404C696E6B4C6F52613230313823.			
Application Session Key	Appskey for ABP mode, default is 5572404C696E6B4C6F52613230313823.			
LoRaWAN Version	V1.0.2 and V1.0.3 are available.			
Work Mode	It's fixed as Class A.			
RX2 Data Rate	RX2 data rate to receive downlinks.			
RX2 Frequency	RX2 frequency to receive downlinks. Unit: Hz			
	Enable or disable the frequency to send uplinks. If frequency is one of CN470/AU915/U S915, enter the index of the channel that you want to enable in the input box, making them separated by commas.			
	Examples:			
	• 1, 40: Enabling Channel 1 and Channel 40			
Supported Frequency	1-40: Enabling Channel 1 to Channel 40			
Capported Frequency	1-40, 60: Enabling Channel 1 to Channel 40 and Channel 60 All: Enabling all channel			
	s			
	Null: Indicate that all channels are disabled			

		Standard-Chanr	nel	*	
		Enable Channel Index 1			
		0-71			
		Index	Frequency/MHz	1	
		0 - 15	902.3 - 905.3		
		16 - 31	905.5 - 908.5		
		32 - 47	908.7 - 911.7		
		48 - 63	911.9 - 914.9		
		A4 - 71	903 - 914 2		
Spread Factor	If ADR is disabled, t	he device will se	nd data via this spread	d factor.	
Confirmed Mode	If the device does not receive an ACK packet from the network server, it will resend data once.				
Rejoin Mode	AC packets to the n val to validate connecting interval >	etwork server evectivity; If there is 35 mins: the deetwork server ev	ery reporting interval of s no response, the devivice will send a specific ery reporting interval t	c number of LinkCheckReq M or every double reporting intervice will re-join the network. c number of LinkCheckReq M o validate connectivity; If ther	
Set the number of pa ckets sent	When rejoin mode is enabled, set the number of LinkCheckReq packets sent.				
ADR Mode	Allow the network server to adjust datarate of the device. This only works with Standard Channel Mode.				
Tx Power	Transmit power of the	ne device.			


Note

- 1. Please contact sales for the device EUI list if there are many units.
- 2. Please contact sales if you need random App keys before purchase.
- 3. Select OTAA mode if you use Milesight IoT Cloud to manage devices.
- 4. Only OTAA mode supports rejoin mode.

Time Synchronization

ToolBox App Sync

Go to Device > Status of ToolBox App to click Sync to sync the time.

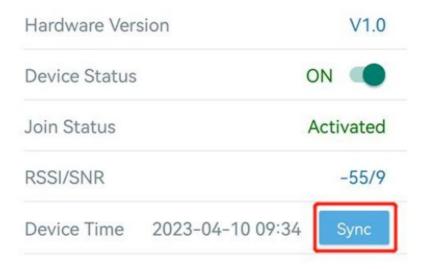

Network Server Sync:


Change device LoRaWAN® Version as 1.0.3, the device will ask the network server for the time everytime it joins the network.

Note

- 1. This function is only applicable to network server using LoRaWAN® 1.0.3 or 1.1 version.
- 2. Network server will sync the time which timezone is UTC+0 by default. It's suggested to sync the timezone via ToolBox App to change the timezone.

Basic Settings

Go to Device > Setting > General Settings to change the reporting interval, etc.

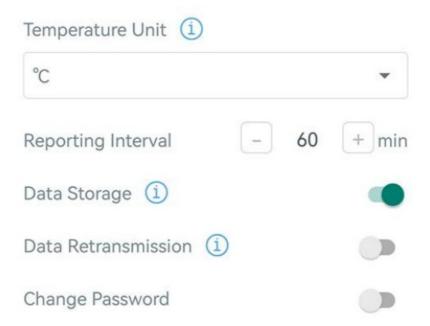

Parameters	Description
Deposition Interval	Reporting interval of transmitting data to the network server. Range:
Reporting Interval	1~1080min; Default: 60min
	Change the temperature unit displayed on the ToolBox. Note:
Temperature Unit	1. The temperature unit in the reporting package is fixed as °C.
	2. Please modify the threshold settings if the unit is changed.

Data Storage	Disable or enable reporting data storage locally.
Data Retransmission	Disable or enable data retransmission.
Change Password	Change the password for ToolBox app to write this device.

Advanced Settings

Calibration Settings

ToolBox supports temperature calibration. Go to Device > Setting > Calibration Settings to type the calibration value and save, the device will add the calibration to raw value.



Threshold Settings

Go to Device > Setting > Threshold Settings to enable the threshold settings and input the threshold. TS101 sensor will upload the current data once instantly when the temperature threshold is triggered. Note that when you change the temperature unit, please re-configure the threshold.

emperature			
Over / °C			
Below / °C			
Temperature mutat	ion valu	ie over /	/°C ●
0.0			
Collecting Interval		10	+ mir

Parameters	Description
Temperature Threshold	When the temperature is over or below the threshold value, the

	device will report an alarm packet.
	When the temperature mutation value is over the threshold value, the device w ill report an alarm packet.
Temperature Mutation Value	Temperature Mutation Value = Current temperature - Last temperature .
Collecting Interval	Collecting interval for detecting the temperature. Default: 10min; Range: 1~108 0min

Data Storage


TS101 sensor supports storing more than 1,200 data records locally and export data via ToolBox App. The device will record the data according to reporting interval even not joining to network.

1. Go to Device > Setting > General Settings of ToolBox App to enable data storage feature.

2.



Go to Device > Maintenance of ToolBox App, click Export, then select the data time period and click Confirm to export data. The maximum export data period on ToolBox App is 14 days.

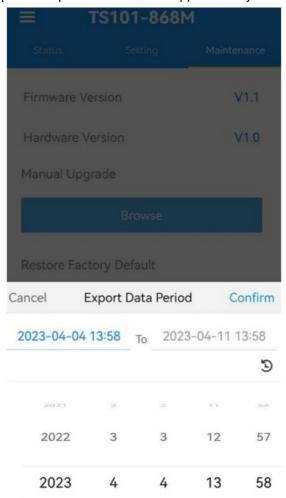

3. Click Data Cleaning to clear all stored data inside the device.



Data Retransmission

TS101 sensor supports data retransmission to ensure the network server can get all data even if network is down for some times. There are two ways to get the lost data:

· Network server sends downlink commands to enquire the historical data for specifying time range, refer to

section Historical Data Enquiry.

• When network is down if no response from LinkCheckReq MAC packets for a period of time, the device will record the network disconnected time and re-transmit the lost data after device re-connects the network.

Here are the steps for retransmission:

- 1. Refer to Time Synchronization to sync the device time
- 2. Go to Device > Setting > General Settings to enable data storage and data retransmission feature.

3.



Go to Device > Setting > LoRaWAN Settings to enable rejoin mode and set the number of packet sent. For example, the device will send LinkCheckReq MAC packets to the network server regularly to check any network disconnection; if there is no response for 4 +1 times, the join status will change to de-activate and the device will record a data lost time point (the time it reconnected to the network).



4. After the network connected back, the device will send the lost data from the point in time when the data was lost according to the reporting interval.

Note

- 1. If the device is reboot or re-powered when data retransmission is not completed, the device will re-send all retransmission data again after device is reconnected to the network.
- 2. If the network is disconnected again during data retransmission, it will only send the latest disconnection data.
- 3. The retransmission data format is started with "20ce", please refer to section Historical Data Enquiry.
- 4. Data retransmission will increase the uplinks and shorten the battery life.

Maintenance


Upgrade

- 1. Download firmware from Milesight website to your smartphone.
- 2. Open Toolbox App, go to Device > Maintenance and click Browse to import firmware and upgrade the device.

Note

1. Operation on ToolBox is not supported during a firmware upgrade.


2. Only the Android version of ToolBox supports the upgrade feature.

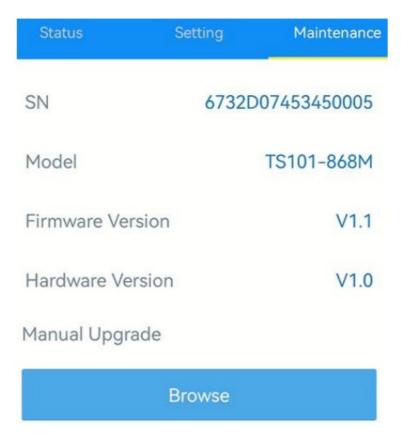


Backup

TS101 supports configure backup for easy and quick device configuration in bulk. Backup is allowed only for devices with the same model and LoRaWAN® frequency band.

- 1. Go to Template page on the App and save the current settings as a template. You can also edit the template file.
- 2. Select one template file saved in the smartphone and click Write, then attach the smartphone to another device to write the configuration.

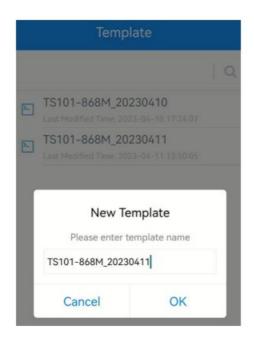

Note: Slide the template item left to edit or delete the template. Click the template to edit the configurations.

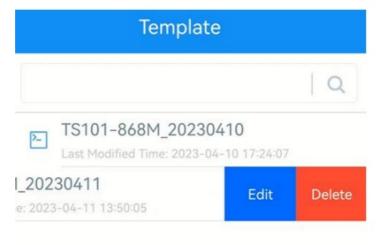

Reset to Factory Default


Please select one of the following methods to reset the device:

- Via Hardware: Hold on the power button (internal) for more than 10s.
- Via ToolBox App: Go to Device > Maintenance to click Reset, then attach the smartphone with NFC area to the device to complete the reset.

Status	Setting	Maintenance
SN	6732	D07453450005
Model		TS101-868M
Firmware Versi	on	V1.1
Hardware Versi	on	V1.0
Manual Upgrad	е	
	Browse	
Restore Factory	Default	
	Reset	

Insert the probe into the measured object directly.

Note: If the density of the measured object is too high to insert the probe directly (such as haystack), please use rubber hammer to strike the anti-strike area of TS101 until the probe is completely inserted into the measured object.

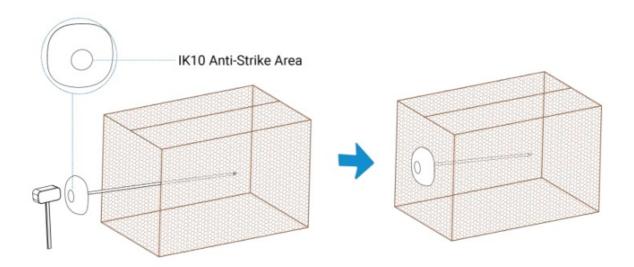

Communication Protocol

All data are based on the following format (HEX), the Data field should follow little-endian:

Channel1	Type1	Data1	Channel2	Type2	Data2	Channel 3	
1 Byte	1 Byte	N Bytes	1 Byte	1 Byte	M Bytes	1 Byte	

For decoder examples please find files on https://github.com/Milesight-IoT/SensorDecoders.

Basic Information

TS101 reports basic information about the sensor every time it joins the network.

Channel	Туре	Description
	01(Protocol Version)	01=>V1
	09 (Hardware Version)	01 40 => V1.4
	0a (Software Version)	01 14 => V1.14
	0b (Power On)	Device is on
ff	Of (Device Type)	00: Class A, 01: Class B, 02: Class C
	16 (Device SN)	16 digits

Example:

ff0bff ff0101	ff0bff ff0101 ff166732d07453450005 ff090100 ff0a0101 ff0f00				
Channel	Туре	Value	Channel	Туре	Value
ff	0b (Power On)	ff (Reserved)	ff	01 (Protocol Version)	01 (V1)
Channel	Туре	Value	Channel	Туре	Value
ff	16	6732d07453	ff	09	0100
11	(Device SN)	450005	- 11	(Hardware version)	(V1.0)
Channel	Туре	Value	Channel	Туре	Value
ff	0a (Software version)	0101 (V1.1)	ff	0f (Device Type)	00 (Class A)

Sensor Data

Item	Channel	Туре	Description
Battery Level	01	75	UINT8, Unit: %
Temperature	03	67	INT16/10, Unit: °C, Resolution: 0.1°C
			3 Bytes, Temperature(2B) + 01
Threshold Alarm	83	67	Temperature: INT16/10, Unit: °C
Mutation Threshold Al arm	93	d7	5 Bytes, Temperature(2B) + Mutation Value(2B) + 02 Temperature: INT16/10, Unit: °C Mutation Value: INT16/100, Unit: °C

1. Periodic Packet: report according to reporting interval (60 min by default).

017564 0367f900					
Channel	Туре	Value	Channel	Туре	Value
01	75 (Battery)	64 => 100%	03	67 (Temperature)	f9 00 => 00 f9 =>249/10=24.9°C

2. Temperature Threshold Alarm Packet

83675201 01		
Channel	Туре	Value
	67	52 01 => 01 52 => 338/10 = 33.8°C
83	(Temperature)	01 => Temperature Alarm

3. Temperature Mutation Alarm Packet

93d74e01 c6	93d74e01 c602 02		
Channel	Type Value		
		Temperature: 4e 01 => 01 4e => 334/10	
	d7	= 33.4°C	
93	(Temperature	Mutation Value: c6 02 => 02 c6 =>	
	Mutation Threshold)	710/10=7.1°C	
		02 => Mutation Alarm	

Downlink Commands

TS101 supports downlink commands to configure the device. The application port is 85 by default.

Item	Channel	Туре	Description
Reboot		10	ff (Reserved)
Reporting Interval		03	2 Bytes, unit: s
Collecting Interval		02	2 Bytes, unit: s
			9 Bytes, CTRL(1B)+Min(2B)+Max(2B)+00000000(4B)
Threshold Alarm	ff	06	CTRL:
THESHOL ALATH		00	Bit2~Bit0: 000=disable 001=below 010=above 011=wit hin

		100=below or above
		Bit5~Bit3: ID
		001=Temperature Threshold
		010=Temperature Mutation Threshold
		Bit6:
		0=disable the Alarm Threshold
		1=enable the Alarm Threshold
		Bit7: Reserved
		Byte 1: 00-disable, 01-enable
Temperature Calibration	ab	Byte 2-3: calibration value, INT16/10, unit: °C
UTC Time Zone	17	INT16/10
Data Storage	68	00: disable, 01: enable
Data Retransmission	69	00: disable, 01: enable
		3 Bytes
Data Retransmission		Byte 1: 00
Interval	6a	Byte 2-3: interval time, unit:s
		range: 30~1200s (600s by default)

Example:

1. Set reporting interval as 20 minutes.

ff03b004		
Channel	Туре	Value
ff	03 (Set Reporting Interval)	b0 04 => 04 b0 = 1200s = 20 minutes

2. Reboot the device.

ff1Off		
Channel	Туре	Value
ff	10 (Reboot)	ff (Reserved)

3. Enable temperature threshold and configure the alarm when the temperature exceeds 30°C.

ff06 ca 0000	ff06 ca 0000 2c01 00000000		
Channel	Туре	Value	
		CTRL: ca =11 001 010	
		010 = above	
ff	06 (Set Threshold Alarm)	001 = Temperature Threshold 1 = enable the Threshold Alarm	
		Max: 2c 01 => 01 2c => 300*0.1 = 30°C	

4. Disable mutation threshold and configure the alarm when the mutation value exceeds 5°C.

ff06 10 0000 3	ff06 10 0000 3200 00000000		
Channel	Туре	Value	
ff	06(Set Threshold Alarm)	CTRL: 10 = 00 010 000 010 = Temperature Mutation Threshold 0 = disable the Threshold Alarm Max: 32 00 => 00 32 => 50*0.1 = 5°C	

5. Enable temperature calibration and set calibration value.

ffab01fdff		
Channel	Туре	Value
ff	ab (Temperature Calibration)	01=Enable fdff=>fffd=-3/10=-0.3 °C

6. Set the time zone.

ff17ecff		
Channel	Туре	Value
ff	17	ec ff => ff ec = -20/10=-2 the time zone is UTC-2

Historical Data Enquiry

TS101 supports sending downlink commands to enquire historical data for specified time point or time range. Before that, ensure the device time is correct and data storage feature was enabled to store the data.

Command format

Channel	Туре	Description	
fd	6b (Enquire data in time point)	4 Bytes, unix timestamp	
fd	6c (Enquire data in time range)	Start time (4 bytes) + End time (4 bytes), Unix timesta mp	
fd	6d (Stop query data report)	ff	
ff	6a (Report Interval)	3 Bytes, Byte 1: 01 Byte 2: interval time, unit: s, range: 30~1200s (60s by default)	

Reply format:

Channel	Туре	Description
fc	6b/6c	00: data enquiry success

		01: time point or time range invalid 02: no data in this time or time range
20	ce (Historical Data)	Data time stamp (4 Bytes) + Data Contents (Mutable)

Note

- 1. The device only uploads no more than 300 data records per range enquiry.
- 2. When enquiring the data in time point, it will upload the data which is the closest to the search point within the reporting interval range. For example, if the device's reporting interval is 10 minutes and users send command to search for 17:00's data, if the device find there is data stored in 17:00, it will upload these data. If not, it will search for data between 16:50 to 17:10 and upload the data which is the closest to 17:00.

Example

1. Enquire historical data between 2023/3/29 15:05:00 to 2023-3-29 15:30:00.

fd6c 1ce32364 f8e82364			
Channel	Туре	Value	
		Start time: 1ce32364=> 6423e31c =	
fd	6c (Enquire data in time	1680073500s =2023/3/29 15:05:00	
	range)	End time: f8e82364 => 6423e8f8 =	
		1680075000s =2023-3-29 15:30:00	

Reply:

fc6c00		
Channel	Туре	Value
fc	6c (Enquire data in time range)	00: data enquiry success

20ce 23e42364 0401			
Channel	Туре	Time Stamp	Value
		23e42364 => 6423e423 =>	Temperature:
20	ce (Historical Data)	1680073763s	04 01=>01 04 =26°C
		= 2023-3-29 15:09:23	

Documents / Resources



<u>Tyrrell Products TS101 Insertion Temperature Sensor</u> [pdf] User Guide TS101, TS101 Insertion Temperature Sensor, TS101, Insertion Temperature Sensor, Temperature Sensor, Sensor

References

- Support : IoT Support
- Q GitHub Milesight-IoT/SensorDecoders
- User Manual

Manuals+, Privacy Policy