
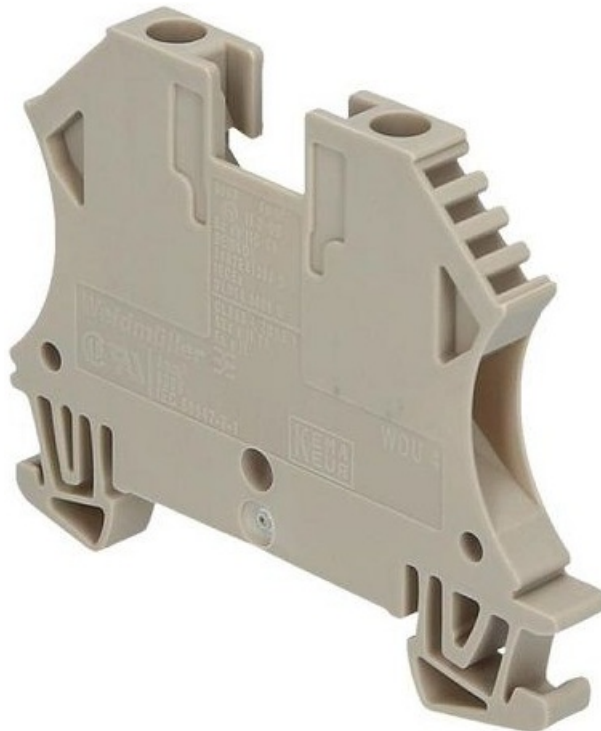




Weidmuller UL21UKEX2115U Modular Terminal Blocks Instructions

[Home](#) » [Weidmuller](#) » Weidmuller UL21UKEX2115U Modular Terminal Blocks Instructions 

Weidmuller UL21UKEX2115U Modular Terminal Blocks Instructions



Contents

- 1 Test – Disconnect Terminal Blocks
- 2 Technical data according to IEC/EN 60079-7 (increased safety “ec”)
- 3 Service life acc. To IEC 60947-7-1
- 4 Mounting instructions:
- 5 Schedule of Limitations:
- 6 Essential Health and Safety Requirements:
- 7 Documents / Resources
 - 7.1 References
- 8 Related Posts

Test – Disconnect Terminal Blocks

Version	
Type	Order No
WTR 2.5 *	1855610000
WTR 2.5 STB *	1855620000

Accessories		
End Plate	WAP 2.5-10*	Order No
End bracket	WEW 35/2*	1050000000
Terminal rail	1855TS 35/... acc.to DIN EN 60715620000	1061200000

Cross-connection	Pluggable	Order No
	ZQV 2.5N/2*	
	ZQV 2.5N/3*	
	ZQV 2.5N/4*	
	ZQV 2.5N/5*	
	ZQV 2.5N/6*	
	ZQV 2.5N/7*	
	ZQV 2.5N/8*	
	ZQV 2.5N/9*	
	ZQV 2.5N/10*	

Insulation material

- **Type:** Wemid
- **Tracking resistance (A) to IEC 60112:** CTI \geq 600

- **Flammability class to UL 94:** V0
- **Operating temperature range:** -60°C...+130°C (insulating material limit)

Technical data according to IEC/EN 60079-7 (increased safety “ec”)

- **Rated voltage:** 500 V
- **Rated current:** 21 A
- **Contact resistance with rated conductor, 2.5 mm:** 0.8 mΩ
- **Rated conductor cross section:** 2.5 mm²
- **Conductor cross section solid:** 0.14 – 4.0 mm²
- **Conductor cross section stranded:** 0.14 – 4.0 mm²
- **Conductor cross section flexible:** 0.14 – 4.0 mm²
- **Conductor cross section flexible with ferrule:** 0.14 – 1.5 mm²
- **Cross section, American Wire Gauge:** 26 – 12 AWG
- **Tightening torque range, terminal screw:** 0.4 – 0.8 Nm
- **Stripping length:** 10 +/- 1 mm

Service life acc. To IEC 60947-7-1

- **max. no. Of actuation:** 100 cycles

Note:

The creep age and clearance distances were determined in the worst case. (with closed or open clamping yoke)
If smaller cross sections than the rated cross section are used, the belonging lower current has to be laid down in the IECEx/EC-Type Examination Certificate of the complete apparatus

Mounting instructions:

The WTR 2.5 terminal block is suitable for application in enclosures in atmospheres with flammable gases and combustible dust. For use in flammable gases these enclosures must satisfy the requirements according to EN/IEC 60079-0 and EN/IEC 60079-7. For use in combustible dust these enclosures must satisfy the requirements according to EN/IEC 60079-0 and EN/IEC 60079-31.

In combination with other terminal block series and sizes and if other accessories are used, the applicable creepage and clearance distances shall be met.

Regarding the use of accessories the instructions of the manufacturer must be followed.

Schedule of Limitations:

The disconnect terminal block is suitable for use in enclosures in atmospheres with flammable gases and combustible dust. For flammable gases these enclosures must satisfy the requirements according to EN/IEC 60079-0 and EN/IEC 60079-7. For combustible dust these enclosures must satisfy the requirements according to EN/IEC 60079-31.

The terminal blocks shall be placed inside a suitable IECEx/ATEX/UKCA certified IP54 enclosure for gas atmosphere. For dust atmosphere the terminal blocks shall be mounted inside a suitable IECEx/ATEX/UKCA certified ‘t’ enclosure (EN/IEC 60079-31).

The enclosure shall be constructed to block all sun and UV light from affecting the terminal blocks.

Under normal operating conditions the temperature rise of the terminal blocks is max 40 K, measured with the max permitted rated current. Due to the above mentioned the terminal blocks may be used in apparatus of temperature classes T6...T1 as long as the terminal block ambient temperature range is not exceeded as shown below. No part of terminal block must exceed 130° C under any condition.

WARNING – Do not remove or replace the fuse/test disconnect switch when energized!

When using the types WTR 2.5 with other terminal blocks series or sizes or accessories, the requirements for clearance and creepages distances according to EN/IEC 60079-7 must be observed. Regarding the use of covers, cross-connectors and end brackets the instructions of the manufacturer must be followed.


For terminal jumper accessories current ratings and the resistances across the terminals please refer to the table under "Technical data" above.

The terminal can be used with either one or two wires into either side of the terminal. When two wires are used they must be of the same type, and of equal sizes. No other wire sizes or types than the ones specified in instructions must be used. The terminal blocks must either be mounted next to another block of the same type and size or with an end plate.

If smaller conductor cross sections than the rated conductor cross sections are used, then the corresponding lower current shall be stated in the Certificate of the complete apparatus.

Unused terminals shall be tightened.


The terminal blocks may be used, based on the self-heating when used at the nominal current and at ambient temperatures of – 60 °C to + 40 °C at the mounting position in electrical apparatus, e.g. junction and connection boxes, for temperature class T6. When the terminal blocks are used in electrical apparatus of temperature classes T1 up to T5, the highest temperature of the insulating material shall not exceed the max. value of the operating temperature range.

-  Cross connections with blank ends shall not be used.
- Manually cut cross connections shall not be used.

Essential Health and Safety Requirements:

Concerning ESRs this Schedule verifies compliance with the Annex II of ATEX / Schedule 1 of UKCA directive and Equipment and Protective Systems Intended for Use in Potentially Explosive Atmospheres Regulations 2016 only. By placing the product on the market, the manufacturer declares compliance with other relevant Directives, and all other safety related requirements including those of Annex II / Schedule 1 of these Directives.

Weidmüller 



[Weidmuller UL21UKEX2115U Modular Terminal Blocks](#) [pdf] Instructions
UL21UKEX2115U Modular Terminal Blocks, UL21UKEX2115U, Modular Terminal Blocks, Terminal Blocks, Blocks

References

- [acc.to](#)
- [User Manual](#)